



ALLEN & MAJOR
ASSOCIATES, INC.

SITE LOCUS

NOT TO SCALE




ALTA at RIVER'S EDGE 490 BOSTON POST ROAD WAYLAND, MASSACHUSETTS DRAINAGE REPORT

PREPARED: JUNE 20, 2019

REVISED: OCTOBER 18, 2019

CLIENT:
WP EAST ACQUISITIONS, LLC.
91 HARTWELL AVENUE
LEXINGTON, MA 02421

PREPARED BY:
ALLEN & MAJOR ASSOCIATES, INC.
100 COMMERCE WAY, SUITE #5
WOBURN, MASSACHUSETTS, 01801

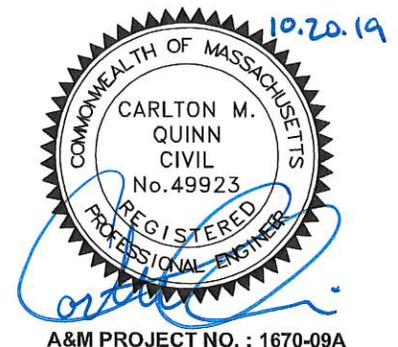

DRAINAGE REPORT

ALTA AT RIVER'S EDGE
#490 BOSTON POST ROAD
WAYLAND, MA

PROPONENT:

WP EAST ACQUISITIONS, LLC
91 HARTWELL AVENUE
LEXINGTON, MA 02421

PREPARED BY:

ALLEN & MAJOR ASSOCIATES, INC.
100 COMMERCE WAY, SUITE 5
WOBURN, MA 01801

ISSUED: JUNE 20, 2019

REVISED: SEPTEMBER 27, 2019

A&M PROJECT #1670-09A

DRAINAGE REPORT

ALTA at River's Edge
Wayland, MA

A&M Project #1670-09A
October 18, 2019

TITLE PAGE	i
TABLE OF CONTENTS	iii

Section 1.0

INTRODUCTION	1
SITE CHARACTERIZATION FOR STORMWATER REGULATIONS	1
SITE LOCATION AND ACCESS	1
EXISTING SITE CONDITIONS	1
WATERSHED	2
EXISTING SOIL CONDITIONS	2
FEMA FLOODPLAIN/ENVIRONMENTAL DUE DILIGENCE	3
ENVIRONMENTALLY SENSITIVE ZONES	3
DRAINAGE ANALYSIS METHODOLOGY	3
PROPOSED CONDITIONS - PEAK RATE OF RUNOFF	4
MADEP PERFORMANCE STANDARDS	5
MADEP STORMWATER REPORT CHECKLIST	10

Section 2.0

OPERATION AND MAINTENANCE PLAN	1
INTRODUCTION	1
DEMOLITION & CONSTRUCTION MAINTENANCE PLAN	2
POST-CONSTRUCTION MAINTENANCE PLAN	3
LANDSCAPE MANAGEMENT PLAN	5
MANAGEMENT OF DEICING CHEMICALS AND SNOW	8
SPILL PREVENTION AND RESPONSE	9
PET WASTE MANAGEMENT	9
OPERATION & MAINTENANCE SUMMARY TABLE	10
SNOW DISPOSAL GUIDANCE	11
MOSQUITO CONTROL IN STORMWATER PROJECTS	15
CDS GUIDE: OPERATION, DESIGN, PERFORMANCE, AND MAINTENANCE	19
STORMTECH OPERATION AND MAINTENANCE MANUAL	27
OPERATION AND MAINTENANCE PLAN	31

Section 3.0

USGS SITE LOCUS MAP	EX-1
AERIAL PHOTO	EX-2
FEMA FLOOD INSURANCE RATE MAP	EX-3
MASSDEP WETLANDS	EX-4
SOILS MAP	EX-5
NHESP MAP	EX-6

DRAINAGE REPORT

ALTA at River's Edge
Wayland, MA

A&M Project #1670-09A
October 18, 2019

Section 4.0

EXISTING HYDROCAD4.1
PROPOSED HYDROCAD.....4.2

Section 5.0

EXISTING WATERSHED PLANEWS-1
PROPOSED WATERSHED PLANPWS-1
PROPOSED GRADING & DRAINAGE PLANC-103

Section 6.0

SOIL HSG INFORMATION6.1
GEOTECHNICAL REPORT (BY OTHERS)6.2
RAINFALL DATA6.3
MANNING’S ROUGHNESS COEFFICIENT TABLE6.4
NJDEP CDS CERTIFICATION LETTER6.5
DEP STANDARD CALCULATIONS6.6
STORMWATER PIPE SIZING TABLE6.7
RIP-RAP SIZING CALCULATION SPREADSHEET6.8
ILLICIT DISCHARGE STATEMENT6.9

DRAINAGE REPORT

*ALTA at River's Edge
Wayland, MA*

*A&M Project #1670-09A
October 18, 2019*

INTRODUCTION

The purpose of this drainage report is to provide an overview of the proposed stormwater management system (SMS) for the multi-family residential development located at #490 Boston Post Road (MA Route 20) in Wayland, MA. The report will show by means of narrative, calculations and exhibits that the proposed stormwater management system will meet or exceed the 10 Massachusetts Department of Environment Protection (DEP) stormwater standards.

The proposed site development includes three (3) three- and four-story multi-family residential apartment buildings with parking garages beneath, off-street surface parking, utilities, drainage and associated site-work. A proposed driveway will provide access to the site from an existing access drive immediately adjacent to Boston Post Road (MA Route 20). The project will be serviced by municipal water and an on-site wastewater treatment plant with associated leach field.

The SMS incorporates structural and non-structural Best Management Practices (BMPs) to provide stormwater peak flow mitigation, quality treatment, and conveyance. The SMS includes deep-sump, hooded catch basins, drain manholes, hydrodynamic separators, underground infiltration ponds equipped with isolator rows, outlet protection, concrete headwalls with rip-rap lined aprons, and a long-term Operation and Maintenance Plan.

SITE CATEGORIZATION FOR STORMWATER REGULATIONS

The proposed project at #490 Boston Post Road is considered a new development under the DEP Stormwater Management Standards due to the net increase in impervious area. A new development project is required to meet the ten (10) Stormwater Standards within the MA DEP Stormwater Handbook. Standards 1, 8, 9 and 10 must always be fully met.

SITE LOCATION AND ACCESS

The subject parcel is located at #490 Boston Post Road, along the western edge of the Town of Wayland, and directly abuts the Town of Sudbury. The parcel is 8.25+/- acres and is identified on the Town of Wayland Assessor's database as Map 22, Lots 003 (portion, 006, and 007 (portion). Wayland is located in Middlesex County and is approximately 20 miles west of the City of Boston. The site is located approximately 2.0 miles southeast on Middlesex Turnpike from the intersection at Concord Road. Exhibit 1 shows the location of the property on Boston Post Road.

The parcel is abutted by Boston Post Road (MA Route 20) to the south of the property; an undeveloped lot owned by the Town of Wayland to the north and east (0 Boston Post Road); and the Town of Sudbury to the west. The northern portion of the property contains bordering vegetated wetlands.

EXISTING SITE CONDITIONS

The site currently includes a 7,000± square-foot (SF) one-story brick and concrete building, a loading dock, a paved parking lot, several circular storage tanks, and multiple outbuildings including sheds. A portion of the site was previously used as a refuse facility. The parcel has two (2) access points, from an unnamed access road which connects to Boston Post Road, as well as

DRAINAGE REPORT

ALTA at River's Edge

A&M Project #1670-09A

Wayland, MA

October 18, 2019

an unmaed access road which connects to an adjacnet property to the west located in the Town of Sudbury.

The site topography slopes varies significantly over the site, due to its use as a refuse facility as well as a gun range. Some existing slopes are relatively steep, with multiple localized high points throughout the site. Elevations range from El. 160± at the southwest corner of the site along Boston Post Road to a low point of approximately El. 117± abutting the wetlands near the northerly property line. The main building on the subject parcel is at elevation 149.5±, with a four-foot high loading dock to the rear at approximately El. 153.3±. There is a landscaped buffer area along the southern, eastern, and northern property lines consisting of trees and grass, and a bordering vegetated wetland area to the north.

The majority of the site (notated as Watershed E-1 in the HydroCAD model and existing watershed plan) flows to the northern wetland area (notated as Study Point #1 in the HydroCAD model and existing watershed plan) with the exception of Watershed E-2 which flows to the southeastern corner of the site, notated as Study Point #2.

WATERSHED

The subject property is located within the SuAsCo Watershed. The SuAsCo Watershed is one of the 27 major watersheds in Massachusetts. SuAsCo stands for the Sudbury, Assabet, and Concord Rivers. The SuAsCo Watershed is the land area surrounding these three rivers. Any rain falling within the SuAsCo watershed eventually drains into the Sudbury, Assabet or Concord rivers. The SuAsCo Watershed is a 377-square mile area encompassing, partially or wholly, 36 Massachusetts towns and cities. The SuAsCo Watershed is not protected under the Watershed Protection Act and has no associated land use restrictions.

EXISTING SOIL CONDITIONS

The on-site soils were identified using the USDA Natural Resources Conservation Services (NRCS) Soil Survey for Middlesex County. The sites soil types and corresponding Hydrologic Soil Groups (HSG) include:

- 51A (HSG-B/D) - Swansea Muck
- 253D (HSG-A) - Hinckley Loamy Sand
- 652 (Assumed HSG-B) - Udorthents, Refuse Substratum
- 656 (Assumed HSG-B) - Udorthents-Urban Land Complex

Urban land consists of areas where the soil has been altered or obscured by buildings, or paved areas; neither Urban land nor Udorthents are assigned a hydrologic soil group (HSG). Based on a textural analysis of the in-situ soils and a geotechnical report dated May 2019 by Haley & Aldrich, the site was assumed to have a conservative HSG of "B". The report states that the site is comprised mostly of poorly-graded, glaciofluvial deposits mainly consisting of sand and gravel.

There is adequate separation between the infiltration systems and the seasonal high groundwater table of four (4) feet. A copy of the soil mapping is included in the Appendix of this report.

DRAINAGE REPORT

*ALTA at River's Edge
Wayland, MA*

*A&M Project #1670-09A
October 18, 2019*

FEMA FLOODPLAIN/ENVIRONMENTAL DUE DILIGENCE

The Flood Insurance Rate Map (FIRM) (Map Number 25017C0507F) for the Town of Wayland dated July 7, 2014 indicates that the parcel lies within the FEMA Zone X as well as FEMA Zone AE. The FEMA Zone X in this area is defined as “areas determined to be outside the 0.2% annual chance floodplain.” The FEMA Zone AE in this area is defined as a “special flood hazard area” with a Base Flood Elevation (BFE). See the appendix of this report for a copy of the FEMA FIRM.

ENVIRONMENTALLY SENSITIVE ZONES

The Commonwealth of Massachusetts asserts control over numerous protected and regulated areas including: Areas of Critical Environmental Concern (ACEC); Outstanding Resource Waters (ORWs); areas protected under the Wetlands Protection Act and the Rivers Protection Act, as well as Priority and Protected Habitat for rare and endangered species. The subject property is located within the 100' of a bordering vegetated wetland and within 200' of the Sudbury River as illustrated on the site development plans. A Notice of Intent is required.

DRAINAGE ANALYSIS METHODOLOGY

A peak rate of runoff will be determined using techniques and data found in the following:

1. Urban Hydrology for Small Watersheds – Technical Release 55 by the United States Department of Agriculture Soils Conservation Service, June 1986. Runoff curve numbers and 24-hour precipitation values were obtained from this reference.
2. HydroCAD[®] Stormwater Modeling System by HydroCAD Software Solutions LLC, version 10.00, 2013. The HydroCAD program was used to generate the runoff hydrographs for the watershed areas, to determine discharge/stage/storage characteristics for the stormwater BMPs, to perform drainage routing and to combine the results of the runoff hydrographs. HydroCAD uses the TR-20 methodology of the SCS Unit Hydrograph procedure (SCS-UH).
3. Soil Survey of Middlesex County Massachusetts by United States Department of Agriculture, NRCS. Soil types and boundaries were obtained from this reference.
4. National Oceanic and Atmospheric Administration (NOAA) Atlas 14, Volume 10, Version 3-point precipitation frequency estimates for Wayland, Massachusetts. The 2-year, 10-year, and 100-year storm events were taken from this website per Wayland Conservation Commission (see Appendix).

DRAINAGE REPORT

*ALTA at River's Edge
Wayland, MA*

*A&M Project #1670-09A
October 18, 2019*

PROPOSED CONDITIONS - PEAK RATE OF RUNOFF

The storm water runoff analysis of the existing and proposed conditions includes an estimate of the peak rate of runoff from various rainfall events. Peak runoff rates were developed using TR-55 Urban Hydrology for Small Watersheds, developed by the U.S. Department of Commerce, Engineering Division and the HydroCAD computer program. Further, the analysis has been prepared in accordance with the MA DEP and the Town of Wayland requirements and standard engineering practices. The peak rate of runoff has been estimated for each watershed during the 1-inch, 2-year, 10-year, and 100-year storm events, per Chapter 194 Submittal Requirements for the Town of Wayland.

Proposed underground infiltration ponds receive stormwater directly from the proposed roof and pretreated site areas. Infiltration Ponds provide recharge for building roofs as well as paved surface parking areas. Paved areas will require pretreatment which is provided by catch basins equipped with deep sumps and hoods, ConTech CDS-2015-4-C hydrodynamic separators, and Stormtech isolator rows. Outlet control structures with weirs and orifices act as overflow devices and control flows during high-intensity storm events. All infiltration systems ultimately discharge to the abutting wetlands, located to the north and east of the project site.

All proposed infiltration systems provide the minimum required four (4) feet of separation between the Estimated Seasonal High-Water Table (ESHWT); therefore, a mounding analysis is not required.

The stormwater runoff model shows that the proposed site development reduces the rate of runoff during all storm events at the identified points of analysis. Stormwater models show that the volume of water discharging to the abutting wetlands will be reduced in the 1-inch and 2-year event but will increase for the 10-year and 100-year events. The following tables provide a summary of the estimated peak flow rate and discharge volume at each Study Point during each of the design storm events. The HydroCAD worksheets are included in Section 4 of this report.

PEAK FLOW RATES SUMMARY TABLE

STUDY POINT #1 (Flow to northern wetlands)

	1-Inch	2-Year	10-Year	100-Year
Existing Runoff (CFS)	0.00	2.18	5.59	11.84
Proposed Runoff (CFS)	0.00	1.21	5.27	11.62
REDUCTION	0.00	0.97	0.32	0.22

STUDY POINT #2 (Off-site flow to southeast corner)

	1-Inch	2-Year	10-Year	100-Year
Existing Runoff (CFS)	0.01	3.57	8.19	16.29
Proposed Runoff (CFS)	0.01	0.90	7.02	16.18
REDUCTION	0.00	2.67	1.17	0.11

DRAINAGE REPORT

*ALTA at River's Edge
Wayland, MA*

*A&M Project #1670-09A
October 18, 2019*

PEAK VOLUMES SUMMARY TABLE

STUDY POINT #1 (Flow to northern wetlands)

	1-Inch	2-Year	10-Year	100-Year
Existing Runoff (CF)	66	7,823	18,575	38,811
Proposed Runoff (CF)	0	6,559	21,203	49,437
CHANGE	-66	-1,264	+2,628	+10,626

STUDY POINT #2 (Off-site flow to southeast corner)

	1-Inch	2-Year	10-Year	100-Year
Existing Runoff (CF)	346	13,112	28,986	57,768
Proposed Runoff (CF)	74	8,200	31,951	75,786
CHANGE	-272	-4,912	+2,965	+18,018

MA DEP STORMWATER PERFORMANCE STANDARDS

The MA DEP Stormwater Management Policy was developed to improve water quality by implementing performance standards for storm water management. The intent is to implement the stormwater management standards through the review of Notice of Intent filings by the issuing authority (Conservation Commission or DEP). The following section outlines how the proposed Stormwater Management System meets the standards set forth by the Policy.

BMP's implemented in the design include:

- Deep-sump, hooded catch basins
- Trench Drains
- Hydro-dynamic (Proprietary) separators
- Underground infiltration systems
- Isolator row
- Specific maintenance schedule

Stormwater Best Management Practices have been incorporated into the design of the project to mitigate the anticipated pollutant loading. An Operations and Maintenance Plan has been developed for the project, which addresses the long-term maintenance requirements of the proposed system.

Temporary erosion and sedimentation controls will be incorporated into the construction phase of the project. These temporary controls may include straw bale and/or silt fence barriers, inlet sediment traps, diversion channels, slope stabilization, and stabilized construction entrances.

The Massachusetts Department of Environmental Protection has established ten (10) Stormwater Management Standards. A project that meets or exceeds the standards is presumed to satisfy the regulatory requirements regarding stormwater management. The Standards are enumerated below as well as descriptions and supporting calculations as to how the Project will comply with the Standards:

DRAINAGE REPORT

ALTA at River's Edge
Wayland, MA

A&M Project #1670-09A
October 18, 2019

1. *No new stormwater conveyances (e.g. outfalls) may discharge untreated stormwater directly to or cause erosion in wetlands or waters of the Commonwealth.*

The proposed development will not introduce any new stormwater conveyances (e.g. outfalls) that discharge untreated stormwater directly to or cause erosion in wetlands or waters of the Commonwealth.

For computations demonstrating discharges are adequately treated please see computations for Standard 4 through Standard 6. Additionally, all outfalls have been designed to provide standard Rip Rap outfalls as calculated in Section 6.11.

2. *Stormwater management systems shall be designed so that post-development peak discharge rates do not exceed pre-development peak discharge rates. This Standard may be waived for discharges to land subject to coastal storm flowage as defined in 310 CMR 10.04.*

The proposed development will be designed so that the post-development peak discharge rates do not exceed the pre-development peak discharge rates. See the peak flow rate table, above.

3. *Loss of annual recharge to groundwater shall be eliminated or minimized through the use of infiltration measures including environmentally sensitive site design, low impact development techniques, stormwater best management practices, and good operation and maintenance. At a minimum, the annual recharge from the post-development site shall approximate the annual recharge from pre-development conditions based on soil type. This Standard is met when the stormwater management system is designed to infiltrate the required recharge volume as determined in accordance with the Massachusetts Stormwater Handbook.*

The existing annual recharge for the site will be approximated in the developed condition. Subsurface infiltration chambers will be designed to meet this requirement. All Infiltration Systems were designed using the Static Method per the MA DEP Stormwater Management Standards, Volume 3, Chapter 1. See Section 6.9 for water quality/recharge calculations for the project site.

4. *Stormwater management systems shall be designed to remove 80% of the average annual post-construction load of Total Suspended Solids (TSS). This Standard is met when:*
 - a. *Suitable practices for source control and pollution prevention are identified in a long-term pollution prevention plan, and thereafter are implemented and maintained;*
 - b. *Structural stormwater best management practices are sized to capture the required water quality volume determined in accordance with the Massachusetts Stormwater Handbook; and*

DRAINAGE REPORT

ALTA at River's Edge
Wayland, MA

A&M Project #1670-09A
October 18, 2019

- c. *Pretreatment is provided in accordance with the Massachusetts Stormwater Handbook.*

The proposed stormwater management system will be designed so that the 80% TSS removal standard will be met for each drainage area. Standard #4 is met when structural stormwater best management practices are sized to capture and treat the required water quality volume and pretreatment is provided in accordance with the Massachusetts Stormwater Handbook. Standard #4 also requires that suitable source control measures are identified in the Long-Term Pollution Prevention Plan.

Additionally, because discharge is from land uses with higher potential pollutant loads, the proposed stormwater management system will be designed so that prior to each discharge to an infiltration structure, the 44% TSS removal standard will be met using some combination of the following: deep-sump, hooded catch basins, proprietary separators, and isolator rows.

The water quality volume for the site development will be captured and treated using proprietary separators and infiltration systems equipped with isolator rows. All systems will be sized to meet the water quality flow rate for the 1" storm event. See DEP Calculations in the appendix of this report for water quality flow rate and volume calculations.

5. *For land uses with higher potential pollutant loads, source control and pollution prevention shall be implemented in accordance with the Massachusetts Stormwater Handbook to eliminate or reduce the discharge of stormwater runoff from such land uses to the maximum extent practicable. If through source control and/or pollution prevention all land uses with higher potential pollutant loads cannot be completely protected from exposure to rain, snow, snow melt, and stormwater runoff, the proponent shall use the specific structural stormwater BMPs determined by the Department to be suitable for such uses as provided in the Massachusetts Stormwater Handbook. Stormwater discharges from land uses with higher potential pollutant loads shall also comply with the requirements of the Massachusetts Clean Waters Act, M.G.L. c. 21, §§ 26-53 and the regulations promulgated thereunder at 314 CMR 3.00, 314 CMR 4.00 and 314 CMR 5.00.*

The proposed development may be considered a source of higher potential pollutant loads because the proposed parking area is considered a high-intensity parking area (over 1,000 vehicle trips per day). Pre-treatment and source reduction are provided to the maximum extent practicable. The drainage system will be designed to treat 1" water quality volume and provide 44% TSS removal prior to discharge to an infiltration device. The SMS will be designed with hydrodynamic separators, deep-sump & hooded catch basins, and infiltration chambers equipped with isolator rows to provide 44% TSS removal prior to recharge.

6. *Stormwater discharges within the Zone II or Interim Wellhead Protection Area of a public water supply, and stormwater discharges near or to any other critical area, require the use of the specific source control and pollution prevention measures and the specific structural stormwater best management practices determined by the Department*

DRAINAGE REPORT

ALTA at River's Edge
Wayland, MA

A&M Project #1670-09A

October 18, 2019

to be suitable for managing discharges to such areas, as provided in the Massachusetts Stormwater Handbook. A discharge is near a critical area if there is a strong likelihood of a significant impact occurring to said area, taking into account site-specific factors. Stormwater discharges to Outstanding Resource Waters and Special Resource Waters shall be removed and set back from the receiving water or wetland and receive the highest and best practical method of treatment. A "storm water discharge" as defined in 314 CMR 3.04(2)(a)1 or (b) to an Outstanding Resource Water or Special Resource Water shall comply with 314 CMR 3.00 and 314 CMR 4.00. Stormwater discharges to a Zone I or Zone A are prohibited unless essential to the operation of a public water supply.

The proposed project is not located within a critical area.

7. *A redevelopment project is required to meet the following Stormwater Management Standards only to the maximum extent practicable: Standard 2, Standard 3, and the pretreatment and structural best management practice requirements of Standards 4, 5, and 6. Existing stormwater discharges shall comply with Standard 1 only to the maximum extent practicable. A redevelopment project shall also comply with all other requirements of the Stormwater Management Standards and improve existing conditions.*

The proposed project is considered a new development project under the Stormwater Management Handbook guidelines as there is an increase in the amount of impervious area.

8. *A plan to control construction-related impacts including erosion, sedimentation and other pollutant sources during construction and land disturbance activities (construction period erosion, sedimentation, and pollution prevention plan) shall be developed and implemented.*

A plan to control construction-related impacts, including erosion, sedimentation and other pollutant sources during construction and land disturbance activities will be developed. The proponent will prepare and submit a Stormwater Pollution Prevention Plan (SWPPP) prior to commencement of construction activities that will result in the disturbance of one acre of land or more.

9. *A long-term operation and maintenance plan shall be developed and implemented to ensure that stormwater management systems function as designed.*

A Long-Term Operation and Maintenance (O&M) Plan has been developed for the proposed stormwater management system and is included within this document. See Section 2.0 of this report.

10. *All illicit discharges to the stormwater management system are prohibited.*

There are no expected illicit discharges to the stormwater management system. The Applicant has submitted an Illicit Discharge Compliance Statement with this report. See

DRAINAGE REPORT

ALTA at River's Edge

A&M Project #1670-09A

Wayland, MA

October 18, 2019

Section 6.12 of the Appendix.

See the next page for the Mass DEP Stormwater Checklist.



Checklist for Stormwater Report

A. Introduction

Important: When filling out forms on the computer, use only the tab key to move your cursor - do not use the return key.



A Stormwater Report must be submitted with the Notice of Intent permit application to document compliance with the Stormwater Management Standards. The following checklist is NOT a substitute for the Stormwater Report (which should provide more substantive and detailed information) but is offered here as a tool to help the applicant organize their Stormwater Management documentation for their Report and for the reviewer to assess this information in a consistent format. As noted in the Checklist, the Stormwater Report must contain the engineering computations and supporting information set forth in Volume 3 of the [Massachusetts Stormwater Handbook](#). The Stormwater Report must be prepared and certified by a Registered Professional Engineer (RPE) licensed in the Commonwealth.

The Stormwater Report must include:

- The Stormwater Checklist completed and stamped by a Registered Professional Engineer (see page 2) that certifies that the Stormwater Report contains all required submittals.¹ This Checklist is to be used as the cover for the completed Stormwater Report.
- Applicant/Project Name
- Project Address
- Name of Firm and Registered Professional Engineer that prepared the Report
- Long-Term Pollution Prevention Plan required by Standards 4-6
- Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan required by Standard 8²
- Operation and Maintenance Plan required by Standard 9

In addition to all plans and supporting information, the Stormwater Report must include a brief narrative describing stormwater management practices, including environmentally sensitive site design and LID techniques, along with a diagram depicting runoff through the proposed BMP treatment train. Plans are required to show existing and proposed conditions, identify all wetland resource areas, NRCS soil types, critical areas, Land Uses with Higher Potential Pollutant Loads (LUHPPL), and any areas on the site where infiltration rate is greater than 2.4 inches per hour. The Plans shall identify the drainage areas for both existing and proposed conditions at a scale that enables verification of supporting calculations.

As noted in the Checklist, the Stormwater Management Report shall document compliance with each of the Stormwater Management Standards as provided in the Massachusetts Stormwater Handbook. The soils evaluation and calculations shall be done using the methodologies set forth in Volume 3 of the Massachusetts Stormwater Handbook.

To ensure that the Stormwater Report is complete, applicants are required to fill in the Stormwater Report Checklist by checking the box to indicate that the specified information has been included in the Stormwater Report. If any of the information specified in the checklist has not been submitted, the applicant must provide an explanation. The completed Stormwater Report Checklist and Certification must be submitted with the Stormwater Report.

¹ The Stormwater Report may also include the Illicit Discharge Compliance Statement required by Standard 10. If not included in the Stormwater Report, the Illicit Discharge Compliance Statement must be submitted prior to the discharge of stormwater runoff to the post-construction best management practices.

² For some complex projects, it may not be possible to include the Construction Period Erosion and Sedimentation Control Plan in the Stormwater Report. In that event, the issuing authority has the discretion to issue an Order of Conditions that approves the project and includes a condition requiring the proponent to submit the Construction Period Erosion and Sedimentation Control Plan before commencing any land disturbance activity on the site.



Checklist for Stormwater Report

B. Stormwater Checklist and Certification

The following checklist is intended to serve as a guide for applicants as to the elements that ordinarily need to be addressed in a complete Stormwater Report. The checklist is also intended to provide conservation commissions and other reviewing authorities with a summary of the components necessary for a comprehensive Stormwater Report that addresses the ten Stormwater Standards.

Note: Because stormwater requirements vary from project to project, it is possible that a complete Stormwater Report may not include information on some of the subjects specified in the Checklist. If it is determined that a specific item does not apply to the project under review, please note that the item is not applicable (N.A.) and provide the reasons for that determination.

A complete checklist must include the Certification set forth below signed by the Registered Professional Engineer who prepared the Stormwater Report.

Registered Professional Engineer's Certification

I have reviewed the Stormwater Report, including the soil evaluation, computations, Long-term Pollution Prevention Plan, the Construction Period Erosion and Sedimentation Control Plan (if included), the Long-term Post-Construction Operation and Maintenance Plan, the Illicit Discharge Compliance Statement (if included) and the plans showing the stormwater management system, and have determined that they have been prepared in accordance with the requirements of the Stormwater Management Standards as further elaborated by the Massachusetts Stormwater Handbook. I have also determined that the information presented in the Stormwater Checklist is accurate and that the information presented in the Stormwater Report accurately reflects conditions at the site as of the date of this permit application.

Registered Professional Engineer Block and Signature



Signature and Date

10.20.19

Checklist

Project Type: Is the application for new development, redevelopment, or a mix of new and redevelopment?

- New development
- Redevelopment
- Mix of New Development and Redevelopment



Checklist for Stormwater Report

Checklist (continued)

LID Measures: Stormwater Standards require LID measures to be considered. Document what environmentally sensitive design and LID Techniques were considered during the planning and design of the project:

- No disturbance to any Wetland Resource Areas
- Site Design Practices (e.g. clustered development, reduced frontage setbacks)
- Reduced Impervious Area (Redevelopment Only)
- Minimizing disturbance to existing trees and shrubs
- LID Site Design Credit Requested:
 - Credit 1
 - Credit 2
 - Credit 3
- Use of "country drainage" versus curb and gutter conveyance and pipe
- Bioretention Cells (includes Rain Gardens)
- Constructed Stormwater Wetlands (includes Gravel Wetlands designs)
- Treebox Filter
- Water Quality Swale
- Grass Channel
- Green Roof
- Other (describe): Underground Infiltration Systems (Chambers); Isolator row; Water quality unit

Standard 1: No New Untreated Discharges

- No new untreated discharges
- Outlets have been designed so there is no erosion or scour to wetlands and waters of the Commonwealth
- Supporting calculations specified in Volume 3 of the Massachusetts Stormwater Handbook included.



Checklist for Stormwater Report

Checklist (continued)

Standard 2: Peak Rate Attenuation

- Standard 2 waiver requested because the project is located in land subject to coastal storm flowage and stormwater discharge is to a wetland subject to coastal flooding.
- Evaluation provided to determine whether off-site flooding increases during the 100-year 24-hour storm.
- Calculations provided to show that post-development peak discharge rates do not exceed pre-development rates for the 2-year and 10-year 24-hour storms. If evaluation shows that off-site flooding increases during the 100-year 24-hour storm, calculations are also provided to show that post-development peak discharge rates do not exceed pre-development rates for the 100-year 24-hour storm.

Standard 3: Recharge

- Soil Analysis provided.
- Required Recharge Volume calculation provided.
- Required Recharge volume reduced through use of the LID site Design Credits.
- Sizing the infiltration, BMPs is based on the following method: Check the method used.
 - Static
 - Simple Dynamic
 - Dynamic Field¹
- Runoff from all impervious areas at the site discharging to the infiltration BMP.
- Runoff from all impervious areas at the site is *not* discharging to the infiltration BMP and calculations are provided showing that the drainage area contributing runoff to the infiltration BMPs is sufficient to generate the required recharge volume.
- Recharge BMPs have been sized to infiltrate the Required Recharge Volume.
- Recharge BMPs have been sized to infiltrate the Required Recharge Volume *only* to the maximum extent practicable for the following reason:
 - Site is comprised solely of C and D soils and/or bedrock at the land surface
 - M.G.L. c. 21E sites pursuant to 310 CMR 40.0000
 - Solid Waste Landfill pursuant to 310 CMR 19.000
 - Project is otherwise subject to Stormwater Management Standards only to the maximum extent practicable.
- Calculations showing that the infiltration BMPs will drain in 72 hours are provided.
- Property includes a M.G.L. c. 21E site or a solid waste landfill and a mounding analysis is included.

¹ 80% TSS removal is required prior to discharge to infiltration BMP if Dynamic Field method is used.



Checklist for Stormwater Report

Checklist (continued)

Standard 3: Recharge (continued)

- The infiltration BMP is used to attenuate peak flows during storms greater than or equal to the 10-year 24-hour storm and separation to seasonal high groundwater is less than 4 feet and a mounding analysis is provided.
- Documentation is provided showing that infiltration BMPs do not adversely impact nearby wetland resource areas.

Standard 4: Water Quality

The Long-Term Pollution Prevention Plan typically includes the following:

- Good housekeeping practices;
 - Provisions for storing materials and waste products inside or under cover;
 - Vehicle washing controls;
 - Requirements for routine inspections and maintenance of stormwater BMPs;
 - Spill prevention and response plans;
 - Provisions for maintenance of lawns, gardens, and other landscaped areas;
 - Requirements for storage and use of fertilizers, herbicides, and pesticides;
 - Pet waste management provisions;
 - Provisions for operation and management of septic systems;
 - Provisions for solid waste management;
 - Snow disposal and plowing plans relative to Wetland Resource Areas;
 - Winter Road Salt and/or Sand Use and Storage restrictions;
 - Street sweeping schedules;
 - Provisions for prevention of illicit discharges to the stormwater management system;
 - Documentation that Stormwater BMPs are designed to provide for shutdown and containment in the event of a spill or discharges to or near critical areas or from LUHPPL;
 - Training for staff or personnel involved with implementing Long-Term Pollution Prevention Plan;
 - List of Emergency contacts for implementing Long-Term Pollution Prevention Plan.
- A Long-Term Pollution Prevention Plan is attached to Stormwater Report and is included as an attachment to the Wetlands Notice of Intent.
 - Treatment BMPs subject to the 44% TSS removal pretreatment requirement and the one inch rule for calculating the water quality volume are included, and discharge:
 - is within the Zone II or Interim Wellhead Protection Area
 - is near or to other critical areas
 - is within soils with a rapid infiltration rate (greater than 2.4 inches per hour)
 - involves runoff from land uses with higher potential pollutant loads.
 - The Required Water Quality Volume is reduced through use of the LID site Design Credits.
 - Calculations documenting that the treatment train meets the 80% TSS removal requirement and, if applicable, the 44% TSS removal pretreatment requirement, are provided.



Checklist for Stormwater Report

Checklist (continued)

Standard 4: Water Quality (continued)

- The BMP is sized (and calculations provided) based on:
 - The ½" or 1" Water Quality Volume or
 - The equivalent flow rate associated with the Water Quality Volume and documentation is provided showing that the BMP treats the required water quality volume.
- The applicant proposes to use proprietary BMPs, and documentation supporting use of proprietary BMP and proposed TSS removal rate is provided. This documentation may be in the form of the propriety BMP checklist found in Volume 2, Chapter 4 of the Massachusetts Stormwater Handbook and submitting copies of the TARP Report, STEP Report, and/or other third party studies verifying performance of the proprietary BMPs.
- A TMDL exists that indicates a need to reduce pollutants other than TSS and documentation showing that the BMPs selected are consistent with the TMDL is provided.

Standard 5: Land Uses With Higher Potential Pollutant Loads (LUHPPLs)

- The NPDES Multi-Sector General Permit covers the land use and the Stormwater Pollution Prevention Plan (SWPPP) has been included with the Stormwater Report.
- The NPDES Multi-Sector General Permit covers the land use and the SWPPP will be submitted **prior to** the discharge of stormwater to the post-construction stormwater BMPs.
- The NPDES Multi-Sector General Permit does **not** cover the land use.
- LUHPPLs are located at the site and industry specific source control and pollution prevention measures have been proposed to reduce or eliminate the exposure of LUHPPLs to rain, snow, snow melt and runoff, and been included in the long term Pollution Prevention Plan.
- All exposure has been eliminated.
- All exposure has **not** been eliminated and all BMPs selected are on MassDEP LUHPPL list.
- The LUHPPL has the potential to generate runoff with moderate to higher concentrations of oil and grease (e.g. all parking lots with >1000 vehicle trips per day) and the treatment train includes an oil grit separator, a filtering bioretention area, a sand filter or equivalent.

Standard 6: Critical Areas

- The discharge is near or to a critical area and the treatment train includes only BMPs that MassDEP has approved for stormwater discharges to or near that particular class of critical area.
- Critical areas and BMPs are identified in the Stormwater Report.



Checklist for Stormwater Report

Checklist (continued)

Standard 7: Redevelopments and Other Projects Subject to the Standards only to the maximum extent practicable

- The project is subject to the Stormwater Management Standards only to the maximum Extent Practicable as a:
 - Limited Project
 - Small Residential Projects: 5-9 single family houses or 5-9 units in a multi-family development provided there is no discharge that may potentially affect a critical area.
 - Small Residential Projects: 2-4 single family houses or 2-4 units in a multi-family development with a discharge to a critical area
 - Marina and/or boatyard provided the hull painting, service and maintenance areas are protected from exposure to rain, snow, snow melt and runoff
 - Bike Path and/or Foot Path
 - Redevelopment Project
 - Redevelopment portion of mix of new and redevelopment.
- Certain standards are not fully met (Standard No. 1, 8, 9, and 10 must always be fully met) and an explanation of why these standards are not met is contained in the Stormwater Report.
- The project involves redevelopment and a description of all measures that have been taken to improve existing conditions is provided in the Stormwater Report. The redevelopment checklist found in Volume 2 Chapter 3 of the Massachusetts Stormwater Handbook may be used to document that the proposed stormwater management system (a) complies with Standards 2, 3 and the pretreatment and structural BMP requirements of Standards 4-6 to the maximum extent practicable and (b) improves existing conditions.

Standard 8: Construction Period Pollution Prevention and Erosion and Sedimentation Control

A Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan must include the following information:

- Narrative;
 - Construction Period Operation and Maintenance Plan;
 - Names of Persons or Entity Responsible for Plan Compliance;
 - Construction Period Pollution Prevention Measures;
 - Erosion and Sedimentation Control Plan Drawings;
 - Detail drawings and specifications for erosion control BMPs, including sizing calculations;
 - Vegetation Planning;
 - Site Development Plan;
 - Construction Sequencing Plan;
 - Sequencing of Erosion and Sedimentation Controls;
 - Operation and Maintenance of Erosion and Sedimentation Controls;
 - Inspection Schedule;
 - Maintenance Schedule;
 - Inspection and Maintenance Log Form.
- A Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan containing the information set forth above has been included in the Stormwater Report.



Checklist for Stormwater Report

Checklist (continued)

Standard 8: Construction Period Pollution Prevention and Erosion and Sedimentation Control (continued)

- The project is highly complex and information is included in the Stormwater Report that explains why it is not possible to submit the Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan with the application. A Construction Period Pollution Prevention and Erosion and Sedimentation Control has **not** been included in the Stormwater Report but will be submitted **before** land disturbance begins.
- The project is **not** covered by a NPDES Construction General Permit.
- The project is covered by a NPDES Construction General Permit and a copy of the SWPPP is in the Stormwater Report.
- The project is covered by a NPDES Construction General Permit but no SWPPP been submitted. The SWPPP will be submitted BEFORE land disturbance begins.

Standard 9: Operation and Maintenance Plan

- The Post Construction Operation and Maintenance Plan is included in the Stormwater Report and includes the following information:
 - Name of the stormwater management system owners;
 - Party responsible for operation and maintenance;
 - Schedule for implementation of routine and non-routine maintenance tasks;
 - Plan showing the location of all stormwater BMPs maintenance access areas;
 - Description and delineation of public safety features;
 - Estimated operation and maintenance budget; and
 - Operation and Maintenance Log Form.
- The responsible party is **not** the owner of the parcel where the BMP is located and the Stormwater Report includes the following submissions:
 - A copy of the legal instrument (deed, homeowner's association, utility trust or other legal entity) that establishes the terms of and legal responsibility for the operation and maintenance of the project site stormwater BMPs;
 - A plan and easement deed that allows site access for the legal entity to operate and maintain BMP functions.

Standard 10: Prohibition of Illicit Discharges

- The Long-Term Pollution Prevention Plan includes measures to prevent illicit discharges;
- An Illicit Discharge Compliance Statement is attached;
- NO Illicit Discharge Compliance Statement is attached but will be submitted **prior to** the discharge of any stormwater to post-construction BMPs.

DRAINAGE REPORT

*ALTA at River's Edge
Wayland, MA*

*A&M Project # 1670-09A
October 18, 2019*

OPERATION AND MAINTENANCE PLAN

In accordance with the standards set forth by the Stormwater Management Policy issued by the Department of Environmental Protection (DEP), Allen & Major Associates, Inc. (A&M) has prepared the following Operation and Maintenance plan for the ALTA at Rivers Edge project located at #490 Boston Post Road.

This plan is broken into two major sections. The first section describes construction-related erosion and sedimentation controls. The second section is devoted to a post-development operation and maintenance plan. An operation and maintenance schedule is included with this report.

Stormwater Management System Owner:

WP East Acquisitions, LLC
91 Hartwell Avenue, 3rd Floor
Lexington, MA 02421

Emergency Contact Information:

- WP East Acquisitions, LLC
c/o David Moore Phone (978) 369-8111
- Allen & Major Associates, Inc. (Site Civil Engineer) Phone (781) 935-6889
- Wayland Public Works Phone (508) 358-3672
- Wayland Fire Department (business line) Phone (508) 358-4747

INTRODUCTION

The stormwater management system (SMS) for this project is owned by WP East Acquisitions, LLC; and shall be legally responsible for long-term operation and maintenance for this SMS as outlined in this Operation and Maintenance (O&M) Plan. Should ownership of the SMS change the succeeding owner will be presented with this O&M Plan and supporting attachments at or before legal conveyance of ownership and will assume the obligations of the O&M Plan.

In the event that the SMS will be operated and maintained by an entity other than that listed in this document, the applicant shall provide a plan and easement deed that provides a right of access for the legal entity to be able to perform said operation and maintenance functions. In the event the SMS will serve multiple lots/owners, the applicant shall also provide a copy of the legal instrument (deed, homeowner's association, utility trust or other legal entity) that establishes the terms of and legal responsibility for the operation and maintenance of the entire SMS.

DRAINAGE REPORT

*ALTA at River's Edge
Wayland, MA*

*A&M Project # 1670-09A
October 18, 2019*

DEMOLITION & CONSTRUCTION MAINTENANCE PLAN

1. Call Digsafe: 1-888-344-7233
2. Contact the Town of Wayland at least three (3) days prior to start of demolition and/or construction activities.
3. Install Erosion Control measures as shown on the Plans prepared by A&M. The Town of Wayland shall review the installation of straw bales and silt fencing prior to the start of any site demolition work. Install Construction fencing if determined to be necessary at the commencement of construction.
4. Install construction entrances & straw bales and silt fence at the locations shown on the Erosion Control Plan prepared by A&M.
5. Site access shall be achieved only from the designated construction entrances.
6. Cut and clear trees in construction areas only (within the limit of work; see plans).
7. Stockpiles of materials subject to erosion shall be stabilized with erosion control matting or temporary seeding whenever practicable, but in no case more than 14 days after the construction activity in that portion of the site has temporarily or permanently ceased.
8. Install silt sacks and straw bales around each drain inlet prior to any demolition and or construction activities.
9. All erosion control measures shall be inspected weekly and after every rainfall event. Records of these inspections shall be kept on site for review.
10. All erosion control measures shall be maintained, repaired or replaced as required or at the direction of the owner's engineer or the Town of Wayland.
11. Sediment accumulation up-gradient of the straw bales, silt fence, and stone check dams greater than 6" in depth shall be removed and disposed of in accordance with all applicable regulations.
12. If it appears that sediment is exiting the site, silt sacks shall be installed in all catch basins adjacent to the site. Sediment accumulation on all adjacent catch basin inlets shall be removed and the silt sack replaced if torn or damaged.
13. Install stone check dams on site during construction as needed. Refer to the erosion

DRAINAGE REPORT

*ALTA at River's Edge
Wayland, MA*

*A&M Project # 1670-09A
October 18, 2019*

- control details. Temporary sediment basins combined with stone check dams shall be installed on site during construction to control and collect runoff from upland areas of this site during demolition and construction activities.
14. The contractor shall comply with the Sedimentation and Erosion Control Notes as shown on the Site Development Plans and Specifications.
 15. The stabilized construction entrances shall be inspected weekly and records of inspections kept. The entrances shall be maintained by adding additional clean, angular, durable stone to remove the soil from the construction vehicle's tires when exiting the site. If soil is still leaving the site via the construction vehicle tires, adjacent roadways shall be kept clean by street sweeping.
 16. Dust pollution shall be controlled using on-site water trucks and or an approved soil stabilization product.
 17. During demolition and construction activities Status Reports on compliance with this O&M Document shall be submitted weekly. The report shall document any deficiencies and corrective actions taken by the applicant.

POST CONSRUCTION MAINTENANCE PLAN

The SMS shall be inspected immediately after construction. A maintenance log will be kept (i.e. report) summarizing inspections, maintenance, and any corrective actions taken. The log will include the date on which each inspection or maintenance task was performed, a description of the inspection findings or maintenance completed, and the name of the inspector or maintenance personnel performing the task. If a maintenance task requires the clean-out of any sediments or debris, the location where the sediment and debris was disposed after removal will be indicated. The log will be made accessible to department staff and a copy provided to the department upon request.

Inspection and Maintenance Frequency and Corrective Measures:

The following areas, facilities, and measures will be inspected and the identified deficiencies will be corrected. Clean-out must include the removal and legal disposal of any accumulated sediments, trash, and debris. In any and all cases, operations, inspections, and maintenance activities shall utilize best practical measures to avoid and minimize impacts to wetland resource areas outside the foot print of the SMS.

Attached is an Grading and Drainage Plan (C-103) illustrating the location of the following SMS components that will require continuing inspections as outlined in this document:

DRAINAGE REPORT

*ALTA at River's Edge
Wayland, MA*

*A&M Project # 1670-09A
October 18, 2019*

- Deep Sump Catch Basins (10)
- Proprietary Separators (5)
- Subsurface Infiltration Systems (3)
- Outlet Control Structures (3)
- Snow Storage (as outlined on plan)

Monthly Post Construction Inspection (First three months only)

- **Sub-surface Infiltration Systems:**

Inspect the Infiltration system after all rainfalls greater than 1" to ensure that the system is draining within 72 hours. Repair as required.

Quarterly Inspections (specifically after foliage and snow season)

Deep Sump Catch Basins:

Inspect catch basins to ensure that the catch basins are working in their intended fashion and that they are free of debris. Structures will be skimmed of floatable debris at each inspection and sediment will be removed at a minimum once per year (typically after snow season) or when sediment has accumulated to within 2 feet of the outlet invert. If the basin outlet is designed with a hood to trap floatable materials (i.e. Snout), check to ensure watertight seal is working.

Proprietary Separators:

Separators shall be operated in strict accordance with manufacturer's recommend practices. Available manufacturer specific O&M plans attached as Appendix. Separators shall be inspected to ensure that they are working in their intended fashion and that they are free of debris. Structures shall be cleaned with a vacuum truck at least once annually (typically after snow season) or when sediment has accumulated to a depth of six inches (6"), whichever is more frequent.

Sediment Forebay:

Inspect the Sediment Forebay for accumulations of sediment. The forebay shall be cleaned at least once annually (typically after snow season) or when sediment has accumulated to a depth of one and a half inches (1.5"), whichever is more frequent.

Sub-surface Infiltration Systems:

The sub-surface structures will be inspected 24 hours or several days after large rain events (greater than 1.5"), to look for ponded water. Inspection can be accomplished by using the observation well, inspection port, and/or access structure for underground chamber systems.

DRAINAGE REPORT

*ALTA at River's Edge
Wayland, MA*

*A&M Project # 1670-09A
October 18, 2019*

Semi-Annual Inspection (specifically after foliage & snow season)

Isolator rows:

Inspect Isolator row by using inspection port and/or access structure. Remove any accumulated sediment as needed when average depths reach 1" with a vacuum truck or per the manufactures recommendation.

Culverts:

Inspect culverts to ensure that the culverts are working in their intended fashion and that they are free of debris. Remove any obstructions to flow; remove accumulated sediments and debris at the inlet, at the outlet, and within the conduit and to repair any erosion damage at the culvert's inlet and outlet.

Vegetated Areas:

Inspect slopes and embankments early in the growing season to identify active or potential erosion problems. Replant bare areas or areas with sparse growth. Where rill erosion is evident, armor the area with an appropriate lining or divert the erosive flows to on-site areas able to withstand the concentrated flows.

Roadways and Parking Surfaces:

Sweep paved areas as soon as possible after snow melt and no less than four times annually. Clear accumulations of winter sand in parking lots and along roadways at least once a year, preferably in the spring. Accumulations on pavement may be removed by pavement sweeping.

Accumulations of sand along road shoulders may be removed by grading excess sand to the pavement edge and removing it manually or by a front-end loader.

Level Spreaders, Check Dams, Rip-Rap:

These accessories will be inspected for erosion, debris accumulation, and unwanted vegetation. Erosion will be stabilized and sediment, debris, and woody vegetation will be removed.

LANDSCAPE MANAGEMENT PLAN

It should be recognized that this is a general guideline towards achieving high quality and well-groomed landscaped areas. The grounds staff / landscape contractor must recognize the shortcomings of a general maintenance program such as this, and modify and/or augment it based on weekly, monthly, and yearly observations. In order to assure the highest quality conditions, the staff must also recognize and appreciate the need to be aware of the constantly changing conditions of the landscaping and be able to respond to them on a proactive basis.

DRAINAGE REPORT

*ALTA at River's Edge
Wayland, MA*

*A&M Project # 1670-09A
October 18, 2019*

Additional care must be taken in landscape areas that are functioning as BMP drainage structures. These areas have been specifically designed to treat and convey stormwater and shall be maintained as such. These areas include the Bioretention Areas, Gravel Infiltration Swale, Grassed Filter Strips, Sediment Forebay and Detention Basin and are illustrated on the attached Operation and Maintenance Plan (OM-1)

Fertilizer

Maintenance practices should be aimed at reducing environmental, mechanical and pest stresses to promote healthy and vigorous growth. When necessary, pest outbreaks should be treated with the most sensitive control measure available. Synthetic chemical controls should be used only as a last resort to organic and biological control methods. Fertilizer, synthetic chemical controls and pest management applications (when necessary) should be performed only by licensed applicators in accordance with the manufacturer's label instructions when environmental conditions are conducive to controlled product application.

Only slow-release organic fertilizers should be used in the landscaped areas to limit the amount of nutrients that could enter downstream resource areas. Fertilization of developed areas on site will be performed within manufacturers labeling instructions. Additionally, the fertilizer will include a slow release element and be Phosphorous free.

Suggested Aeration Program

In-season aeration of lawn areas is good cultural practice, and is recommended whenever feasible. It should be accomplished with a solid thin tine aeration method to reduce disruption to the use of the area. The depth of solid tine aeration is similar to core type, but should be performed when the soil is somewhat drier for a greater overall effect.

Depending on the intensity of use, it can be expected that all landscaped lawn areas will need aeration to reduce compaction at least once per year. The first operation should occur in late May following the spring season. Methods of reducing compaction will vary based on the nature of the compaction. Compaction on newly established landscaped areas is generally limited to the top 2-3" and can be alleviated using hollow core or thin tine aeration methods.

The spring aeration should consist of two passes at opposite directions with 1/4" hollow core tines penetrating 3-5" into the soil profile. Aeration should occur when the soil is moist but not saturated. The cores should be shattered in place and dragged or swept back into the turf to control thatch. If desired the cores may also be removed and the area top-dressed with sand or sandy loam. If the area drains on average too slowly, the topdressing should contain a higher percentage of sand. If it is draining on average too quickly, the top dressing should contain a higher percentage of soil and organic matter.

DRAINAGE REPORT

*ALTA at River's Edge
Wayland, MA*

*A&M Project # 1670-09A
October 18, 2019*

Landscape Maintenance Program Practices:

Lawn

- Mow a minimum of once a week in spring, to a height of 2" to 2 1/2" high. Mowing should be frequent enough so that no more than 1/3 of grass blade is removed at each mowing. The top growth supports the roots; the shorter the grass is cut, the less the roots will grow. Short cutting also dries out the soil and encourages weeds to germinate.
- Mow approximately once every two weeks from July 1st to August 15th depending on lawn growth.
- Mow on a ten-day cycle in fall, when growth is stimulated by cooler nights and increased moisture.
- Do not remove grass clippings after mowing. (Except in Drainage BMP's)
- Keep mower blades sharp to prevent ragged cuts on grass leaves, which cause a brownish appearance and increase the chance for disease to enter a leaf.
- Supplemental irrigation of lawn areas should provide 1" of water per week in two watering's per week—when no natural rainfall has occurred.

Shrubs

- Mulch not more than 3" depth with shredded pine or fir bark.
- Hand pruning shall be performed annually based on the natural growth characteristics of each species to keep plants from overgrowing walks and windows. **NO SHEARING OF SHRUBS IS PERMITTED.** Typically, pruning of each variety shall be immediately after blooming.
- Fertilize with ½ lb. slow-release fertilizer (see above section on Fertilizer) every second year.
- Hand prune evergreen shrubs only as needed to remove dead and damaged wood and to maintain the naturalistic form of the shrub. Never mechanically shear evergreen shrubs.

Trees

- Provide aftercare for new tree plantings for the first three years.
- Do not fertilize trees, it artificially stimulates them (unless tree health warrants).
- Water once a week for the first year; twice a month the second, once a month the third year.
- Prune trees on a four-year cycle.

Grassland Management Protocol

During the first three growing seasons, the native grasslands should mowed one or two times with a sickle bar mower to suppress weed species. The blade shall be set between 5"-10" as

DRAINAGE REPORT

*ALTA at River's Edge
Wayland, MA*

*A&M Project # 1670-09A
October 18, 2019*

directed. If weed growth is not rampant, the first mowing should be done in mid-July. More than one mowing may be necessary over the course of the first and second growing season if extensive weed growth is evident. During the third year of growth, one mowing shall be performed in late July. No rotary mowers shall be used. All cuttings should be removed and disposed of away from the planted area until the grassland habitat is fully established.

No fertilizers shall be used after planting. The low nitrogen available from the soil is an important factor in suppressing many potential invasive species from establishing in the grassland restoration areas.

Herbicides shall only be used where non-grass herbaceous species comprise more than 30 percent of vegetative cover based as determined from monitoring. Appropriate broad-leaf herbicides should be used only according to their directions.

Supplemental Seeding shall be done in areas where the primary seeding has not been successful as directed by the monitor.

Maintenance Phase

By the fourth growing season, the planted grasslands should be reaching maturity. At this time, half of the grassland habitat area should be mown annually in mid- August to maintain the grassland habitat, limiting the opportunity for shrubs and late-blooming forbs to spread, and allowing the grasses time to recover before dormancy.

Management of Deicing Chemicals and Snow

Snow shall not be plowed towards any area protected by the Massachusetts Wetlands Protection Act. Additionally, it is prohibited to dump snow into the bioretention swales, or gravel swales. Snow shall only be stockpiled on site within the snow storage areas depicted on the Snow Storage plan. If the stockpiles of snow do not fit within the designated areas, then snow will be disposed off-site. It will be the responsibility of the snow removal contractor to properly dispose of transported snow according to the Massachusetts DEP, Bureau of Resource Protection – Snow Disposal Guideline #BRPG01-0, governing the proper disposal of snow. It will be the responsibility of the snow removal contractor to follow these guidelines and all applicable laws and regulations. A copy of the MA DEP Snow Disposal Guideline #BRPG01-01 has been included at the end of Section 2 for reference.

The sites maintenance staff (or its designee) will be responsible for the clearing of the sidewalk and building entrances. The site may be required to use a de-icing agent such as potassium chloride (or approved equal) to maintain a safe walking surface; however, these are to be used at the minimum amount practicable. The de-icing agent for the walkways and building entrances will be kept within the storage rooms located within the buildings. De-

DRAINAGE REPORT

*ALTA at River's Edge
Wayland, MA*

*A&M Project # 1670-09A
October 18, 2019*

icing agents will not be stored outside and shall not be used within 100 feet of the bordering vegetated wetlands.

Spill Prevention and Response

Sources of potential spill hazards include vehicle fluids, liquid fuels, pesticides, paints, solvents, and liquid cleaning products. The majority of the spill hazards would likely occur within the building and would not enter the stormwater drainage system. However, there are spill hazards from vehicle fluids or liquid fuels located outside of the buildings. These exterior spill hazards have the potential to enter the stormwater drainage system and are to be addressed as follows:

1. Spill Hazards of pesticides, paints, and solvents shall be remediated using the Manufacturers' recommended spill cleanup protocol.
2. Vehicle fluids and liquid fuel spill shall be remediated according to the local and state regulations governing fuel spills.
3. The owner shall have the following equipment and materials on hand to address a spill clean-up: brooms, dust pans, mops, rags, gloves, absorptive material, sand, sawdust, plastic and metal trash containers.
4. All spills shall be cleaned up immediately after discovery
5. Spills of toxic or hazardous material shall be reported, regardless of size, to the Massachusetts Department of Environmental Protection at 888-304-1133.
6. Should a spill occur, the pollution prevention plan will be adjusted to include measures to prevent another spill of a similar nature. A description of the spill, along with the causes and cleanup measures will be included in the updated pollution prevention plan.

Pet Waste Management

Pet waste stations will be provided on site. Ultimately, it will be the responsibility of the pet owner to clean any waste and discard it in the provided stations.

OPERATION & MAINTENANCE PLAN SCHEDULE

Project: ALTA at River's Edge
Address: 490 Boston Post Road
 Wayland, MA

ty Responsible for O & M Plan: WP East Acquisitions, LLC.
Address: 91 Hartwell Avenue
 3rd Floor
 Lexington, MA 02421
Phone: (978)-369-8111

Date: 5/31/2017
Revised: -----

Structure or Task	Maintenance Activity	Schedule/Notes	Annual Maintenance Cost	Inspection Performed	
				Date:	By:
Street Sweeping	Sweep, power broom or vacuum paved areas.	Sweep paved areas as needed, but not less than four times annually.	\$2,000		
		Submit information that confirms that all street sweepings have been disposed in accordance with state and local requirements			
Deep Sump Catch Basins(s)	Clam shell or vacuum sumps	Inspect at least twice annually. Clean when sediment is within 2.5 feet of the outlet invert.	\$500		
		Submit information that confirms that all catch basin sediments have been disposed in accordance with state and local requirements			
Storm Water Management System					
Proprietary Separators	See the ConTECH Maintenance package for the inspection and cleaning procedure.	Inspect at least four times annually as well as following storms exceeding 1" of rainfall. Devices shall be cleaned at least once annually or when sediment reaches 6 inches of depth whichever is more frequent. See also note #1 below.	\$250		
		Submit information that confirms that all water quality inlets sediments have been disposed in accordance with state and local requirements			
Subsurface Infiltration Systems	Inspect to ensure it is draining properly.	Perform every other month as well as after every storm event over 1/2". See also note #1 below.	\$500		
	Inspect isolator row using inspection ports and remove any accumulated sediment when average depth reaches 1" per the manufacturers recommendation.	On a semi-annual basis.			
Outlet Control Structure(s)	Vacuum.	Periodic cleaning of Outlet Control Structures as needed.	\$50		
Mosquito Control	CB management targeted larviciding treatment to CB's and all storm drains to control mosquitoes in their aquatic stages.	Surveillance is a non chemical inspection method that involves classification of mosquito breeding sites, larval presents, and survey.	\$100		
Snow Storage	Debris shall be cleared from the site and properly disposed of at the end of the snow season, but shall be cleared no later than May 15.	Avoid dumping snow removal over catch basins, in detention ponds, sediment forebays, rivers, wetlands, and flood plain. It is also prohibited to dump snow in the bioretention basins or gravel swales. (See Site Plan for appropriate locations)	\$500		

Note #1 - During the first year of operation, all of the BMP's shall be inspected during and after large storm events to ensure they are functioning properly. The subsurface infiltration systems should be fully drained within 72 hours after a rain event. If they are not drained within this time period, the systems shall be evaluated and corrective actions should be implemented.



Energy and Environmental Affairs

[Home](#) > [Agencies](#) > [MassDEP](#) > [Water Resources](#) > [Laws & Rules](#) > [Snow Disposal Guidance](#)

Snow Disposal Guidance

Effective Date: March 8, 2001

Guideline No. BRPG01-01

Applicability: Applies to all federal, state, regional and local agencies, as well as to private businesses.

Supersedes: BRP Snow Disposal Guideline BRPG97-1 issued 12/19/97, and all previous snow disposal guidance

Approved by: Glenn Haas, Assistant Commissioner for Resource Protection

PURPOSE: To provide guidelines to all government agencies and private businesses regarding snow disposal site selection, site preparation and maintenance, and emergency snow disposal options that are acceptable to the Department of Environmental Protection, Bureau of Resource Protection.

APPLICABILITY: These Guidelines are issued by the Bureau of Resource Protection on behalf of all Bureau Programs (including Drinking Water Supply, Wetlands and Waterways, Wastewater Management, and Watershed Planning and Permitting). They apply to public agencies and private businesses disposing of snow in the Commonwealth of Massachusetts.

INTRODUCTION

Finding a place to dispose of collected snow poses a challenge to municipalities and businesses as they clear roads, parking lots, bridges, and sidewalks. While we are all aware of the threats to public safety caused by snow, collected snow that is contaminated with road salt, sand, litter, and automotive pollutants such as oil also threatens public health and the environment.

As snow melts, road salt, sand, litter, and other pollutants are transported into surface water or through the soil where they may eventually reach the groundwater. Road salt and other pollutants can contaminate water supplies and are toxic to aquatic life at certain levels. Sand washed into waterbodies can create sand bars or fill in wetlands and ponds, impacting aquatic life, causing flooding, and affecting our use of these resources.

There are several steps that communities can take to minimize the impacts of snow disposal on public health and the environment. These steps will help communities avoid the costs of a contaminated water supply, degraded waterbodies, and flooding. Everything we do on the land has the potential to impact our water resources. Given the authority of local government over the use of the land, municipal officials and staff have a critically important role to play in protecting our water resources.

The purpose of these guidelines is to help municipalities and businesses select, prepare, and maintain appropriate snow disposal sites before the snow begins to accumulate through the winter.

RECOMMENDED GUIDELINES

These snow disposal guidelines address: (1) site selection; (2) site preparation and maintenance; and (3) emergency snow disposal.

1. SITE SELECTION

The key to selecting effective snow disposal sites is to locate them adjacent to or on pervious surfaces in upland areas away from water resources and wells. At these locations, the snow meltwater can filter in to the soil, leaving behind sand and debris which can be removed in the springtime. The following areas should be avoided:

- Avoid dumping of snow into any waterbody, including rivers, the ocean, reservoirs, ponds, or wetlands. In addition to water quality impacts and flooding, snow disposed of in open water can cause navigational hazards when it freezes into ice blocks.
- Do not dump snow within a Zone II or Interim Wellhead Protection Area (IWPA) of a public water supply well or within 75 feet of a private well, where road salt may contaminate water supplies.
- Avoid dumping snow on MassDEP-designated high and medium-yield aquifers where it may contaminate groundwater (see the next page for information on ordering maps from MassGIS showing the locations of aquifers, Zone II's, and IWPAs in your community).
- Avoid dumping snow in sanitary landfills and gravel pits. Snow meltwater will create more contaminated leachate in landfills posing a greater risk to groundwater, and in gravel pits, there is little opportunity for pollutants to be filtered out of the meltwater because groundwater is close to the land surface.



- Avoid disposing of snow on top of storm drain catch basins or in stormwater drainage swales or ditches. Snow combined with sand and debris may block a storm drainage system, causing localized flooding. A high volume of sand, sediment, and litter released from melting snow also may be quickly transported through the system into surface water.

Site Selection Procedures

1. It is important that the municipal Department of Public Works or Highway Department, Conservation Commission, and Board of Health work together to select appropriate snow disposal sites. The following steps should be taken:
2. Estimate how much snow disposal capacity is needed for the season so that an adequate number of disposal sites can be selected and prepared.
3. Identify sites that could potentially be used for snow disposal such as municipal open space (e.g., parking lots or parks).
4. Sites located in upland locations that are not likely to impact sensitive environmental resources should be selected first.
5. If more storage space is still needed, prioritize the sites with the least environmental impact (using the site selection criteria, and local or MassGIS maps as a guide).

MassGIS Maps of Open Space and Water Resources

If local maps do not show the information you need to select appropriate snow disposal sites, you may order maps from MassGIS (Massachusetts Geographic Information System) which show publicly owned open spaces and approximate locations of sensitive environmental resources (locations should be field-verified where possible). Different coverages or map themes depicting sensitive environmental resources are available from MassGIS on the map you order. At a minimum, you should order the Priority Resources Map. The Priority Resources Map includes aquifers, public water supplies, MassDEP-approved Zone II's, Interim Wellhead Protection Areas, Wetlands, Open Space, Areas of Critical Environmental Concern, NHESP Wetlands Habitats, MassDEP Permitted Solid Waste facilities, Surface Water Protection areas (Zone A's) and base map features. The cost of this map is \$25.00. Other coverages or map themes you may consider, depending on the location of your city or town, include Outstanding Resource Waters and MassDEP Eelgrass Resources. These are available at \$25.00 each, with each map theme being depicted on a separate map. Maps should be ordered from [MassGIS](#). Maps may also be ordered by fax at 617-626-1249 (order form available from the MassGIS web site) or mail. For further information, contact MassGIS at 617-626-1189.

2. SITE PREPARATION AND MAINTENANCE

In addition to carefully selecting disposal sites before the winter begins, it is important to prepare and maintain these sites to maximize their effectiveness. The following maintenance measures should be undertaken for all snow disposal sites:

- A silt fence or equivalent barrier should be placed securely on the downgradient side of the snow disposal site.
- To filter pollutants out of the meltwater, a 50-foot vegetative buffer strip should be maintained during the growth season between the disposal site and adjacent waterbodies.
- Debris should be cleared from the site prior to using the site for snow disposal.
- Debris should be cleared from the site and properly disposed of at the end of the snow season and no later than May 15.

3. EMERGENCY SNOW DISPOSAL

As mentioned earlier, it is important to estimate the amount of snow disposal capacity you will need so that an adequate number of upland disposal sites can be selected and prepared.

If despite your planning, upland disposal sites have been exhausted, snow may be disposed of near waterbodies. A vegetated buffer of at least 50 feet should still be maintained between the site and the waterbody in these situations. Furthermore, it is essential that the other guidelines for preparing and maintaining snow disposal sites be followed to minimize the threat to adjacent waterbodies.

Under extraordinary conditions, when all land-based snow disposal options are exhausted, disposal of snow that is not obviously contaminated with road salt, sand, and other pollutants may be allowed in certain waterbodies under certain conditions. In these dire situations, notify your Conservation Commission and the appropriate MassDEP Regional Service Center before disposing of snow in a waterbody.

Use the following guidelines in these emergency situations:

- Dispose of snow in open water with adequate flow and mixing to prevent ice dams from forming.
- Do not dispose of snow in saltmarshes, vegetated wetlands, certified vernal pools, shellfish beds, mudflats, drinking water reservoirs and their tributaries, Zone IIs or IWPA's of public water supply wells, Outstanding Resource Waters, or Areas of Critical Environmental Concern.
- Do not dispose of snow where trucks may cause shoreline damage or erosion.
- Consult with the municipal Conservation Commission to ensure that snow disposal in open water complies with local

ordinances and bylaws.

FOR MORE INFORMATION

If you need more information, contact one of MassDEP's Regional Service Centers:

Northeast Regional Office, Wilmington, 978-694-3200

Southeast Regional Office, Lakeville, 508-946-2714

Central Regional Office, Worcester, 508-792-7683

Western Regional Office, Springfield, 413-755-2214

or

Call Thomas Maguire of DEP's Bureau of Resource Protection in Boston at 617-292-5602.

Chapter 5 Miscellaneous Stormwater Topics

Mosquito Control in Stormwater Management Practices

Both aboveground and underground stormwater BMPs have the potential to serve as mosquito breeding areas. Good design, proper operation and maintenance and treatment with larvicides can minimize this potential.

EPA recommends that stormwater treatment practices dewater within 3 days (72 hours) to reduce the number of mosquitoes that mature to adults, since the aquatic stage of many mosquito species is 7 to 10 days. Massachusetts has had a 72-hour dewatering rule in its Stormwater Management Standards since 1996. The 2008 technical specifications for BMPs set forth in Volume 2, Chapter 2 of the Massachusetts Stormwater Handbook also concur with this practice by requiring that all stormwater practices designed to drain do so within 72 hours.

Some stormwater practices are designed to include permanent wet pools. These practices – if maintained properly – can limit mosquito breeding by providing habitat for mosquito predators. Additional measures that can be taken to reduce mosquito populations include increasing water circulation, attracting mosquito predators by adding suitable habitat, and applying larvicides.

The Massachusetts State Reclamation and Mosquito Control Board (SRMCB), through the Massachusetts Mosquito Control Districts, can undertake further mosquito control actions specifically for the purpose of mosquito control pursuant to Massachusetts General Law Chapter 252. The Mosquito Control Board, <http://www.mass.gov/agr/mosquito/>, describes mosquito control methods and is in the process of developing guidance documents that describe Best Management Practices for mosquito control projects.

The SRMCB and Mosquito Control Districts are not responsible for operating and maintaining stormwater BMPs to reduce mosquito populations. The owners of property that construct the stormwater BMPs or municipalities that “accept” them through local subdivision approval are responsible for their maintenance.¹ The SRMCB is composed of officials from MassDEP, Department of Agricultural Resources, and Department of Conservation and Recreation. The nine (9) Mosquito Control Districts overseen by the SRMCB are located throughout Massachusetts, covering 176 municipalities.

Construction Period Best Management Practices for Mosquito Control

To minimize mosquito breeding during construction, it is essential that the following actions be taken to minimize the creation of standing pools by taking the following actions:

- **Minimize Land Disturbance:** Minimizing land disturbance reduces the likelihood of mosquito breeding by reducing silt in runoff that will cause construction period controls to clog and retain standing pools of water for more than 72 hours.
- **Catch Basin inlets:** Inspect and refresh filter fabric, hay bales, filter socks or stone dams on a regular basis to ensure that any stormwater ponded at the inlet drains within 8 hours after precipitation stops. Shorter periods may be necessary to avoid hydroplaning in roads

¹ MassDEP and MassHighway understand that the numerous stormwater BMPs along state highways pose a unique challenge. To address this challenge, the 2004 MassHighway Stormwater Handbook will provide additional information on appropriate operation and maintenance practices for mosquito control when the Handbook is revised to reflect the 2008 changes to the Stormwater Management Standards..

caused by water ponded at the catch basin inlet. Treat catch basin sumps with larvicides such as *Bacillus sphaericus* (*Bs*) using a licensed pesticide applicator.

- **Check Dams:** If temporary check dams are used during the construction period to lag peak rate of runoff or pond runoff for exfiltration, inspect and repair the check dams on a regular basis to ensure that any stormwater ponded behind the check dam drains within 72 hours.
- **Design construction period sediment traps** to dewater within 72 hours after precipitation. Because these traps are subject to high silt loads and tend to clog, treat them with the larvicide *Bs* after it rains from June through October, until the first frost occurs.
- **Construction period open conveyances:** When temporary manmade ditches are used for channelizing construction period runoff, inspect them on a regular basis to remove any accumulated sediment to restore flow capacity to the temporary ditch.
- **Revegetating Disturbed Surfaces:** Revegetating disturbed surfaces reduces sediment in runoff that will cause construction period controls to clog and retain standing pools of water for greater than 72 hours.
- **Sediment fences/hay bale barriers:** When inspections find standing pools of water beyond the 24-hour period after a storm, take action to restore barrier to its normal function.

Post-Construction Stormwater Treatment Practices

- Mosquito control begins with the environmentally sensitive site design. Environmentally sensitive site design that minimizes impervious surfaces reduces the amount of stormwater runoff. Disconnecting runoff using the LID Site Design credits outlined in the Massachusetts Stormwater Handbook reduces the amount of stormwater that must be conveyed to a treatment practice. Utilizing green roofs minimizes runoff from smaller storms. Storage media must be designed to dewater within 72 hours after precipitation.
- Mosquito control continues with the selection of structural stormwater BMPs that are unlikely to become breeding grounds for mosquitoes, such as:
 - **Bioretention Areas/Rain Gardens/Sand Filter:** These practices tend not to result in mosquito breeding. If any level spreaders, weirs or sediment forebays are used as part of the design, inspect them and correct them as necessary to prevent standing pools of water for more than 72 hours.
 - **Infiltration Trenches:** This practice tends not to result in mosquito breeding. If any level spreaders, weirs, or sediment forebays are used as part of the design, inspect them and correct them as necessary to prevent standing pools of water for more than 72 hours.
- Another mosquito control strategy is to select BMPs that can become habitats for mosquito predators, such as:
 - **Constructed Stormwater Wetlands:** Habitat features can be incorporated in constructed stormwater wetlands to attract dragonflies, amphibians, turtles, birds, bats, and other natural predators of mosquitoes.
 - **Wet Basins:** Wet basins can be designed to incorporate fish habitat features, such as deep pools. Introduce fish in consultation with Massachusetts Division of Fisheries and Wildlife. Vegetation within wet basins designed as fish habitat must be properly managed to ensure that vegetation does not overtake the habitat. Proper design to ensure that no low circulation or “dead” zones are created may reduce the potential for mosquito breeding. Introducing bubblers may increase water circulation in the wet basin.

Effective mosquito controls require proponents to design structural BMPs to prevent ponding and facilitate maintenance and, if necessary, the application of larvicides. Examples of such design practices include the following:

- **Basins:** Provide perimeter access around wet basins, extended dry detention basins and dry detention basins for both larviciding and routine maintenance. Control vegetation to ensure that access pathways stay open.
- **BMPs without a permanent pool of water:** All structural BMPs that do not rely on a permanent pool of water must drain and completely dewater within 72 hours after precipitation. This includes dry detention basins, extended dry detention basins, infiltration basins, and dry water quality swales. Use underdrains at extended dry detention basins to drain the small pools that form due to accumulation of silts. Wallace indicates that extended dry extended detention basins may breed more mosquitoes than wet basins. It is, therefore, imperative to design outlets from extended dry detention basins to completely dewater within the 72-hour period.
- **Energy Dissipators and Flow Spreaders:** Currier and Moeller, 2000 indicate that shallow recesses in energy dissipators and flow spreaders trap water where mosquitoes breed. Set the riprap in grout to reduce the shallow recesses and minimize mosquito breeding.
- **Outlet control structures:** Debris trapped in small orifices or on trash racks of outlet control structures such as multiple stage outlet risers may clog the orifices or the trash rack, causing a standing pool of water. Optimize the orifice size or trash rack mesh size to provide required peak rate attenuation/water quality detention/retention time while minimizing clogging.
- **Rain Barrels and Cisterns:** Seal lids to reduce the likelihood of mosquitoes laying eggs in standing water. Install mosquito netting over inlets. The cistern system should be designed to ensure that all collected water is drained into it within 72 hours.
- **Subsurface Structures, Deep Sump Catch Basins, Oil Grit Separators, and Leaching Catch Basins:** Seal all manhole covers to reduce likelihood of mosquitoes laying eggs in standing water. Install mosquito netting over the outlet (CALTRANS 2004).

The Operation and Maintenance Plan should provide for mosquito prevention and control.

- **Check dams:** Inspect permanent check dams on the schedule set forth in the O&M Plan. Inspect check dams 72 hours after storms for standing water ponding behind the dam. Take corrective action if standing water is found.
- **Cisterns:** Apply *Bs* larvicide in the cistern if any evidence of mosquitoes is found. The Operation and Maintenance Plan shall specify how often larvicides should be applied to waters in the cistern.
- **Water quality swales:** Remove and properly dispose of any accumulated sediment as scheduled in the Operation and Maintenance Plan.
- **Larvicide Treatment:** The Operation and Maintenance Plan must include measures to minimize mosquito breeding, including larviciding.
- The party identified in the Operation and Maintenance Plan as responsible for maintenance shall see that larvicides are applied as necessary to the following stormwater treatment practices: catch basins, oil/grit separators, wet basins, wet water quality swales, dry extended detention basins, infiltration basins, and constructed stormwater wetlands. The Operation and Maintenance Plan must ensure that all larvicides are applied by a licensed pesticide applicator and in compliance with all pesticide label requirements.
- The Operation and Maintenance Plan should identify the appropriate larvicide and the time and method of application. For example, *Bacillus sphaericus* (*Bs*), the preferred

larvicide for stormwater BMPs, should be hand-broadcast.² Alternatively, Altosid, a Methopren product, may be used. Because some practices are designed to dewater between storms, such as dry extended detention and infiltration basins, the Operation and Maintenance Plan should provide that larviciding must be conducted during or immediately after wet weather, when the detention or infiltration basin has a standing pool of water, unless a product is used that can withstand extended dry periods.

REFERENCES

- California Department of Transportation, 2004, BMP Retrofit Pilot Program, Final Report, Report ID CTSW – RT – 1 – 050,
http://www.dot.ca.gov/hq/env/stormwater/special/newsetup/pdfs/new_technology/CTSW-RT-01-050.pdf#xml=http://dap1.dot.ca.gov/cgi-bin/texis/webinator/search/pdfhi.txt?query=mosquito&db=db&pr=www&prox=page&rorder=500&rprox=500&rdfreq=500&rwfreq=500&rlead=500&sufs=0&order=r&cq=&id=4673373b7
Appendix E: Vector Monitoring and Abatement,
http://www.dot.ca.gov/hq/env/stormwater/special/newsetup/pdfs/new_technology/
California Department of Transportation, 2001, Final Vector Report, Caltrans BMP Retrofit Project Sites, Districts 7 and 11,
http://www.dot.ca.gov/hq/env/stormwater/special/newsetup/pdfs/new_technology/CTSW-RT-01-050/AppendixE/01_FinalVectorReport.pdf
Currier, Brian, and Moeller, Glenn, 2000, Glenn, Lessons Learned: The CALTRANS Storm Water Best Management Practice Retrofit Pilot Study, prepared by the California State University Sacramento and University of California Davis for the California Department of Transportation,
<http://www.owp.csus.edu/research/papers/papers/PP015.pdf>
Massachusetts Department of Environmental Protection, 2001, West Nile Virus, Application of Pesticides to Wetland Resource Areas and Buffer Zones and Public Water systems, Guideline No. BRPG01-02, <http://www.mass.gov/dep/water/wnvpolicy.doc>
O’Meara, G.F., 2003, Mosquitoes Associated With Stormwater Detention/Retention Areas, ENY627, University of Florida, Institute of Food and Agricultural Sciences Extension,
<http://edis.ifas.ufl.edu/mg338>
Taylor, Scott M., and Currier, Brian, 1999, A Wet Pond as a Storm Water Runoff BMP – Case Study, presented at Department of Environmental Resources Engineering, Humboldt State University, Arcata, California <http://www.owp.csus.edu/research/papers/papers/PP004.pdf>
U.S. EPA, 2005, Stormwater Structures and Mosquitoes, EPA 833-F-05-003,
http://www.epa.gov/npdes/pubs/sw_wnv.pdf
U.S. EPA, 2003, Do Stormwater Retention Ponds Contribute to Mosquito Problems, Nonpoint source News-Notes, Issue No. 71, <http://notes.tetrattech-ffx.com/newsnotes.nsf/0/143f7fa99c3ea25485256d0100618bc9?OpenDocument>
Virginia Department of Conservation and Recreation, 2003, Vector Control, Mosquitoes and Stormwater Management, Stormwater Management Technical Bulletin No. 8,
http://www.dcr.virginia.gov/soil_&_water/documents/tecbltn8.pdf
Wallace, John R., Stormwater Management and Mosquito Ecology, Stormwater Magazine, March/April 2007, http://www.gradingandexcavation.com/sw_0703_management.html

² *Bacillus thuringiensis israelensis* or *Bti* is usually applied by helicopter to wetlands and floodplains

CDS Guide

Operation, Design, Performance and Maintenance



CDS®

Using patented continuous deflective separation technology, the CDS system screens, separates and traps debris, sediment, and oil and grease from stormwater runoff. The indirect screening capability of the system allows for 100% removal of floatables and neutrally buoyant material without blinding. Flow and screening controls physically separate captured solids, and minimize the re-suspension and release of previously trapped pollutants. Inline units can treat up to 6 cfs, and internally bypass flows in excess of 50 cfs (1416 L/s). Available precast or cast-in-place, offline units can treat flows from 1 to 300 cfs (28.3 to 8495 L/s). The pollutant removal capacity of the CDS system has been proven in lab and field testing.


Operation Overview

Stormwater enters the diversion chamber where the diversion weir guides the flow into the unit's separation chamber and pollutants are removed from the flow. All flows up to the system's treatment design capacity enter the separation chamber and are treated.

Swirl concentration and screen deflection force floatables and solids to the center of the separation chamber where 100% of floatables and neutrally buoyant debris larger than the screen apertures are trapped.

Stormwater then moves through the separation screen, under the oil baffle and exits the system. The separation screen remains clog free due to continuous deflection.

During the flow events exceeding the treatment design capacity, the diversion weir bypasses excessive flows around the separation chamber, so captured pollutants are retained in the separation cylinder.

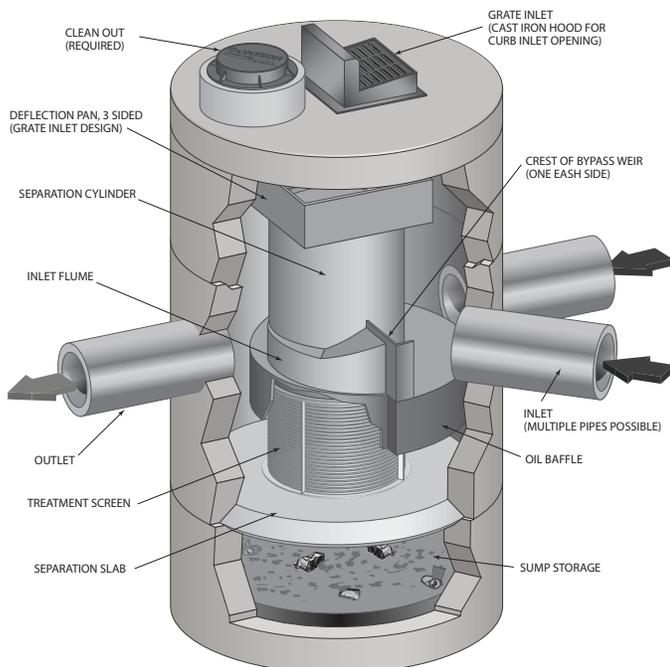

Design Basics

There are three primary methods of sizing a CDS system. The Water Quality Flow Rate Method determines which model size provides the desired removal efficiency at a given flow rate for a defined particle size. The Rational Rainfall Method™ or the Probabilistic Method is used when a specific removal efficiency of the net annual sediment load is required.

Typically in the United States, CDS systems are designed to achieve an 80% annual solids load reduction based on lab generated performance curves for a gradation with an average particle size (d50) of 125 microns (μm). For some regulatory environments, CDS systems can also be designed to achieve an 80% annual solids load reduction based on an average particle size (d50) of 75 microns (μm) or 50 microns (μm).

Water Quality Flow Rate Method

In some cases, regulations require that a specific treatment rate, often referred to as the water quality design flow (WQQ), be treated. This WQQ represents the peak flow rate from either an event with a specific recurrence interval, e.g. the six-month storm, or a water quality depth, e.g. 1/2-inch (13 mm) of rainfall.

The CDS is designed to treat all flows up to the WQQ. At influent rates higher than the WQQ, the diversion weir will direct most flow exceeding the WQQ around the separation chamber. This allows removal efficiency to remain relatively constant in the separation chamber and eliminates the risk of washout during bypass flows regardless of influent flow rates.

Treatment flow rates are defined as the rate at which the CDS will remove a specific gradation of sediment at a specific removal efficiency. Therefore the treatment flow rate is variable, based on the gradation and removal efficiency specified by the design engineer.

Rational Rainfall Method™

Differences in local climate, topography and scale make every site hydraulically unique. It is important to take these factors into consideration when estimating the long-term performance of any stormwater treatment system. The Rational Rainfall Method combines site-specific information with laboratory generated performance data, and local historical precipitation records to estimate removal efficiencies as accurately as possible.

Short duration rain gauge records from across the United States and Canada were analyzed to determine the percent of the total annual rainfall that fell at a range of intensities. US stations' depths were totaled every 15 minutes, or hourly, and recorded in 0.01-inch increments. Depths were recorded hourly with 1-mm resolution at Canadian stations. One trend was consistent at all sites; the vast majority of precipitation fell at low intensities and high intensity storms contributed relatively little to the total annual depth.

These intensities, along with the total drainage area and runoff coefficient for each specific site, are translated into flow rates using the Rational Rainfall Method. Since most sites are relatively small and highly impervious, the Rational Rainfall Method is appropriate. Based on the runoff flow rates calculated for each intensity, operating rates within a proposed CDS system are

determined. Performance efficiency curve determined from full scale laboratory tests on defined sediment PSDs is applied to calculate solids removal efficiency. The relative removal efficiency at each operating rate is added to produce a net annual pollutant removal efficiency estimate.

Probabilistic Rational Method

The Probabilistic Rational Method is a sizing program Contech developed to estimate a net annual sediment load reduction for a particular CDS model based on site size, site runoff coefficient, regional rainfall intensity distribution, and anticipated pollutant characteristics.

The Probabilistic Method is an extension of the Rational Method used to estimate peak discharge rates generated by storm events of varying statistical return frequencies (e.g. 2-year storm event). Under the Rational Method, an adjustment factor is used to adjust the runoff coefficient estimated for the 10-year event, correlating a known hydrologic parameter with the target storm event. The rainfall intensities vary depending on the return frequency of the storm event under consideration. In general, these two frequency dependent parameters (rainfall intensity and runoff coefficient) increase as the return frequency increases while the drainage area remains constant.

These intensities, along with the total drainage area and runoff coefficient for each specific site, are translated into flow rates using the Rational Method. Since most sites are relatively small and highly impervious, the Rational Method is appropriate. Based on the runoff flow rates calculated for each intensity, operating rates within a proposed CDS are determined. Performance efficiency curve on defined sediment PSDs is applied to calculate solids removal efficiency. The relative removal efficiency at each operating rate is added to produce a net annual pollutant removal efficiency estimate.

Treatment Flow Rate

The inlet throat area is sized to ensure that the WQQ passes through the separation chamber at a water surface elevation equal to the crest of the diversion weir. The diversion weir bypasses excessive flows around the separation chamber, thus preventing re-suspension or re-entrainment of previously captured particles.

Hydraulic Capacity

The hydraulic capacity of a CDS system is determined by the length and height of the diversion weir and by the maximum allowable head in the system. Typical configurations allow hydraulic capacities of up to ten times the treatment flow rate. The crest of the diversion weir may be lowered and the inlet throat may be widened to increase the capacity of the system at a given water surface elevation. The unit is designed to meet project specific hydraulic requirements.

Performance

Full-Scale Laboratory Test Results

A full-scale CDS system (Model CDS2020-5B) was tested at the facility of University of Florida, Gainesville, FL. This CDS unit was evaluated under controlled laboratory conditions of influent flow rate and addition of sediment.

Two different gradations of silica sand material (UF Sediment & OK-110) were used in the CDS performance evaluation. The particle size distributions (PSDs) of the test materials were analyzed using standard method "Gradation ASTM D-422 "Standard Test Method for Particle-Size Analysis of Soils" by a certified laboratory.

UF Sediment is a mixture of three different products produced by the U.S. Silica Company: "Sil-Co-Sil 106", "#1 DRY" and "20/40 Oil Frac". Particle size distribution analysis shows that the UF Sediment has a very fine gradation ($d_{50} = 20$ to $30 \mu\text{m}$) covering a wide size range (Coefficient of Uniformity, C averaged at 10.6). In comparison with the hypothetical TSS gradation specified in the NJDEP (New Jersey Department of Environmental Protection) and NJCAT (New Jersey Corporation for Advanced Technology) protocol for lab testing, the UF Sediment covers a similar range of particle size but with a finer d_{50} (d_{50} for NJDEP is approximately $50 \mu\text{m}$) (NJDEP, 2003).

The OK-110 silica sand is a commercial product of U.S. Silica Sand. The particle size distribution analysis of this material, also included in Figure 1, shows that 99.9% of the OK-110 sand is finer than 250 microns, with a mean particle size (d_{50}) of 106 microns. The PSDs for the test material are shown in Figure 1.

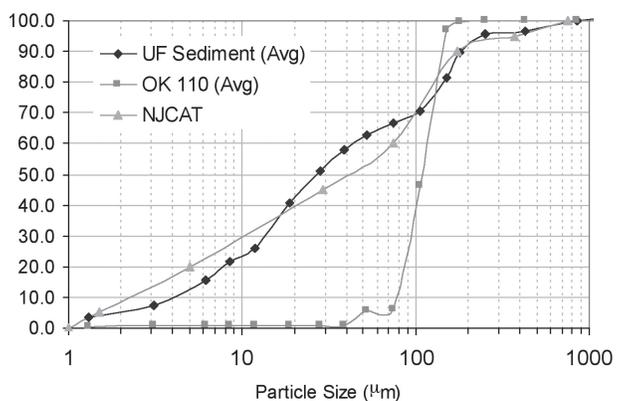


Figure 1. Particle size distributions

Tests were conducted to quantify the performance of a specific CDS unit (1.1 cfs (31.3-L/s) design capacity) at various flow rates, ranging from 1% up to 125% of the treatment design capacity of the unit, using the 2400 micron screen. All tests were conducted with controlled influent concentrations of approximately 200 mg/L. Effluent samples were taken at equal time intervals across the entire duration of each test run. These samples were then processed with a Dekaport Cone sample splitter to obtain representative sub-samples for Suspended Sediment Concentration (SSC) testing using ASTM D3977-97 "Standard Test Methods for Determining Sediment Concentration in Water Samples", and particle size distribution analysis.

Results and Modeling

Based on the data from the University of Florida, a performance model was developed for the CDS system. A regression analysis was used to develop a fitting curve representative of the scattered data points at various design flow rates. This model, which demonstrated good agreement with the laboratory data, can then be used to predict CDS system performance with respect

to SSC removal for any particle size gradation, assuming the particles are inorganic sandy-silt. Figure 2 shows CDS predictive performance for two typical particle size gradations (NJCAT gradation and OK-110 sand) as a function of operating rate.

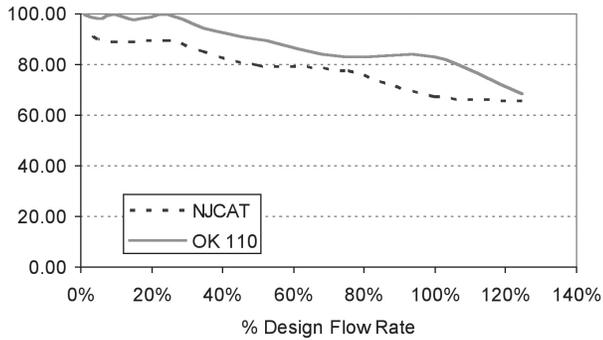


Figure 2. CDS stormwater treatment predictive performance for various particle gradations as a function of operating rate.

Many regulatory jurisdictions set a performance standard for hydrodynamic devices by stating that the devices shall be capable of achieving an 80% removal efficiency for particles having a mean particle size (d_{50}) of 125 microns (e.g. Washington State Department of Ecology — WASDOE - 2008). The model can be used to calculate the expected performance of such a PSD (shown in Figure 3). The model indicates (Figure 4) that the CDS system with 2400 micron screen achieves approximately 80% removal at the design (100%) flow rate, for this particle size distribution ($d_{50} = 125 \mu\text{m}$).

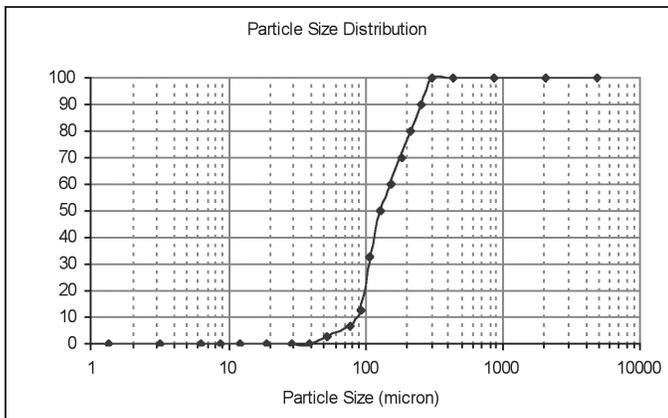


Figure 3. WASDOE PSD

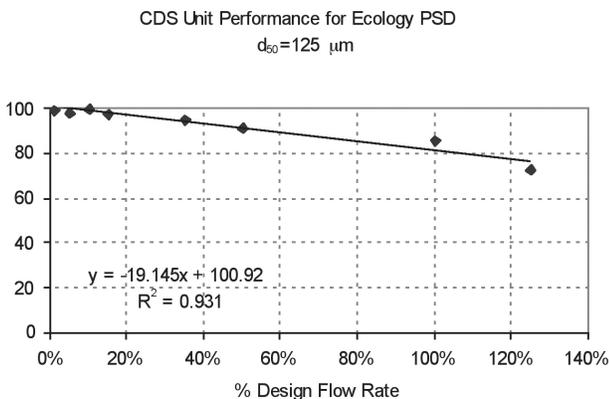


Figure 4. Modeled performance for WASDOE PSD.

Maintenance

The CDS system should be inspected at regular intervals and maintained when necessary to ensure optimum performance. The rate at which the system collects pollutants will depend more heavily on site activities than the size of the unit. For example, unstable soils or heavy winter sanding will cause the grit chamber to fill more quickly but regular sweeping of paved surfaces will slow accumulation.

Inspection

Inspection is the key to effective maintenance and is easily performed. Pollutant transport and deposition may vary from year to year and regular inspections will help ensure that the system is cleaned out at the appropriate time. At a minimum, inspections should be performed twice per year (e.g. spring and fall) however more frequent inspections may be necessary in climates where winter sanding operations may lead to rapid accumulations, or in equipment washdown areas. Installations should also be inspected more frequently where excessive amounts of trash are expected.

The visual inspection should ascertain that the system components are in working order and that there are no blockages or obstructions in the inlet and separation screen. The inspection should also quantify the accumulation of hydrocarbons, trash, and sediment in the system. Measuring pollutant accumulation can be done with a calibrated dipstick, tape measure or other measuring instrument. If absorbent material is used for enhanced removal of hydrocarbons, the level of discoloration of the sorbent material should also be identified



during inspection. It is useful and often required as part of an operating permit to keep a record of each inspection. A simple form for doing so is provided.

Access to the CDS unit is typically achieved through two manhole access covers. One opening allows for inspection and cleanout of the separation chamber (cylinder and screen) and isolated sump. The other allows for inspection and cleanout of sediment captured and retained outside the screen. For deep units, a single manhole access point would allow both sump cleanout and access outside the screen.

The CDS system should be cleaned when the level of sediment has reached 75% of capacity in the isolated sump or when an appreciable level of hydrocarbons and trash has accumulated. If absorbent material is used, it should be replaced when significant discoloration has occurred. Performance will not be impacted until 100% of the sump capacity is exceeded however it is recommended that the system be cleaned prior to that for easier removal of sediment. The level of sediment is easily determined by measuring from finished grade down to the top of the sediment pile. To avoid underestimating the level of sediment in the chamber, the measuring device must be lowered to the top of the sediment pile carefully. Particles at the top of the pile typically offer less resistance to the end of the rod than consolidated particles toward the bottom of the pile. Once this measurement is recorded, it should be compared to the as-built drawing for the unit to determine whether the height of the sediment pile off the bottom of the sump floor exceeds 75% of the total height of isolated sump.

Cleaning

Cleaning of a CDS system should be done during dry weather conditions when no flow is entering the system. The use of a vacuum truck is generally the most effective and convenient method of removing pollutants from the system. Simply remove the manhole covers and insert the vacuum hose into the sump. The system should be completely drained down and the sump fully evacuated of sediment. The area outside the screen should also be cleaned out if pollutant build-up exists in this area.

In installations where the risk of petroleum spills is small, liquid contaminants may not accumulate as quickly as sediment. However, the system should be cleaned out immediately in the event of an oil or gasoline spill. Motor oil and other hydrocarbons that accumulate on a more routine basis should be removed when an appreciable layer has been captured. To remove these pollutants, it may be preferable to use absorbent pads since they are usually less expensive to dispose than the oil/water emulsion that may be created by vacuuming the oily layer. Trash and debris can be netted out to separate it from the other pollutants. The screen should be cleaned to ensure it is free of trash and debris.


Manhole covers should be securely seated following cleaning activities to prevent leakage of runoff into the system from above and also to ensure that proper safety precautions have been followed. Confined space entry procedures need to be followed if physical access is required. Disposal of all material removed from the CDS system should be done in accordance with local regulations. In many jurisdictions, disposal of the sediments may be handled in the same manner as the disposal of sediments removed from catch basins or deep sump manholes. Check your local regulations for specific requirements on disposal.



CDS Model	Diameter		Distance from Water Surface to Top of Sediment Pile		Sediment Storage Capacity	
	ft	m	ft	m	yd ³	m ³
CDS2015-4	4	1.2	3.0	0.9	0.5	0.4
CDS2015	5	1.5	3.0	0.9	1.3	1.0
CDS2020	5	1.5	3.5	1.1	1.3	1.0
CDS2025	5	1.5	4.0	1.2	1.3	1.0
CDS3020	6	1.8	4.0	1.2	2.1	1.6
CDS3030	6	1.8	4.6	1.4	2.1	1.6
CDS3035	6	1.8	5.0	1.5	2.1	1.6
CDS4030	8	2.4	4.6	1.4	5.6	4.3
CDS4040	8	2.4	5.7	1.7	5.6	4.3
CDS4045	8	2.4	6.2	1.9	5.6	4.3

Table 1: CDS Maintenance Indicators and Sediment Storage Capacities

Note: To avoid underestimating the volume of sediment in the chamber, carefully lower the measuring device to the top of the sediment pile. Finer silty particles at the top of the pile may be more difficult to feel with a measuring stick. These finer particles typically offer less resistance to the end of the rod than larger particles toward the bottom of the pile.

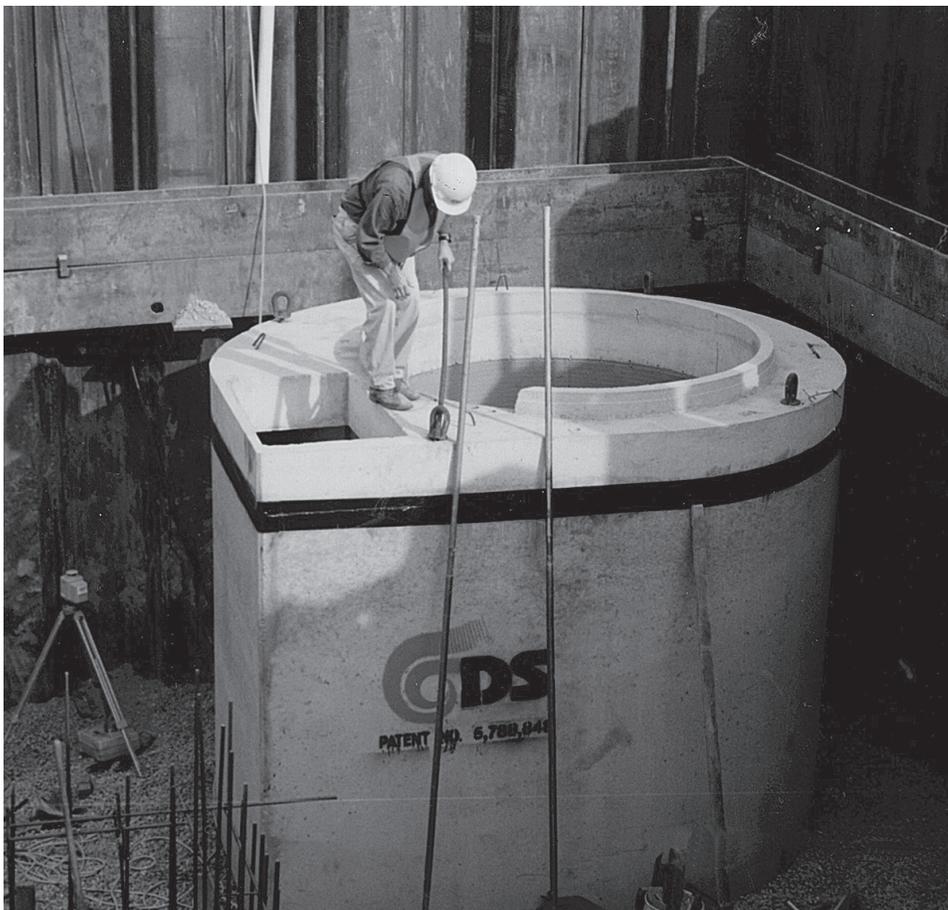

Support

- Drawings and specifications are available at www.ContechES.com.
- Site-specific design support is available from our engineers.



800-338-1122
www.ContechES.com

©2014 Contech Engineered Solutions LLC

Contech Engineered Solutions provides site solutions for the civil engineering industry. Contech's portfolio includes bridges, drainage, sanitary sewer, stormwater, earth stabilization and wastewater products. For information on other Contech division offerings, visit www.ContechES.com or call 800.338.1122

NOTHING IN THIS CATALOG SHOULD BE CONSTRUED AS AN EXPRESSED WARRANTY OR AN IMPLIED WARRANTY OF MERCHANTABILITY OR FITNESS FOR ANY PARTICULAR PURPOSE. SEE THE Contech STANDARD CONDITION OF SALES (VIEWABLE AT www.ContechES.com/COS) FOR APPLICABLE WARRANTIES AND OTHER IMPORTANT INFORMATION.

The product(s) described may be protected by one or more of the following US patents: 5,322,629; 5,624,576; 5,707,527; 5,759,415; 5,788,848; 5,985,157; 6,027,639; 6,350,374; 6,406,218; 6,641,720; 6,511,595; 6,649,048; 6,991,114; 6,998,038; 7,186,058; 7,296,692; 7,297,266; related foreign patents or other patents pending.



Isolator[™] Row O&M Manual
StormTech[®] Chamber System for Stormwater Management

1.0 The Isolator™ Row

1.1 INTRODUCTION

An important component of any Stormwater Pollution Prevention Plan is inspection and maintenance. The StormTech Isolator Row is a patent pending technique to inexpensively enhance Total Suspended Solids (TSS) removal and provide easy access for inspection and maintenance.



Looking down the Isolator Row from the manhole opening, woven geotextile is shown between the chamber and stone base.

1.2 THE ISOLATOR™ ROW

The Isolator Row is a row of StormTech chambers, either SC-740 or SC-310 models, that is surrounded with filter fabric and connected to a closely located manhole for easy access. The fabric-wrapped chambers provide for settling and filtration of sediment as storm water rises in the Isolator Row and ultimately passes through the filter fabric. The open bottom chambers and perforated side-walls allow storm water to flow both vertically and horizontally out of the chambers. Sediments are captured in the Isolator Row protecting the storage areas of the adjacent stone and chambers from sediment accumulation.


Two different fabrics are used for the Isolator Row. A woven geotextile fabric is placed between the stone and the Isolator Row chambers. The tough geotextile provides a media for storm water filtration and provides a durable surface for maintenance operations. It is also designed to prevent scour of the underlying stone and remain intact during high pressure jetting. A non-woven fabric is placed over the chambers to provide a filter media for flows passing through the perforations in the sidewall of the chamber.

The Isolator Row is typically designed to capture the “first flush” and offers the versatility to be sized on a volume basis or flow rate basis. An upstream manhole not only provides access to the Isolator Row but typically includes a high flow weir such that storm water flowrates or volumes that exceed the capacity of the Isolator Row overtop the over flow weir and discharge through a manifold to the other chambers.

The Isolator Row may also be part of a treatment train. By treating storm water prior to entry into the chamber system, the service life can be extended and pollutants such as hydrocarbons can be captured. Pre-treatment best management practices can be as simple as deep sump catch basins, oil-water separators or can be innovative storm water treatment devices. The design of the treatment train and selection of pretreatment devices by the design engineer is often driven by regulatory requirements. Whether pretreatment is used or not, the Isolator Row is recommended by StormTech as an effective means to minimize maintenance requirements and maintenance costs.

Note: See the StormTech Design Manual for detailed information on designing inlets for a StormTech system, including the Isolator Row.

StormTech Isolator Row with Overflow Spillway (not to scale)

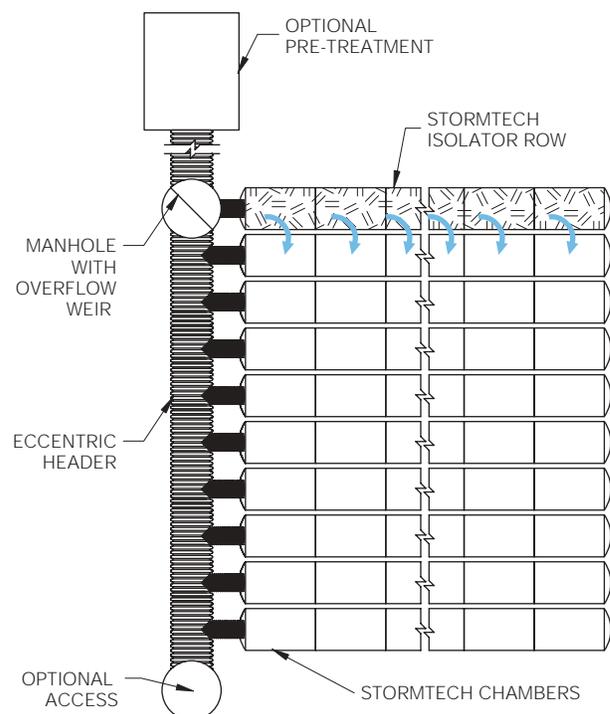

2.0 Isolator Row Inspection/Maintenance

2.1 INSPECTION

The frequency of Inspection and Maintenance varies by location. A routine inspection schedule needs to be established for each individual location based upon site specific variables. The type of land use (i.e. industrial, commercial residential), anticipated pollutant load, percent imperviousness, climate, etc. all play a critical role in determining the actual frequency of inspection and maintenance practices.

At a minimum, StormTech recommends annual inspections. Initially, the Isolator Row should be inspected every 6 months for the first year of operation. For subsequent years, the inspection should be adjusted based upon previous observation of sediment deposition.

The Isolator Row incorporates a combination of standard manhole(s) and strategically located inspection ports (as needed). The inspection ports allow for easy access to the system from the surface, eliminating the need to perform a confined space entry for inspection purposes.

If upon visual inspection it is found that sediment has accumulated, a stadia rod should be inserted to determine the depth of sediment. When the average depth of sediment exceeds 3 inches throughout the length of the Isolator Row, clean-out should be performed.

2.2 MAINTENANCE


The Isolator Row was designed to reduce the cost of periodic maintenance. By "isolating" sediments to just one row, costs are dramatically reduced by eliminating the need to clean out each row of the entire storage bed. If inspection indicates the potential need for maintenance, access is provided via a manhole(s) located on the end(s) of the row for cleanout. If entry into the manhole is required, please follow local and OSHA rules for a confined space entries.



Examples of culvert cleaning nozzles appropriate for Isolator Row maintenance. (These are not StormTech products.)

Maintenance is accomplished with the JetVac process. The JetVac process utilizes a high pressure water nozzle to propel itself down the Isolator Row while scouring and suspending sediments. As the nozzle is retrieved, the captured pollutants are flushed back into the manhole for vacuuming. Most sewer and pipe maintenance companies have vacuum/JetVac combination vehicles. Selection of an appropriate JetVac nozzle will improve maintenance efficiency. Fixed nozzles designed for culverts or large diameter pipe cleaning are preferable. Rear facing jets with an effective spread of at least 45" are best. Most JetVac reels have 400 feet of hose allowing maintenance of an Isolator Row up to 50 chambers long. **The JetVac process shall only be performed on StormTech Isolator Rows that have AASHTO class 1 woven geotextile (as specified by StormTech) over their angular base stone.**

StormTech Isolator Row (not to scale)

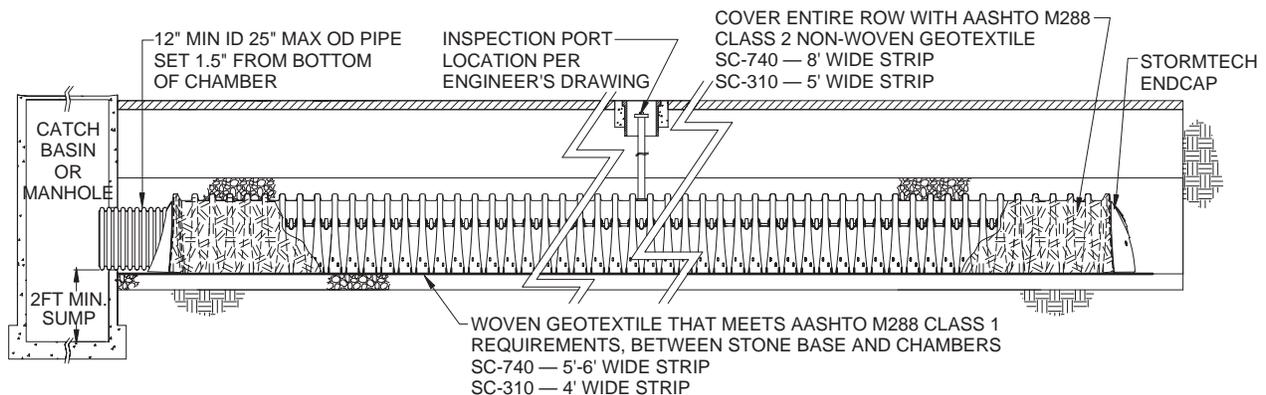

3.0 Isolator Row Step By Step Maintenance Procedures


Step 1) Inspect Isolator Row for sediment

- A) Inspection ports (if present)
 - i. Remove lid from floor box frame
 - ii. Remove cap from inspection riser
 - iii. Using a flashlight and stadia rod, measure depth of sediment and record results on maintenance log.
 - iv. If sediment is at, or above, 3 inch depth proceed to Step 2. If not proceed to step 3.

B) All Isolator Rows

- i. Remove cover from manhole at upstream end of Isolator Row
- ii. Using a flashlight, inspect down Isolator Row through outlet pipe
 - 1. Mirrors on poles or cameras may be used to avoid a confined space entry
 - 2. Follow OSHA regulations for confined space entry if entering manhole
- iii. If sediment is at or above the lower row of sidewall holes (approximately 3 inches) proceed to Step 2. If not proceed to Step 3.

StormTech Isolator Row (not to scale)

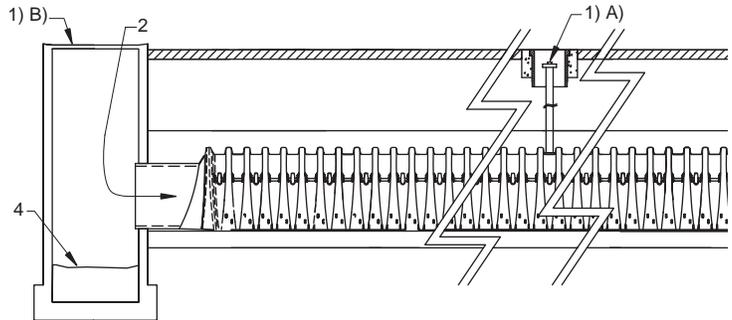

Step 2) Clean out Isolator Row using the JetVac process

- A) A fixed culvert cleaning nozzle with rear facing nozzle spread of 45 inches or more is preferable
- B) Apply multiple passes of JetVac until backflush water is clean
- C) Vacuum manhole sump as required

Step 3) Replace all caps, lids and covers, record observations and actions


Step 4) Inspect & clean catch basins and manholes upstream of the StormTech system

Sample Maintenance Log

Date	Stadia Rod Readings		Sediment Depth (1) - (2)	Observations/Actions	Inspector
	Fixed point to chamber bottom (1)	Fixed point to top of sediment (2)			
3/15/01	6.3 ft.	none		New installation. Fixed point is CI frame at grade	djm
9/24/01		6.2	0.1 ft.	Some grit felt	sm
6/20/03		5.8	0.5 ft.	Mucky feel, debris visible in manhole and in Isolator row, maintenance due	rv
7/7/03	6.3 ft.		0	System jetted and vacuumed	djm



20 Beaver Road, Suite 104 | Wethersfield | Connecticut | 06109
 860.529.8188 | 888.892.2694 | fax 866.328.8401 | www.stormtech.com

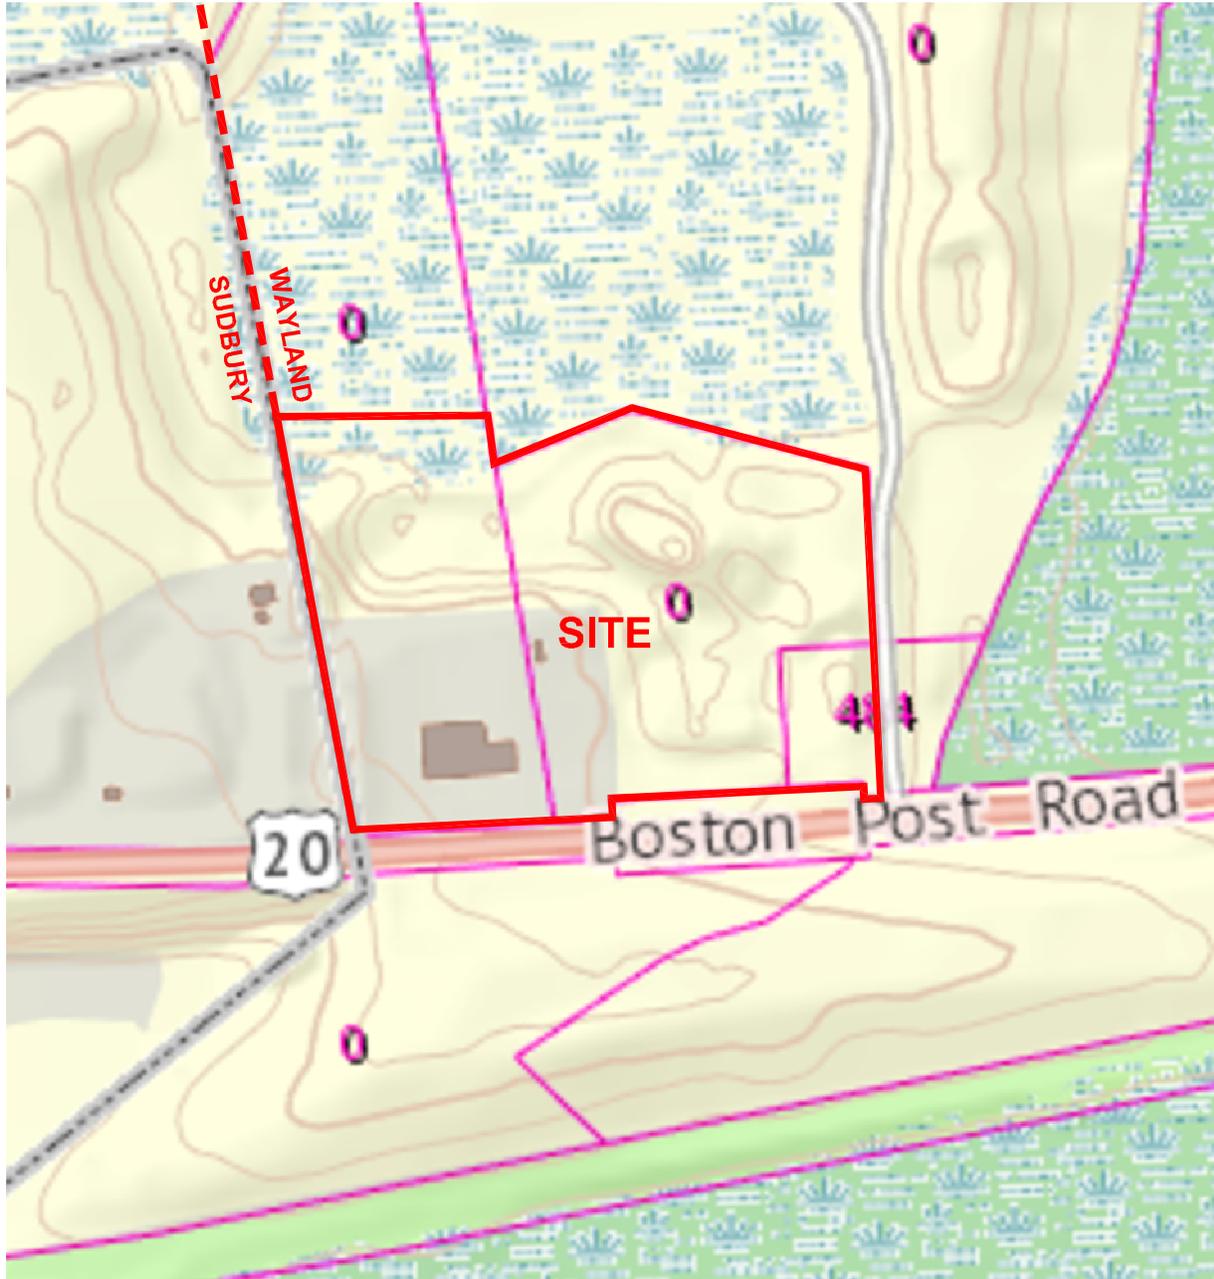

PREPARED BY:



ALLEN & MAJOR ASSOCIATES, INC.

civil & structural engineering ♦ land surveying
 environmental consulting ♦ landscape architecture
 www.allenmajor.com
 100 COMMERCE WAY, SUITE 5
 WOBURN MA 01801
 TEL: (781) 935-6889
 FAX: (781) 935-2896

WOBURN, MA ♦ LAKEVILLE, MA ♦ MANCHESTER, NH

PROJECT:

**ALTA AT RIVER'S EDGE
 490 BOSTON POST ROAD
 WAYLAND, MA**

Copyright © 2019 Allen & Major Associates, Inc.
 All Rights Reserved

USGS SITE LOCUS MAP

PROJECT NO. 1670-09A	DATE: OCTOBER 18, 2019
SCALE: 1"=250'	DWG. NAME: C-1670-09A
DESIGNED BY: DMR	CHECKED BY: CMQ

THIS DRAWING HAS BEEN PREPARED IN ELECTRONIC FORMAT. CLIENT/CLIENT'S REPRESENTATIVE OR CONSULTANT MAY BE PROVIDED COPIES OF DRAWINGS AND SPECIFICATIONS ON MAGNETIC MEDIA FOR HIS/HER INFORMATION AND USE FOR SPECIFIC APPLICATION TO THIS PROJECT. DUE TO THE POTENTIAL THAT THE MAGNETIC INFORMATION MAY BE MODIFIED UNINTENTIONALLY OR OTHERWISE, ALLEN & MAJOR ASSOCIATES, INC. MAY REMOVE ALL INDICATION OF THE DOCUMENT'S AUTHORSHIP ON THE MAGNETIC MEDIA. PRINTED REPRESENTATIONS OF THE DRAWINGS AND SPECIFICATIONS ISSUED SHALL BE THE ONLY RECORD COPIES OF ALLEN & MAJOR ASSOCIATES, INC.'S WORK PRODUCT.

SHEET No.

EXH-1



PREPARED BY:



ALLEN & MAJOR ASSOCIATES, INC.

civil & structural engineering ♦ land surveying
environmental consulting ♦ landscape architecture
www.allenmajor.com

100 COMMERCE WAY, SUITE 5
WOBURN MA 01801
TEL: (781) 935-6889
FAX: (781) 935-2896

WOBURN, MA ♦ LAKEVILLE, MA ♦ MANCHESTER, NH

PROJECT:

**ALTA AT RIVER'S EDGE
490 BOSTON POST ROAD
WAYLAND, MA**

Copyright © 2019 Allen & Major Associates, Inc.
All Rights Reserved

AERIAL PHOTO

PROJECT NO. 1670-09A DATE: OCTOBER 18, 2019


SCALE: 1"=250' DWG. NAME: C-1670-09A

DESIGNED BY: DMR CHECKED BY: CMQ

THIS DRAWING HAS BEEN PREPARED IN ELECTRONIC FORMAT. CLIENT/CLIENT'S REPRESENTATIVE OR CONSULTANT MAY BE PROVIDED COPIES OF DRAWINGS AND SPECIFICATIONS ON MAGNETIC MEDIA FOR HIS/HER INFORMATION AND USE FOR SPECIFIC APPLICATION TO THIS PROJECT. DUE TO THE POTENTIAL THAT THE MAGNETIC INFORMATION MAY BE MODIFIED UNINTENTIONALLY OR OTHERWISE, ALLEN & MAJOR ASSOCIATES, INC. MAY REMOVE ALL INDICATION OF THE DOCUMENT'S AUTHORSHIP ON THE MAGNETIC MEDIA. PRINTED REPRESENTATIONS OF THE DRAWINGS AND SPECIFICATIONS ISSUED SHALL BE THE ONLY RECORD COPIES OF ALLEN & MAJOR ASSOCIATES, INC.'S WORK PRODUCT.

SHEET No.

EXH-2

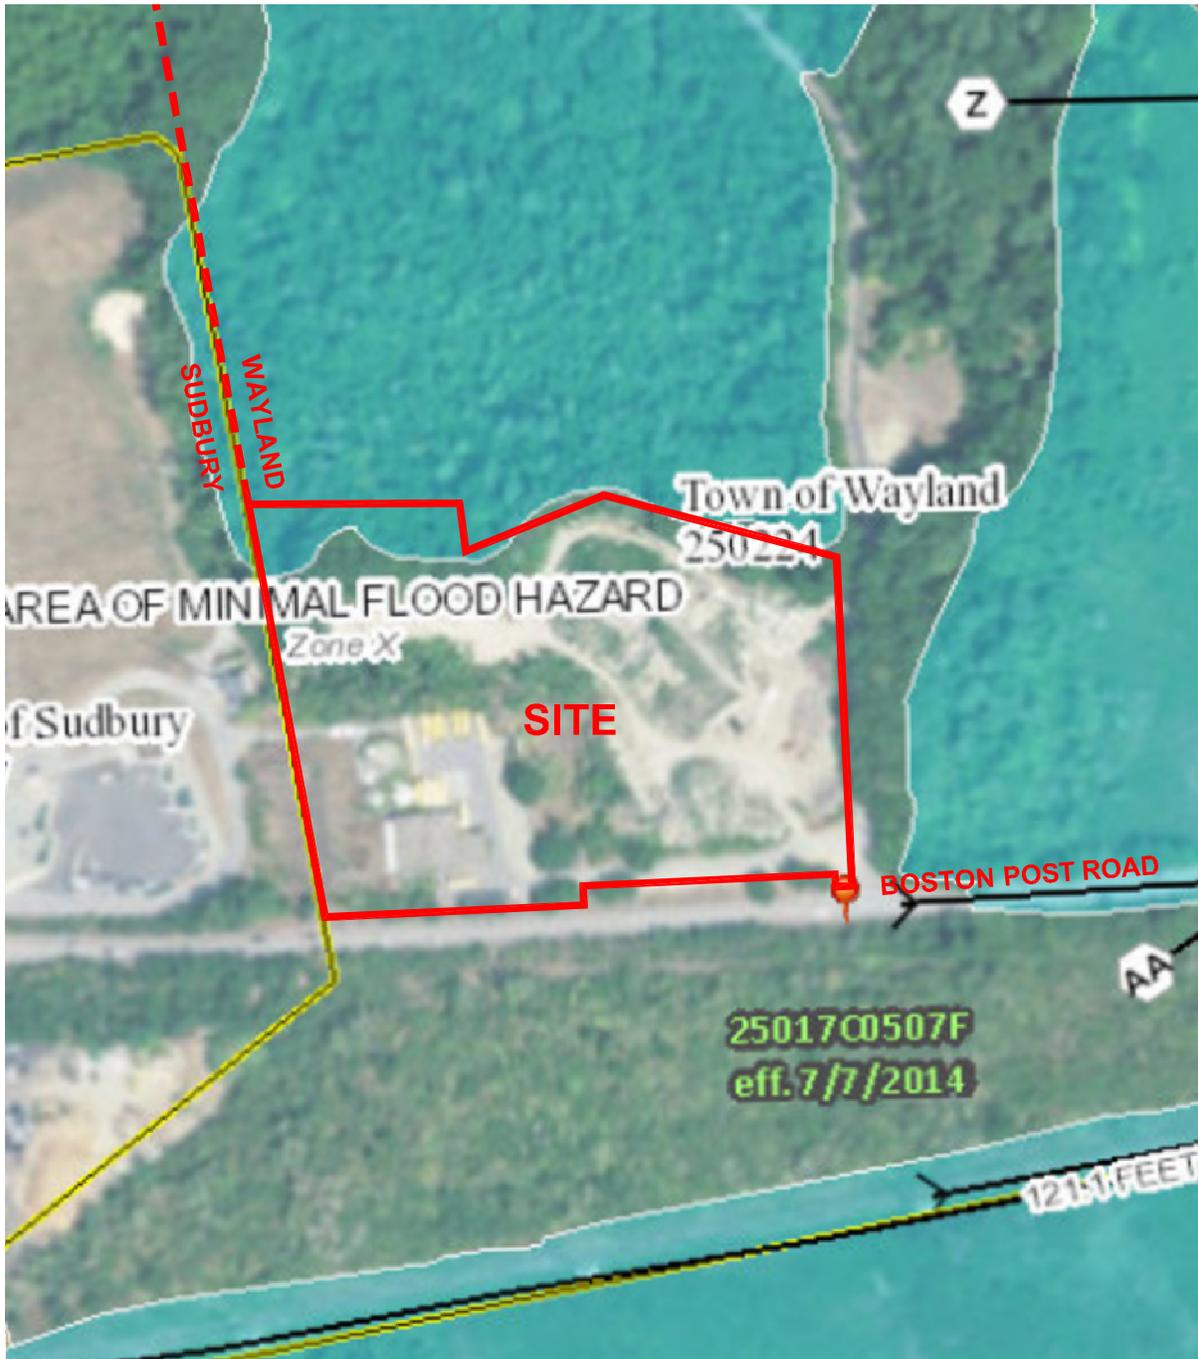

FEMA FLOOD INSURANCE RATE MAP
 MIDDLESEX COUNTY, MASSACHUSETTS
 MAP NUMBERS: 25017C0507F
 JULY 7, 2014

PREPARED BY:



ALLEN & MAJOR ASSOCIATES, INC.

civil & structural engineering ♦ land surveying
 environmental consulting ♦ landscape architecture
 www.allenmajor.com
 100 COMMERCE WAY, SUITE 5
 WOBURN MA 01801
 TEL: (781) 935-6889
 FAX: (781) 935-2896

WOBURN, MA ♦ LAKEVILLE, MA ♦ MANCHESTER, NH

PROJECT:

**ALTA AT RIVER'S EDGE
 490 BOSTON POST ROAD
 WAYLAND, MA**

Copyright © 2019 Allen & Major Associates, Inc.
 All Rights Reserved

FEMA FIRM MAP

PROJECT NO. 1670-09A	DATE: OCTOBER 18, 2019
SCALE: 1"=250'	DWG. NAME: C-1670-09A
DESIGNED BY: DMR	CHECKED BY: CMQ

THIS DRAWING HAS BEEN PREPARED IN ELECTRONIC FORMAT. CLIENT/CLIENT'S REPRESENTATIVE OR CONSULTANT MAY BE PROVIDED COPIES OF DRAWINGS AND SPECIFICATIONS ON MAGNETIC MEDIA FOR HIS/HER INFORMATION AND USE FOR SPECIFIC APPLICATION TO THIS PROJECT. DUE TO THE POTENTIAL THAT THE MAGNETIC INFORMATION MAY BE MODIFIED UNINTENTIONALLY OR OTHERWISE, ALLEN & MAJOR ASSOCIATES, INC. MAY REMOVE ALL INDICATION OF THE DOCUMENT'S AUTHORSHIP ON THE MAGNETIC MEDIA. PRINTED REPRESENTATIONS OF THE DRAWINGS AND SPECIFICATIONS ISSUED SHALL BE THE ONLY RECORD COPIES OF ALLEN & MAJOR ASSOCIATES, INC.'S WORK PRODUCT.

SHEET No.

EXH-3



LEGEND

-  Shrub Swamp
-  Tidal Flat
-  Wooded Swamp Coniferous
-  Wooded Swamp Deciduous
-  Wooded Swamp Mixed Trees

PREPARED BY:



ALLEN & MAJOR ASSOCIATES, INC.

civil & structural engineering ♦ land surveying
 environmental consulting ♦ landscape architecture
 www.allenmajor.com
 100 COMMERCE WAY, SUITE 5
 WOBURN MA 01801
 TEL: (781) 935-6889
 FAX: (781) 935-2896

WOBURN, MA ♦ LAKEVILLE, MA ♦ MANCHESTER, NH

PROJECT:

**ALTA AT RIVER'S EDGE
 490 BOSTON POST ROAD
 WAYLAND, MA**

Copyright © 2019 Allen & Major Associates, Inc.
 All Rights Reserved


MASS DEP WETLANDS

PROJECT NO. 1670-09A	DATE: OCTOBER 18, 2019
SCALE: 1"=250'	DWG. NAME: C-1670-09A
DESIGNED BY: DMR	CHECKED BY: CMQ

THIS DRAWING HAS BEEN PREPARED IN ELECTRONIC FORMAT. CLIENT/CLIENT'S REPRESENTATIVE OR CONSULTANT MAY BE PROVIDED COPIES OF DRAWINGS AND SPECIFICATIONS ON MAGNETIC MEDIA FOR HIS/HER INFORMATION AND USE FOR SPECIFIC APPLICATION TO THIS PROJECT. DUE TO THE POTENTIAL THAT THE MAGNETIC INFORMATION MAY BE MODIFIED UNINTENTIONALLY OR OTHERWISE, ALLEN & MAJOR ASSOCIATES, INC. MAY REMOVE ALL INDICATION OF THE DOCUMENT'S AUTHORSHIP ON THE MAGNETIC MEDIA. PRINTED REPRESENTATIONS OF THE DRAWINGS AND SPECIFICATIONS ISSUED SHALL BE THE ONLY RECORD COPIES OF ALLEN & MAJOR ASSOCIATES, INC.'S WORK PRODUCT.

SHEET No.

EXH-4

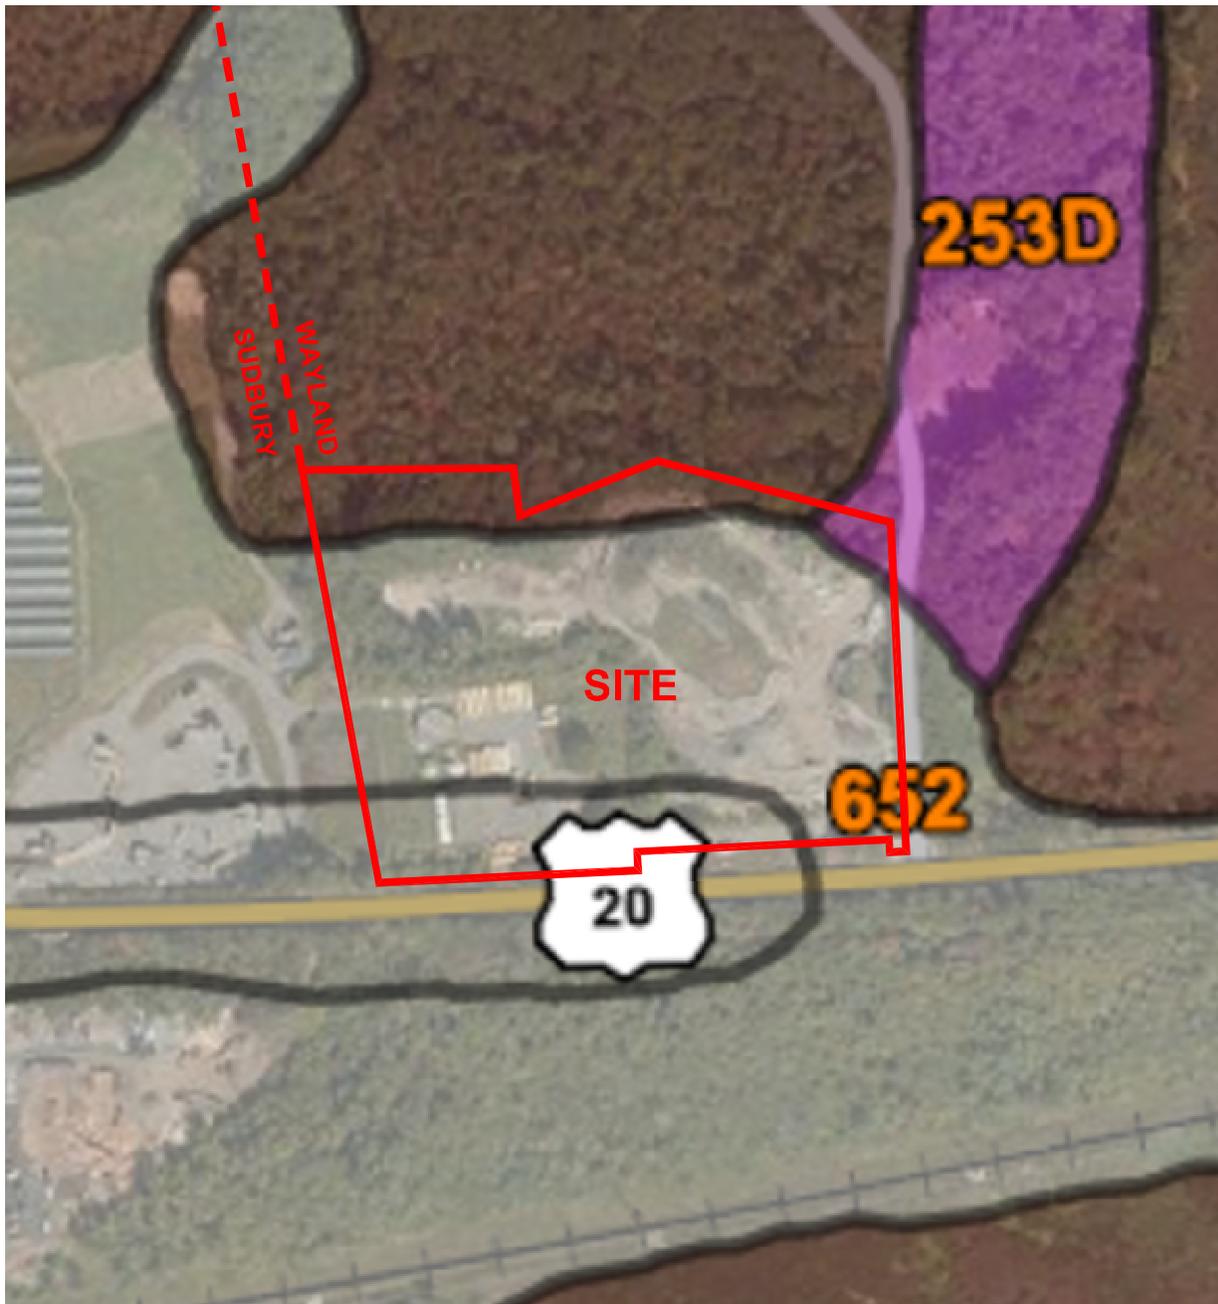

LEGEND:

- 51A: SWANSEA MUCK (HSG B/D)
- 253D: HINCKLEY LOAMY SAND; (HSG A)
- 652: UDORTHENTS; REFUSE SUBSTRATUM (ASSUMED HSG C)
- 656: UDORTHENTS-URBAN LAND COMPLEX (ASSUMED HSG C)

PREPARED BY:



ALLEN & MAJOR ASSOCIATES, INC.

civil & structural engineering ♦ land surveying
 environmental consulting ♦ landscape architecture
 www.allenmajor.com
 100 COMMERCE WAY, SUITE 5
 WOBURN MA 01801
 TEL: (781) 935-6889
 FAX: (781) 935-2896

WOBURN, MA ♦ LAKEVILLE, MA ♦ MANCHESTER, NH

PROJECT:

**ALTA AT RIVER'S EDGE
 490 BOSTON POST ROAD
 WAYLAND, MA**

Copyright © 2019 Allen & Major Associates, Inc.
 All Rights Reserved


SOILS MAP

PROJECT NO. 1670-09A	DATE: OCTOBER 18, 2019
SCALE: 1"=250'	DWG. NAME: C-1670-09A
DESIGNED BY: DMR	CHECKED BY: CMQ

THIS DRAWING HAS BEEN PREPARED IN ELECTRONIC FORMAT. CLIENT/CLIENT'S REPRESENTATIVE OR CONSULTANT MAY BE PROVIDED COPIES OF DRAWINGS AND SPECIFICATIONS ON MAGNETIC MEDIA FOR HIS/HER INFORMATION AND USE FOR SPECIFIC APPLICATION TO THIS PROJECT. DUE TO THE POTENTIAL THAT THE MAGNETIC INFORMATION MAY BE MODIFIED UNINTENTIONALLY OR OTHERWISE, ALLEN & MAJOR ASSOCIATES, INC. MAY REMOVE ALL INDICATION OF THE DOCUMENT'S AUTHORSHIP ON THE MAGNETIC MEDIA. PRINTED REPRESENTATIONS OF THE DRAWINGS AND SPECIFICATIONS ISSUED SHALL BE THE ONLY RECORD COPIES OF ALLEN & MAJOR ASSOCIATES, INC.'S WORK PRODUCT.

SHEET No.

EXH-5

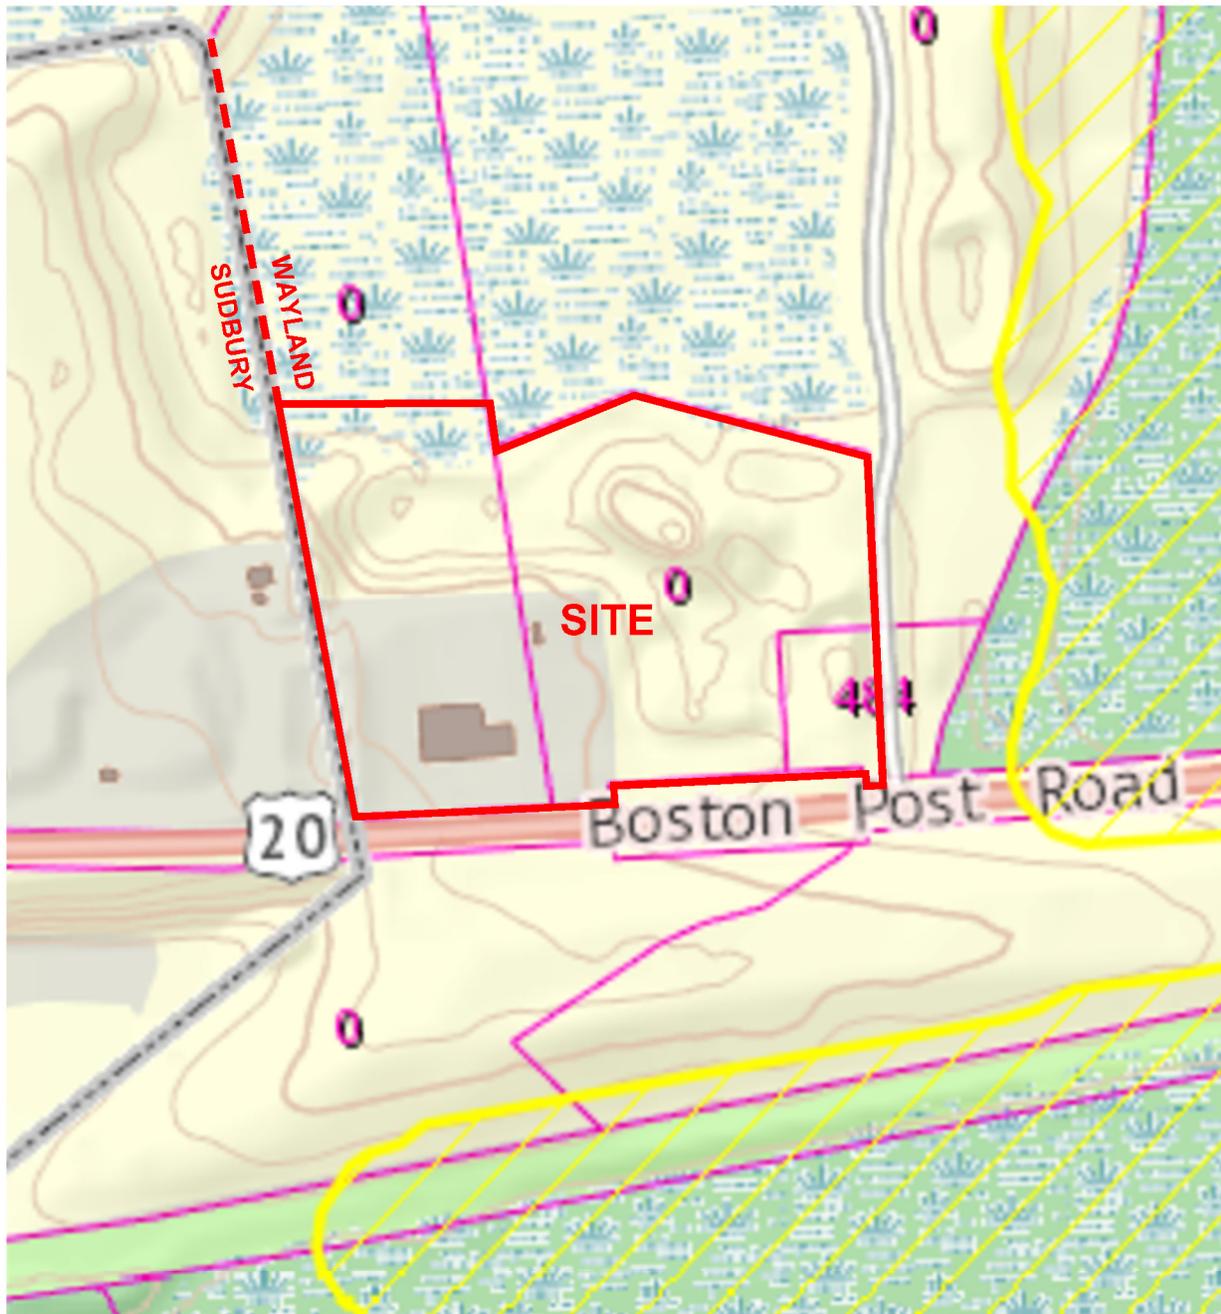

**NO NHESP PRIORITY HABITATS ON-SITE.
NHESP HABITAT PH-1463 LOCATED ON ADJACENT PROPERTIES.**

PREPARED BY:



**ALLEN & MAJOR
ASSOCIATES, INC.**

civil & structural engineering • land surveying
environmental consulting • landscape architecture
www.allenmajor.com
100 COMMERCE WAY, SUITE 5
WOBURN MA 01801
TEL: (781) 935-6889
FAX: (781) 935-2896

WOBURN, MA • LAKEVILLE, MA • MANCHESTER, NH

PROJECT:

**ALTA AT RIVER'S EDGE
490 BOSTON POST ROAD
WAYLAND, MA**

Copyright © 2019 Allen & Major Associates, Inc.
All Rights Reserved

NHESP PRIORITY HABITATS

PROJECT NO. 1670-09A DATE: OCTOBER 18, 2019

SCALE: NOT TO SCALE DWG. NAME: C-1670-09A

DESIGNED BY: DMR CHECKED BY: CMQ

THIS DRAWING HAS BEEN PREPARED IN ELECTRONIC FORMAT. CLIENT/CLIENT'S REPRESENTATIVE OR CONSULTANT MAY BE PROVIDED COPIES OF DRAWINGS AND SPECIFICATIONS ON MAGNETIC MEDIA FOR HIS/HER INFORMATION AND USE FOR SPECIFIC APPLICATION TO THIS PROJECT. DUE TO THE POTENTIAL THAT THE MAGNETIC INFORMATION MAY BE MODIFIED UNINTENTIONALLY OR OTHERWISE, ALLEN & MAJOR ASSOCIATES, INC. MAY REMOVE ALL INDICATION OF THE DOCUMENT'S AUTHORSHIP ON THE MAGNETIC MEDIA. PRINTED REPRESENTATIONS OF THE DRAWINGS AND SPECIFICATIONS ISSUED SHALL BE THE ONLY RECORD COPIES OF ALLEN & MAJOR ASSOCIATES, INC.'S WORK PRODUCT.

SHEET No.

EXH-6

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.


HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

Printed 10/17/2019

Page 2

Area Listing (all nodes)

Area (sq-ft)	CN	Description (subcatchment-numbers)
73,706	61	>75% Grass cover, Good, HSG B (E-1, E-2, E-3)
163,142	85	Gravel roads, HSG B (E-1, E-2, E-3)
10,637	98	Paved parking, HSG B (E-3)
34,321	98	Unconnected pavement, HSG B (E-2)
6,474	30	Woods, Good, HSG A (E-1)
72,517	55	Woods, Good, HSG B (E-1, E-2, E-3)
360,797	75	TOTAL AREA

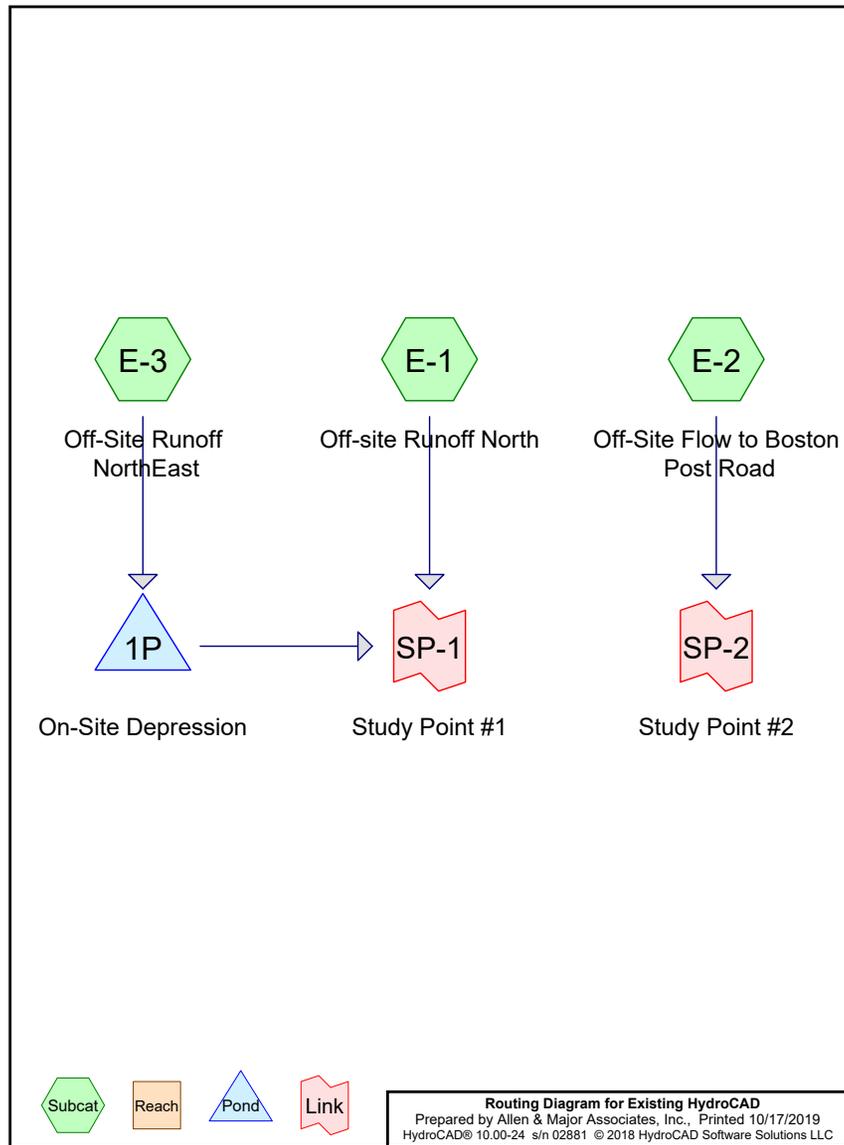

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge

Printed 10/17/2019
Page 3

Soil Listing (all nodes)

Area (sq-ft)	Soil Group	Subcatchment Numbers
6,474	HSG A	E-1
354,323	HSG B	E-1, E-2, E-3
0	HSG C	
0	HSG D	
0	Other	
360,797		TOTAL AREA

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge

Printed 10/17/2019
Page 4

Ground Covers (all nodes)

HSG-A (sq-ft)	HSG-B (sq-ft)	HSG-C (sq-ft)	HSG-D (sq-ft)	Other (sq-ft)	Total (sq-ft)	Ground Cover	Subcatchment Numbers
0	73,706	0	0	0	73,706	>75% Grass cover, Good	E-1, E-2, E-3
0	163,142	0	0	0	163,142	Gravel roads	E-1, E-2, E-3
0	10,637	0	0	0	10,637	Paved parking	E-3
0	34,321	0	0	0	34,321	Unconnected pavement	E-2
6,474	72,517	0	0	0	78,991	Woods, Good	E-1, E-2, E-3
6,474	354,323	0	0	0	360,797	TOTAL AREA	

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
 HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge

Printed 10/17/2019
 Page 5

Pipe Listing (all nodes)

Line#	Node Number	In-Invert (feet)	Out-Invert (feet)	Length (feet)	Slope (ft/ft)	n	Diam/Width (inches)	Height (inches)	Inside-Fill (inches)
1	E-1	0.00	0.00	204.0	0.0180	0.011	24.0	0.0	0.0

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
 HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
 Type III 24-hr 1-INCH Rainfall=1.00"

Printed 10/17/2019
 Page 6

Time span=0.00-30.00 hrs, dt=0.05 hrs, 601 points
 Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
 Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment E-1: Off-site Runoff North	Runoff Area=101,320 sf 0.00% Impervious Runoff Depth=0.01" Flow Length=371' Tc=7.3 min CN=71 Runoff=0.00 cfs 66 cf
Subcatchment E-2: Off-Site Flow to Boston Post Road	Runoff Area=137,008 sf 25.05% Impervious Runoff Depth=0.03" Flow Length=699' Tc=9.4 min UJ Adjusted CN=75 Runoff=0.01 cfs 346 cf
Subcatchment E-3: Off-Site Runoff NorthEast	Runoff Area=122,469 sf 8.69% Impervious Runoff Depth=0.02" Tc=6.0 min CN=74 Runoff=0.01 cfs 237 cf
Pond 1P: On-Site Depression	Peak Elev=125.04' Storage=235 cf Inflow=0.01 cfs 237 cf Outflow=0.00 cfs 0 cf
Link SP-1: Study Point #1	Inflow=0.00 cfs 66 cf Primary=0.00 cfs 66 cf
Link SP-2: Study Point #2	Inflow=0.01 cfs 346 cf Primary=0.01 cfs 346 cf
Total Runoff Area = 360,797 sf Runoff Volume = 649 cf Average Runoff Depth = 0.02"	
87.54% Pervious = 315,839 sf 12.46% Impervious = 44,958 sf	

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 9

Summary for Subcatchment E-2: Off-Site Flow to Boston Post Road

Runoff = 0.01 cfs @ 13.82 hrs, Volume= 346 cf, Depth= 0.03"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 1-INCH Rainfall=1.00"

Area (sf)	CN	Adj	Description
34,321	98		Unconnected pavement, HSG B
46,464	85		Gravel roads, HSG B
48,445	61		>75% Grass cover, Good, HSG B
7,778	55		Woods, Good, HSG B
137,008	78	75	Weighted Average, UI Adjusted
102,687			74.95% Pervious Area
34,321			25.05% Impervious Area
34,321			100.00% Unconnected


Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0	50	0.0450	0.14		Sheet Flow, Grass: Dense n= 0.240 P2= 3.16"
1.2	98	0.0690	1.31		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
2.2	551	0.0420	4.16		Shallow Concentrated Flow, Paved Kv= 20.3 fps
9.4	699	Total			

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 10

Subcatchment E-2: Off-Site Flow to Boston Post Road

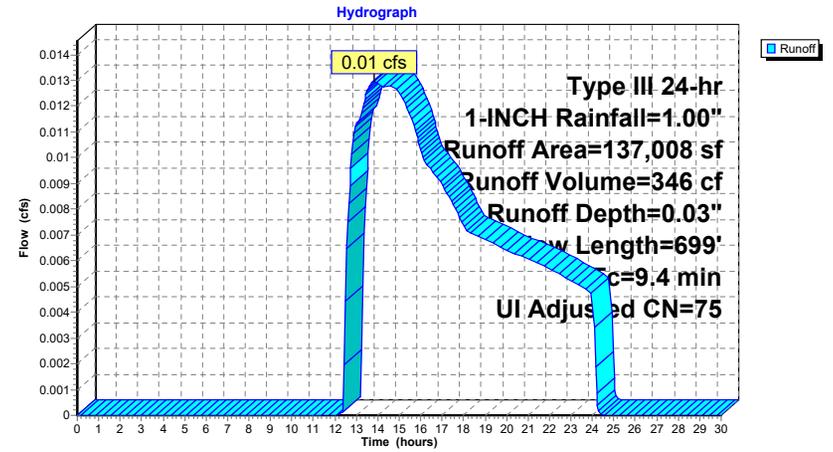

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 11

Summary for Subcatchment E-3: Off-Site Runoff NorthEast

Tc of 4.6 rounds to minimum of 5.0. Use Tc = 5.0 minutes for E-2.


Runoff = 0.01 cfs @ 14.78 hrs, Volume= 237 cf, Depth= 0.02"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 1-INCH Rainfall=1.00"

Area (sf)	CN	Description
10,637	98	Paved parking, HSG B
58,026	85	Gravel roads, HSG B
23,462	61	>75% Grass cover, Good, HSG B
30,344	55	Woods, Good, HSG B
122,469	74	Weighted Average
111,832		91.31% Pervious Area
10,637		8.69% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc

Subcatchment E-3: Off-Site Runoff NorthEast

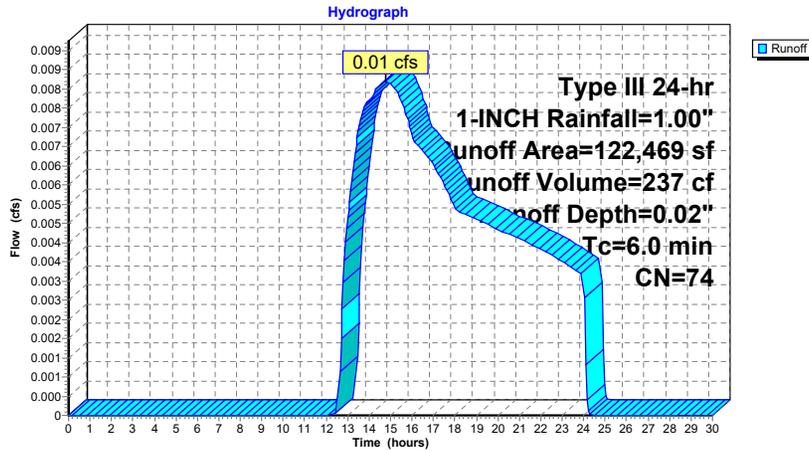

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 12

Summary for Pond 1P: On-Site Depression

Inflow Area = 122,469 sf, 8.69% Impervious, Inflow Depth = 0.02" for 1-INCH event
Inflow = 0.01 cfs @ 14.78 hrs, Volume= 237 cf
Outflow = 0.00 cfs @ 0.00 hrs, Volume= 0 cf, Atten= 100%, Lag= 0.0 min
Primary = 0.00 cfs @ 0.00 hrs, Volume= 0 cf

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Peak Elev= 125.04' @ 24.40 hrs Surf.Area= 5,910 sf Storage= 235 cf

Plug-Flow detention time= (not calculated: initial storage exceeds outflow)
Center-of-Mass det. time= (not calculated: no outflow)

Volume	Invert	Avail.Storage	Storage Description		
#1	125.00'	74,276 cf	Custom Stage Data (Irregular) Listed below (Recalc)		
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
125.00	5,573	547.9	0	0	5,573
126.00	16,635	762.0	10,612	10,612	27,900
127.00	19,483	823.9	18,040	28,652	35,752
128.00	22,540	960.8	20,993	49,645	55,215
129.00	26,782	825.3	24,631	74,276	74,495

Device	Routing	Invert	Outlet Devices
#1	Primary	129.00'	Custom Weir/Orifice, Cv= 2.62 (C= 3.28) Head (feet) 0.00 1.00 Width (feet) 73.00 113.50

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=125.00' (Free Discharge)
1=Custom Weir/Orifice (Controls 0.00 cfs)

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 15


Summary for Link SP-2: Study Point #2

Inflow Area = 137,008 sf, 25.05% Impervious, Inflow Depth = 0.03" for 1-INCH event
Inflow = 0.01 cfs @ 13.82 hrs, Volume= 346 cf
Primary = 0.01 cfs @ 13.82 hrs, Volume= 346 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs

Link SP-2: Study Point #2

Hydrograph

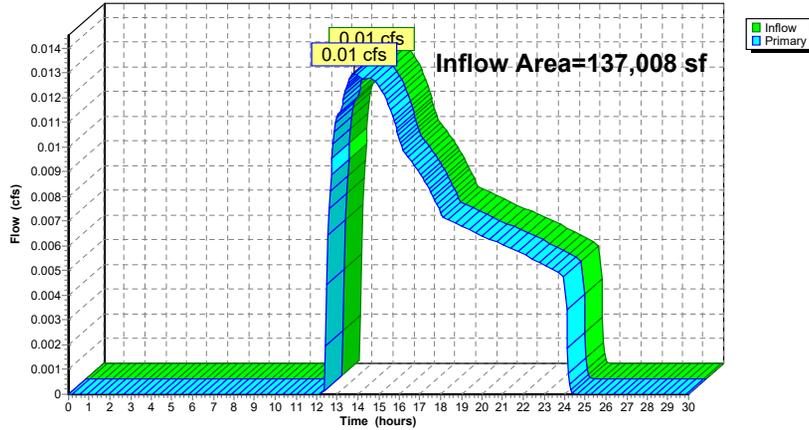

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 16

Time span=0.00-30.00 hrs, dt=0.05 hrs, 601 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment E-1: Off-site Runoff North Runoff Area=101,320 sf 0.00% Impervious Runoff Depth=0.93"
Flow Length=371' Tc=7.3 min CN=71 Runoff=2.18 cfs 7,823 cf

Subcatchment E-2: Off-Site Flow to Boston Post Road Runoff Area=137,008 sf 25.05% Impervious Runoff Depth=1.15"
Flow Length=699' Tc=9.4 min UI Adjusted CN=75 Runoff=3.57 cfs 13,112 cf

Subcatchment E-3: Off-Site Runoff NorthEast Runoff Area=122,469 sf 8.69% Impervious Runoff Depth=1.09"
Tc=6.0 min CN=74 Runoff=3.37 cfs 11,130 cf

Pond 1P: On-Site Depression Peak Elev=126.03' Storage=11,129 cf Inflow=3.37 cfs 11,130 cf
Outflow=0.00 cfs 0 cf

Link SP-1: Study Point #1 Inflow=2.18 cfs 7,823 cf
Primary=2.18 cfs 7,823 cf

Link SP-2: Study Point #2 Inflow=3.57 cfs 13,112 cf
Primary=3.57 cfs 13,112 cf

Total Runoff Area = 360,797 sf Runoff Volume = 32,066 cf Average Runoff Depth = 1.07"
87.54% Pervious = 315,839 sf 12.46% Impervious = 44,958 sf

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 17

Summary for Subcatchment E-1: Off-site Runoff North

Runoff = 2.18 cfs @ 12.12 hrs, Volume= 7,823 cf, Depth= 0.93"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 2-Year Rainfall=3.28"

Area (sf)	CN	Description
58,652	85	Gravel roads, HSG B
1,799	61	>75% Grass cover, Good, HSG B
6,474	30	Woods, Good, HSG A
34,395	55	Woods, Good, HSG B
101,320	71	Weighted Average
101,320		100.00% Pervious Area


Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.7	50	0.0200	0.15		Sheet Flow, A-B Grass: Short n= 0.150 P2= 3.16"
0.4	42	0.0700	1.85		Shallow Concentrated Flow, B-C Short Grass Pasture Kv= 7.0 fps
0.0	6	0.0200	2.87		Shallow Concentrated Flow, C-D Paved Kv= 20.3 fps
0.8	47	0.0200	0.99		Shallow Concentrated Flow, D-E Short Grass Pasture Kv= 7.0 fps
0.3	204	0.0180	11.42	35.87	Pipe Channel, E-F 24.0" Round Area= 3.1 sf Perim= 6.3' r= 0.50' n= 0.011 Concrete pipe, straight & clean
0.1	22	0.4500	3.35		Shallow Concentrated Flow, F-G Woodland Kv= 5.0 fps
7.3	371	Total			

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 18

Subcatchment E-1: Off-site Runoff North

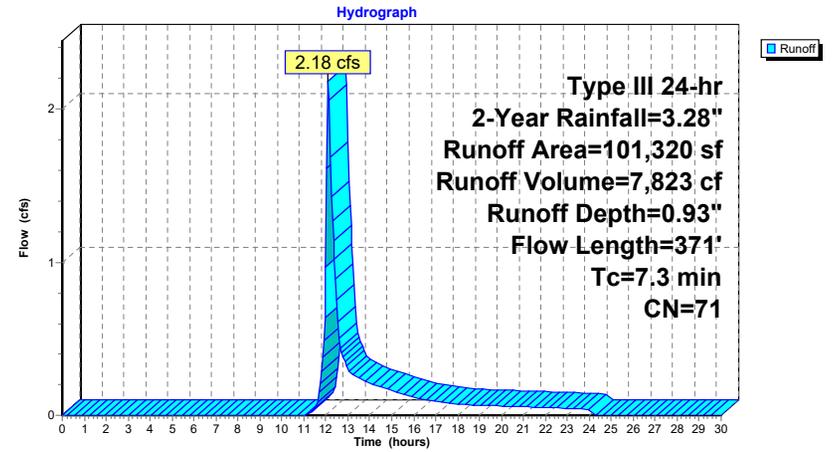

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 19

Summary for Subcatchment E-2: Off-Site Flow to Boston Post Road

Runoff = 3.57 cfs @ 12.15 hrs, Volume= 13,112 cf, Depth= 1.15"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 2-Year Rainfall=3.28"

Area (sf)	CN	Adj	Description
34,321	98		Unconnected pavement, HSG B
46,464	85		Gravel roads, HSG B
48,445	61		>75% Grass cover, Good, HSG B
7,778	55		Woods, Good, HSG B
137,008	78	75	Weighted Average, UI Adjusted
102,687			74.95% Pervious Area
34,321			25.05% Impervious Area
34,321			100.00% Unconnected


Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0	50	0.0450	0.14		Sheet Flow, Grass: Dense n= 0.240 P2= 3.16"
1.2	98	0.0690	1.31		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
2.2	551	0.0420	4.16		Shallow Concentrated Flow, Paved Kv= 20.3 fps
9.4	699	Total			

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 20

Subcatchment E-2: Off-Site Flow to Boston Post Road

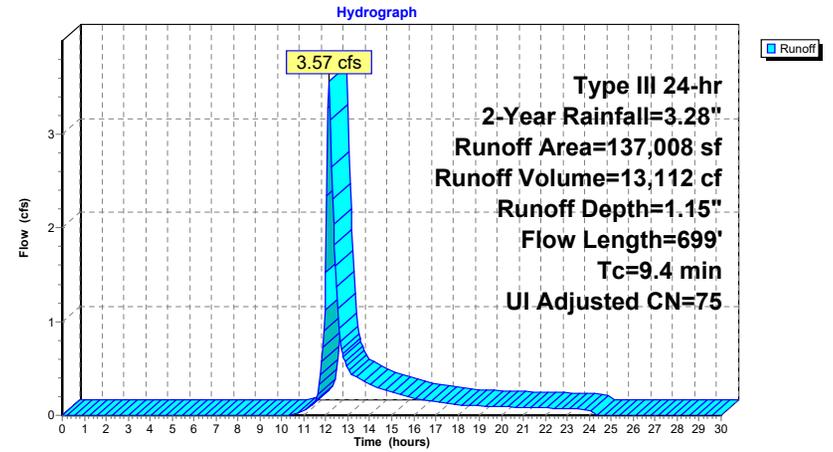

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 21

Summary for Subcatchment E-3: Off-Site Runoff NorthEast

Tc of 4.6 rounds to minimum of 5.0. Use Tc = 5.0 minutes for E-2.


Runoff = 3.37 cfs @ 12.10 hrs, Volume= 11,130 cf, Depth= 1.09"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 2-Year Rainfall=3.28"

Area (sf)	CN	Description
10,637	98	Paved parking, HSG B
58,026	85	Gravel roads, HSG B
23,462	61	>75% Grass cover, Good, HSG B
30,344	55	Woods, Good, HSG B
122,469	74	Weighted Average
111,832		91.31% Pervious Area
10,637		8.69% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc

Subcatchment E-3: Off-Site Runoff NorthEast

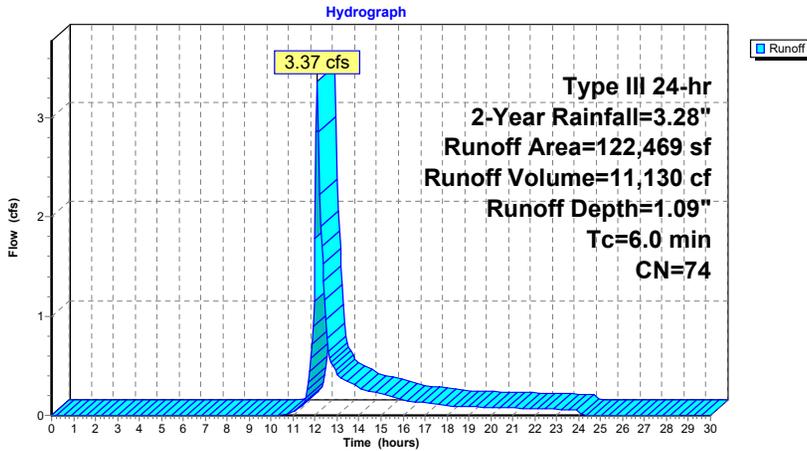

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 22

Summary for Pond 1P: On-Site Depression

Inflow Area = 122,469 sf, 8.69% Impervious, Inflow Depth = 1.09" for 2-Year event
 Inflow = 3.37 cfs @ 12.10 hrs, Volume= 11,130 cf
 Outflow = 0.00 cfs @ 0.00 hrs, Volume= 0 cf, Atten= 100%, Lag= 0.0 min
 Primary = 0.00 cfs @ 0.00 hrs, Volume= 0 cf

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
 Peak Elev= 126.03' @ 24.40 hrs Surf.Area= 16,720 sf Storage= 11,129 cf

Plug-Flow detention time= (not calculated: initial storage exceeds outflow)
 Center-of-Mass det. time= (not calculated: no outflow)

Volume	Invert	Avail.Storage	Storage Description
#1	125.00'	74,276 cf	Custom Stage Data (Irregular) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
125.00	5,573	547.9	0	0	5,573
126.00	16,635	762.0	10,612	10,612	27,900
127.00	19,483	823.9	18,040	28,652	35,752
128.00	22,540	960.8	20,993	49,645	55,215
129.00	26,782	825.3	24,631	74,276	74,495

Device	Routing	Invert	Outlet Devices
#1	Primary	129.00'	Custom Weir/Orifice, Cv= 2.62 (C= 3.28) Head (feet) 0.00 1.00 Width (feet) 73.00 113.50


Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=125.00' (Free Discharge)
 1=Custom Weir/Orifice (Controls 0.00 cfs)

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 23

Pond 1P: On-Site Depression

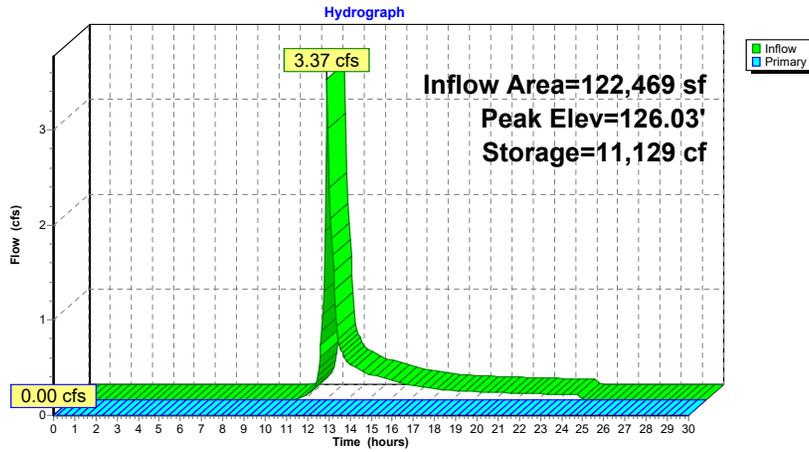

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC


ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 24

Summary for Link SP-1: Study Point #1

Inflow Area = 223,789 sf, 4.75% Impervious, Inflow Depth = 0.42" for 2-Year event
Inflow = 2.18 cfs @ 12.12 hrs, Volume= 7,823 cf
Primary = 2.18 cfs @ 12.12 hrs, Volume= 7,823 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs

Link SP-1: Study Point #1

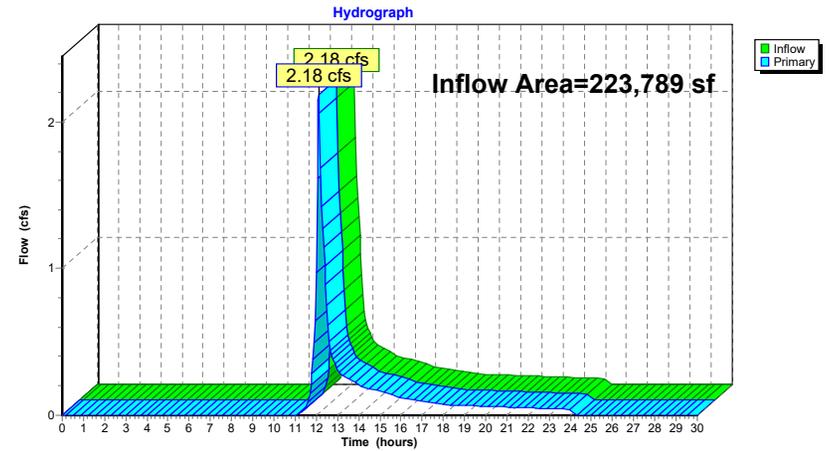

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
 HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC


ALTA at River's Edge
 Type III 24-hr 2-Year Rainfall=3.28"
 Printed 10/17/2019
 Page 25

Summary for Link SP-2: Study Point #2

Inflow Area = 137,008 sf, 25.05% Impervious, Inflow Depth = 1.15" for 2-Year event
 Inflow = 3.57 cfs @ 12.15 hrs, Volume= 13,112 cf
 Primary = 3.57 cfs @ 12.15 hrs, Volume= 13,112 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs

Link SP-2: Study Point #2

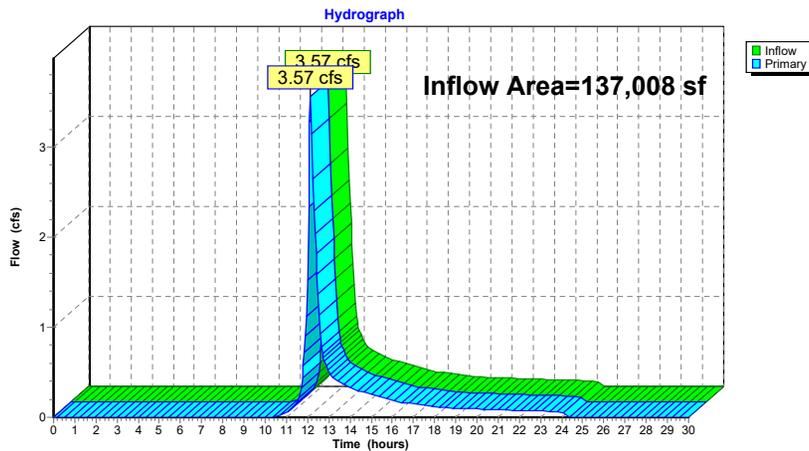

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
 HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
 Type III 24-hr 10-Year Rainfall=5.11"
 Printed 10/17/2019
 Page 26

Time span=0.00-30.00 hrs, dt=0.05 hrs, 601 points
 Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
 Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment E-1: Off-site Runoff North

Runoff Area=101,320 sf 0.00% Impervious Runoff Depth=2.20"
 Flow Length=371' Tc=7.3 min CN=71 Runoff=5.59 cfs 18,575 cf

Subcatchment E-2: Off-Site Flow to Boston Post Road

Runoff Area=137,008 sf 25.05% Impervious Runoff Depth=2.54"
 Flow Length=699' Tc=9.4 min UI Adjusted CN=75 Runoff=8.19 cfs 28,986 cf

Subcatchment E-3: Off-Site Runoff NorthEast

Runoff Area=122,469 sf 8.69% Impervious Runoff Depth=2.45"
 Tc=6.0 min CN=74 Runoff=7.90 cfs 25,028 cf

Pond 1P: On-Site Depression

Peak Elev=126.81' Storage=25,027 cf Inflow=7.90 cfs 25,028 cf
 Outflow=0.00 cfs 0 cf

Link SP-1: Study Point #1

Inflow=5.59 cfs 18,575 cf
 Primary=5.59 cfs 18,575 cf

Link SP-2: Study Point #2

Inflow=8.19 cfs 28,986 cf
 Primary=8.19 cfs 28,986 cf

Total Runoff Area = 360,797 sf Runoff Volume = 72,589 cf Average Runoff Depth = 2.41"
 87.54% Pervious = 315,839 sf 12.46% Impervious = 44,958 sf

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 27

Summary for Subcatchment E-1: Off-site Runoff North

Runoff = 5.59 cfs @ 12.11 hrs, Volume= 18,575 cf, Depth= 2.20"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 10-Year Rainfall=5.11"

Area (sf)	CN	Description
58,652	85	Gravel roads, HSG B
1,799	61	>75% Grass cover, Good, HSG B
6,474	30	Woods, Good, HSG A
34,395	55	Woods, Good, HSG B
101,320	71	Weighted Average
101,320		100.00% Pervious Area


Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.7	50	0.0200	0.15		Sheet Flow, A-B Grass: Short n= 0.150 P2= 3.16"
0.4	42	0.0700	1.85		Shallow Concentrated Flow, B-C Short Grass Pasture Kv= 7.0 fps
0.0	6	0.0200	2.87		Shallow Concentrated Flow, C-D Paved Kv= 20.3 fps
0.8	47	0.0200	0.99		Shallow Concentrated Flow, D-E Short Grass Pasture Kv= 7.0 fps
0.3	204	0.0180	11.42	35.87	Pipe Channel, E-F 24.0" Round Area= 3.1 sf Perim= 6.3' r= 0.50' n= 0.011 Concrete pipe, straight & clean
0.1	22	0.4500	3.35		Shallow Concentrated Flow, F-G Woodland Kv= 5.0 fps
7.3	371	Total			

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 28

Subcatchment E-1: Off-site Runoff North

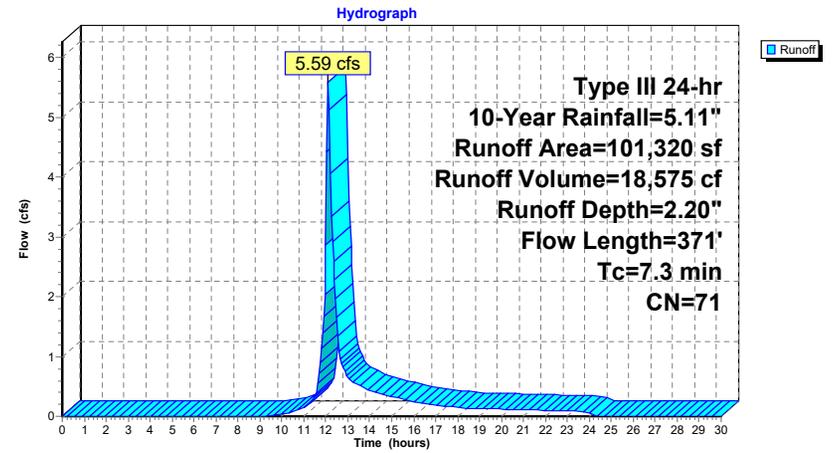

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
 HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
 Type III 24-hr 10-Year Rainfall=5.11"
 Printed 10/17/2019
 Page 29

Summary for Subcatchment E-2: Off-Site Flow to Boston Post Road

Runoff = 8.19 cfs @ 12.14 hrs, Volume= 28,986 cf, Depth= 2.54"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10-Year Rainfall=5.11"

Area (sf)	CN	Adj	Description
34,321	98		Unconnected pavement, HSG B
46,464	85		Gravel roads, HSG B
48,445	61		>75% Grass cover, Good, HSG B
7,778	55		Woods, Good, HSG B
137,008	78	75	Weighted Average, UI Adjusted
102,687			74.95% Pervious Area
34,321			25.05% Impervious Area
34,321			100.00% Unconnected


Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0	50	0.0450	0.14		Sheet Flow, Grass: Dense n= 0.240 P2= 3.16"
1.2	98	0.0690	1.31		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
2.2	551	0.0420	4.16		Shallow Concentrated Flow, Paved Kv= 20.3 fps
9.4	699	Total			

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
 HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
 Type III 24-hr 10-Year Rainfall=5.11"
 Printed 10/17/2019
 Page 30

Subcatchment E-2: Off-Site Flow to Boston Post Road

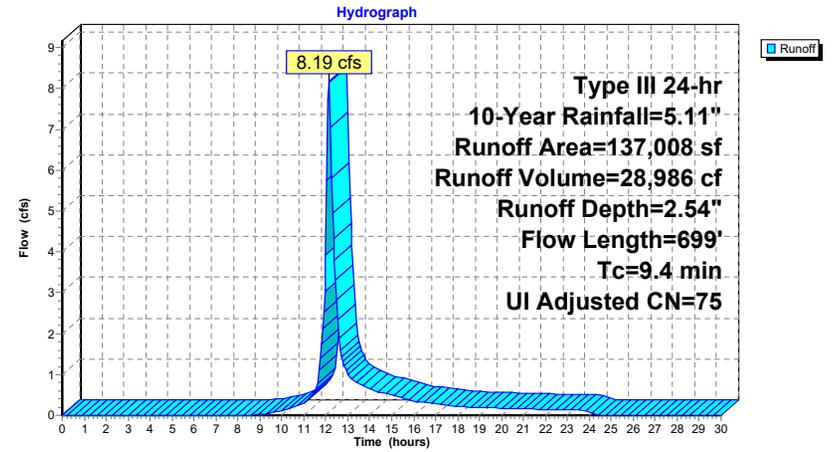

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 31

Summary for Subcatchment E-3: Off-Site Runoff NorthEast

Tc of 4.6 rounds to minimum of 5.0. Use Tc = 5.0 minutes for E-2.


Runoff = 7.90 cfs @ 12.09 hrs, Volume= 25,028 cf, Depth= 2.45"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 10-Year Rainfall=5.11"

Area (sf)	CN	Description
10,637	98	Paved parking, HSG B
58,026	85	Gravel roads, HSG B
23,462	61	>75% Grass cover, Good, HSG B
30,344	55	Woods, Good, HSG B
122,469	74	Weighted Average
111,832		91.31% Pervious Area
10,637		8.69% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc

Subcatchment E-3: Off-Site Runoff NorthEast

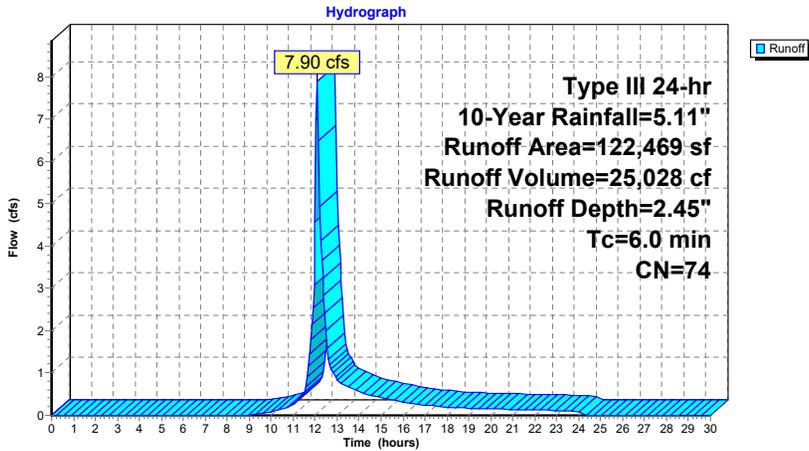

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 32

Summary for Pond 1P: On-Site Depression

Inflow Area = 122,469 sf, 8.69% Impervious, Inflow Depth = 2.45" for 10-Year event
Inflow = 7.90 cfs @ 12.09 hrs, Volume= 25,028 cf
Outflow = 0.00 cfs @ 0.00 hrs, Volume= 0 cf, Atten= 100%, Lag= 0.0 min
Primary = 0.00 cfs @ 0.00 hrs, Volume= 0 cf

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Peak Elev= 126.81' @ 24.40 hrs Surf.Area= 18,928 sf Storage= 25,027 cf

Plug-Flow detention time= (not calculated: initial storage exceeds outflow)
Center-of-Mass det. time= (not calculated: no outflow)

Volume	Invert	Avail.Storage	Storage Description
#1	125.00'	74,276 cf	Custom Stage Data (Irregular) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
125.00	5,573	547.9	0	0	5,573
126.00	16,635	762.0	10,612	10,612	27,900
127.00	19,483	823.9	18,040	28,652	35,752
128.00	22,540	960.8	20,993	49,645	55,215
129.00	26,782	825.3	24,631	74,276	74,495

Device	Routing	Invert	Outlet Devices
#1	Primary	129.00'	Custom Weir/Orifice, Cv= 2.62 (C= 3.28) Head (feet) 0.00 1.00 Width (feet) 73.00 113.50


Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=125.00' (Free Discharge)
1=Custom Weir/Orifice (Controls 0.00 cfs)

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 33

Pond 1P: On-Site Depression

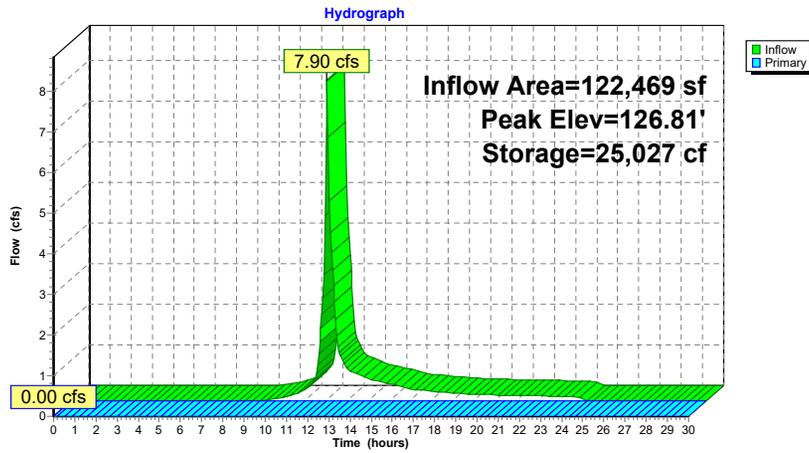

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC


ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 34

Summary for Link SP-1: Study Point #1

Inflow Area = 223,789 sf, 4.75% Impervious, Inflow Depth = 1.00" for 10-Year event
Inflow = 5.59 cfs @ 12.11 hrs, Volume= 18,575 cf
Primary = 5.59 cfs @ 12.11 hrs, Volume= 18,575 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs

Link SP-1: Study Point #1

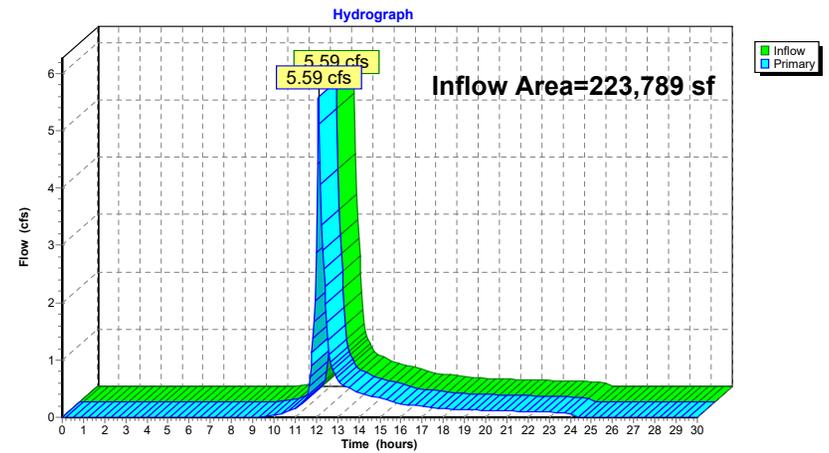

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
 HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
 Type III 24-hr 10-Year Rainfall=5.11"
 Printed 10/17/2019
 Page 35


Summary for Link SP-2: Study Point #2

Inflow Area = 137,008 sf, 25.05% Impervious, Inflow Depth = 2.54" for 10-Year event
 Inflow = 8.19 cfs @ 12.14 hrs, Volume= 28,986 cf
 Primary = 8.19 cfs @ 12.14 hrs, Volume= 28,986 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs

Link SP-2: Study Point #2

Hydrograph

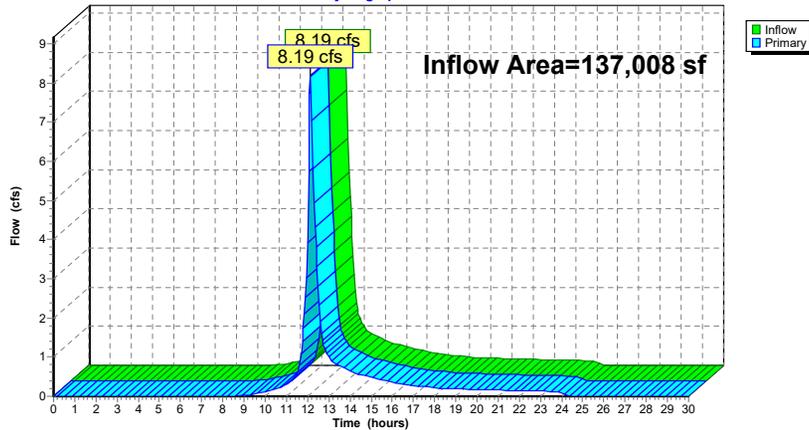

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
 HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
 Type III 24-hr 100-Year Rainfall=8.02"
 Printed 10/17/2019
 Page 36

Time span=0.00-30.00 hrs, dt=0.05 hrs, 601 points
 Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
 Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment E-1: Off-site Runoff North

Runoff Area=101,320 sf 0.00% Impervious Runoff Depth=4.60"
 Flow Length=371' Tc=7.3 min CN=71 Runoff=11.84 cfs 38,811 cf

Subcatchment E-2: Off-Site Flow to Boston Post Road

Runoff Area=137,008 sf 25.05% Impervious Runoff Depth=5.06"
 Flow Length=699' Tc=9.4 min UI Adjusted CN=75 Runoff=16.29 cfs 57,768 cf

Subcatchment E-3: Off-Site Runoff NorthEast

Runoff Area=122,469 sf 8.69% Impervious Runoff Depth=4.94"
 Tc=6.0 min CN=74 Runoff=15.92 cfs 50,453 cf

Pond 1P: On-Site Depression

Peak Elev=128.04' Storage=50,452 cf Inflow=15.92 cfs 50,453 cf
 Outflow=0.00 cfs 0 cf

Link SP-1: Study Point #1

Inflow=11.84 cfs 38,811 cf
 Primary=11.84 cfs 38,811 cf

Link SP-2: Study Point #2

Inflow=16.29 cfs 57,768 cf
 Primary=16.29 cfs 57,768 cf

Total Runoff Area = 360,797 sf Runoff Volume = 147,032 cf Average Runoff Depth = 4.89"
 87.54% Pervious = 315,839 sf 12.46% Impervious = 44,958 sf

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 37

Summary for Subcatchment E-1: Off-site Runoff North

Runoff = 11.84 cfs @ 12.11 hrs, Volume= 38,811 cf, Depth= 4.60"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 100-Year Rainfall=8.02"

Area (sf)	CN	Description
58,652	85	Gravel roads, HSG B
1,799	61	>75% Grass cover, Good, HSG B
6,474	30	Woods, Good, HSG A
34,395	55	Woods, Good, HSG B
101,320	71	Weighted Average
101,320		100.00% Pervious Area


Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.7	50	0.0200	0.15		Sheet Flow, A-B Grass: Short n= 0.150 P2= 3.16"
0.4	42	0.0700	1.85		Shallow Concentrated Flow, B-C Short Grass Pasture Kv= 7.0 fps
0.0	6	0.0200	2.87		Shallow Concentrated Flow, C-D Paved Kv= 20.3 fps
0.8	47	0.0200	0.99		Shallow Concentrated Flow, D-E Short Grass Pasture Kv= 7.0 fps
0.3	204	0.0180	11.42	35.87	Pipe Channel, E-F 24.0" Round Area= 3.1 sf Perim= 6.3' r= 0.50' n= 0.011 Concrete pipe, straight & clean
0.1	22	0.4500	3.35		Shallow Concentrated Flow, F-G Woodland Kv= 5.0 fps
7.3	371	Total			

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 38

Subcatchment E-1: Off-site Runoff North

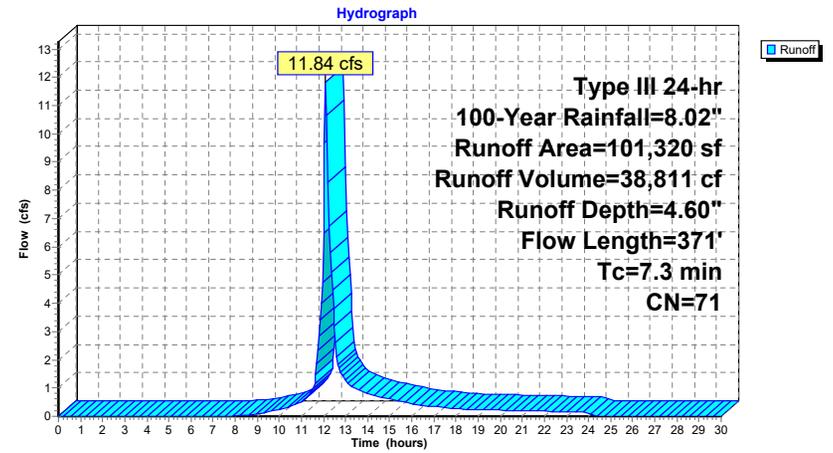

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 39

Summary for Subcatchment E-2: Off-Site Flow to Boston Post Road

Runoff = 16.29 cfs @ 12.13 hrs, Volume= 57,768 cf, Depth= 5.06"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 100-Year Rainfall=8.02"

Area (sf)	CN	Adj	Description
34,321	98		Unconnected pavement, HSG B
46,464	85		Gravel roads, HSG B
48,445	61		>75% Grass cover, Good, HSG B
7,778	55		Woods, Good, HSG B
137,008	78	75	Weighted Average, UI Adjusted
102,687			74.95% Pervious Area
34,321			25.05% Impervious Area
34,321			100.00% Unconnected


Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0	50	0.0450	0.14		Sheet Flow, Grass: Dense n= 0.240 P2= 3.16"
1.2	98	0.0690	1.31		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
2.2	551	0.0420	4.16		Shallow Concentrated Flow, Paved Kv= 20.3 fps
9.4	699	Total			

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 40

Subcatchment E-2: Off-Site Flow to Boston Post Road

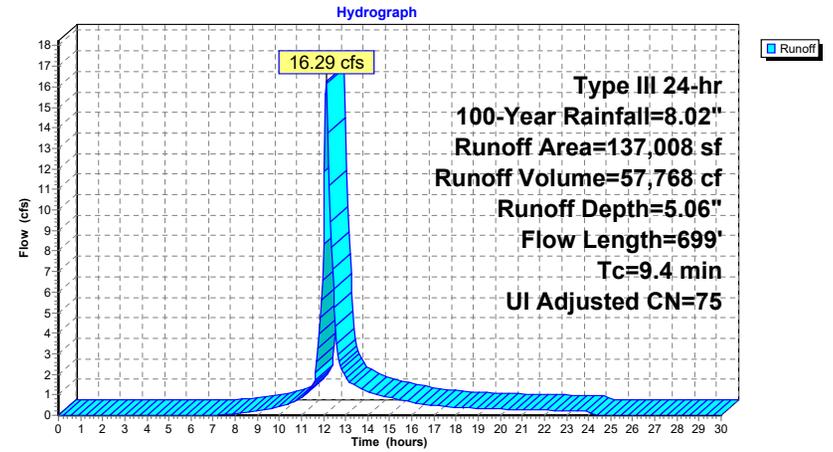

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 41

Summary for Subcatchment E-3: Off-Site Runoff NorthEast

Tc of 4.6 rounds to minimum of 5.0. Use Tc = 5.0 minutes for E-2.


Runoff = 15.92 cfs @ 12.09 hrs, Volume= 50,453 cf, Depth= 4.94"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 100-Year Rainfall=8.02"

Area (sf)	CN	Description
10,637	98	Paved parking, HSG B
58,026	85	Gravel roads, HSG B
23,462	61	>75% Grass cover, Good, HSG B
30,344	55	Woods, Good, HSG B
122,469	74	Weighted Average
111,832		91.31% Pervious Area
10,637		8.69% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc

Subcatchment E-3: Off-Site Runoff NorthEast

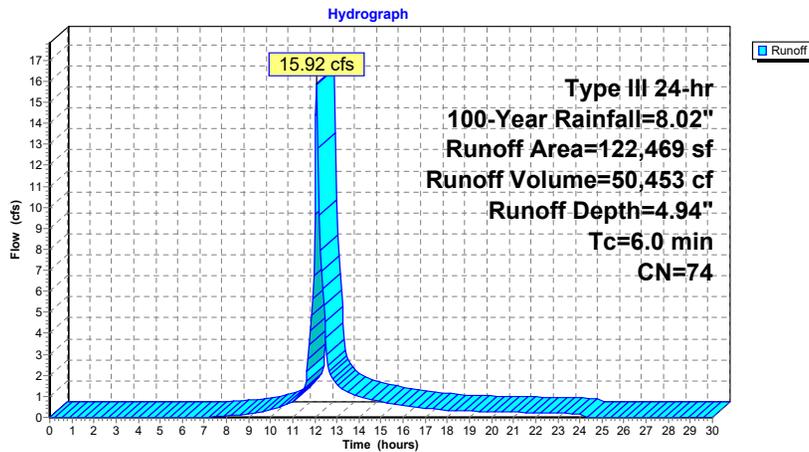

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 42

Summary for Pond 1P: On-Site Depression

Inflow Area = 122,469 sf, 8.69% Impervious, Inflow Depth = 4.94" for 100-Year event
Inflow = 15.92 cfs @ 12.09 hrs, Volume= 50,453 cf
Outflow = 0.00 cfs @ 0.00 hrs, Volume= 0 cf, Atten= 100%, Lag= 0.0 min
Primary = 0.00 cfs @ 0.00 hrs, Volume= 0 cf

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Peak Elev= 128.04' @ 24.40 hrs Surf.Area= 22,685 sf Storage= 50,452 cf

Plug-Flow detention time= (not calculated: initial storage exceeds outflow)
Center-of-Mass det. time= (not calculated: no outflow)

Volume	Invert	Avail.Storage	Storage Description
#1	125.00'	74,276 cf	Custom Stage Data (Irregular) Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
125.00	5,573	547.9	0	0	5,573
126.00	16,635	762.0	10,612	10,612	27,900
127.00	19,483	823.9	18,040	28,652	35,752
128.00	22,540	960.8	20,993	49,645	55,215
129.00	26,782	825.3	24,631	74,276	74,495

Device	Routing	Invert	Outlet Devices
#1	Primary	129.00'	Custom Weir/Orifice, Cv= 2.62 (C= 3.28) Head (feet) 0.00 1.00 Width (feet) 73.00 113.50

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=125.00' (Free Discharge)
1=Custom Weir/Orifice (Controls 0.00 cfs)


Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 43

Pond 1P: On-Site Depression

Hydrograph

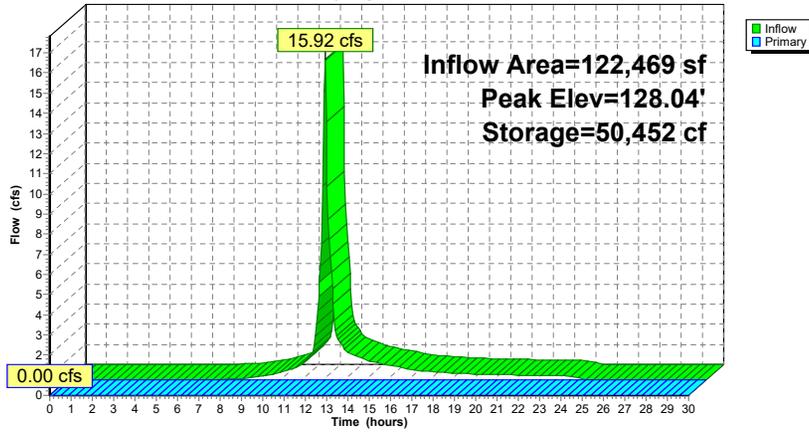

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 44


Summary for Link SP-1: Study Point #1

Inflow Area = 223,789 sf, 4.75% Impervious, Inflow Depth = 2.08" for 100-Year event
Inflow = 11.84 cfs @ 12.11 hrs, Volume= 38,811 cf
Primary = 11.84 cfs @ 12.11 hrs, Volume= 38,811 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs

Link SP-1: Study Point #1

Hydrograph

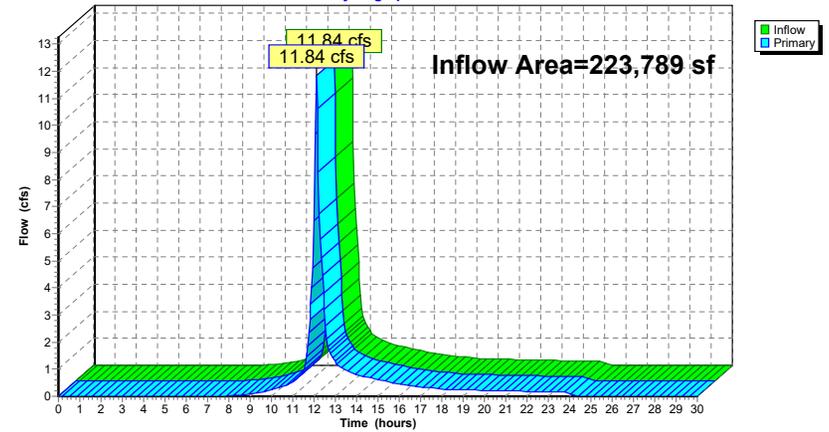

Existing HydroCAD

Prepared by Allen & Major Associates, Inc.

HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"

Printed 10/17/2019

Page 45


Summary for Link SP-2: Study Point #2

Inflow Area = 137,008 sf, 25.05% Impervious, Inflow Depth = 5.06" for 100-Year event
Inflow = 16.29 cfs @ 12.13 hrs, Volume= 57,768 cf
Primary = 16.29 cfs @ 12.13 hrs, Volume= 57,768 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs

Link SP-2: Study Point #2

Hydrograph

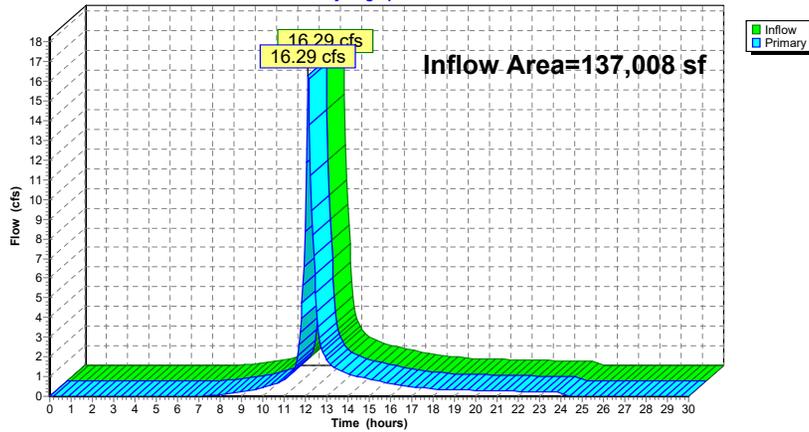

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge

Printed 10/17/2019
Page 3

Soil Listing (all nodes)

Area (sq-ft)	Soil Group	Subcatchment Numbers
3,360	HSG A	P-1
357,437	HSG B	P-1, P-10, P-11, P-2, P-3, P-4, P-5A, P-5B, P-6A, P-6B, P-7, P-8, P-9A, P-9B
0	HSG C	
0	HSG D	
0	Other	
360,797		TOTAL AREA

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge

Printed 10/17/2019
Page 4

Ground Covers (all nodes)

HSG-A (sq-ft)	HSG-B (sq-ft)	HSG-C (sq-ft)	HSG-D (sq-ft)	Other (sq-ft)	Total (sq-ft)	Ground Cover	Subcatchment Numbers
3,360	146,458	0	0	0	149,818	>75% Grass cover, Good	P-1, P-10, P-11, P-2, P-3, P-4, P-8, P-9A, P-9B
0	54,365	0	0	0	54,365	Paved parking	P-10, P-11, P-2
0	122,667	0	0	0	122,667	Unconnected pavement	P-3, P-5A, P-5B, P-6A, P-6B, P-7, P-8, P-9A, P-9B
0	33,947	0	0	0	33,947	Woods, Good	P-1
3,360	357,437	0	0	0	360,797	TOTAL AREA	

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge

Printed 10/17/2019
Page 5

Pipe Listing (all nodes)

Line#	Node Number	In-Invert (feet)	Out-Invert (feet)	Length (feet)	Slope (ft/ft)	n	Diam/Width (inches)	Height (inches)	Inside-Fill (inches)
1	UIS1	135.25	127.09	408.0	0.0200	0.013	15.0	0.0	0.0
2	UIS2	125.75	125.23	26.0	0.0200	0.013	15.0	0.0	0.0
3	UIS3	124.75	124.31	44.0	0.0100	0.013	15.0	0.0	0.0

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"

Printed 10/17/2019
Page 6

Time span=0.00-30.00 hrs, dt=0.05 hrs, 601 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment P-1: Off-site Runoff Northwest	Runoff Area=68,972 sf 0.00% Impervious Runoff Depth=0.00" Tc=6.0 min CN=57 Runoff=0.00 cfs 0 cf
Subcatchment P-10: Building 2/3 - South Parking	Runoff Area=32,520 sf 54.92% Impervious Runoff Depth=0.10" Tc=6.0 min CN=81 Runoff=0.03 cfs 266 cf
Subcatchment P-11: Building 1 - Southeast	Runoff Area=12,625 sf 49.31% Impervious Runoff Depth=0.07" Tc=6.0 min CN=79 Runoff=0.01 cfs 74 cf
Subcatchment P-2: Building 2 Parking - North	Runoff Area=36,597 sf 82.74% Impervious Runoff Depth=0.40" Tc=6.0 min CN=92 Runoff=0.38 cfs 1,227 cf
Subcatchment P-3: Building 1 Parking - East	Runoff Area=26,061 sf 67.95% Impervious Runoff Depth=0.20" Tc=6.0 min CN=86 Runoff=0.11 cfs 429 cf
Subcatchment P-4: Building 3 - West	Runoff Area=16,268 sf 0.00% Impervious Runoff Depth=0.00" Flow Length=322' Tc=8.6 min CN=61 Runoff=0.00 cfs 0 cf
Subcatchment P-5A: Building 3 Roof - North	Runoff Area=13,281 sf 100.00% Impervious Runoff Depth=0.79" Tc=6.0 min CN=98 Runoff=0.27 cfs 875 cf
Subcatchment P-5B: Building 3 Roof - South	Runoff Area=14,024 sf 100.00% Impervious Runoff Depth=0.79" Tc=6.0 min CN=98 Runoff=0.28 cfs 924 cf
Subcatchment P-6A: Building 2 Roof - North	Runoff Area=14,496 sf 100.00% Impervious Runoff Depth=0.79" Tc=6.0 min CN=98 Runoff=0.29 cfs 956 cf
Subcatchment P-6B: Building 2 Roof - South	Runoff Area=14,509 sf 100.00% Impervious Runoff Depth=0.79" Tc=6.0 min CN=98 Runoff=0.29 cfs 956 cf
Subcatchment P-7: Building 1	Runoff Area=22,302 sf 100.00% Impervious Runoff Depth=0.79" Tc=6.0 min CN=98 Runoff=0.45 cfs 1,470 cf
Subcatchment P-8: Pool Courtyard	Runoff Area=27,926 sf 36.53% Impervious Runoff Depth=0.03" Flow Length=267' Slope=0.0200 /' Tc=21.6 min CN=75 Runoff=0.00 cfs 71 cf
Subcatchment P-9A: Area Drains - Courtyard	Runoff Area=18,143 sf 16.94% Impervious Runoff Depth=0.00" Tc=6.0 min UI Adjusted CN=64 Runoff=0.00 cfs 0 cf
Subcatchment P-9B: Building 1/2 Courtyard	Runoff Area=43,073 sf 30.35% Impervious Runoff Depth=0.01" Flow Length=317' Tc=12.7 min CN=72 Runoff=0.00 cfs 43 cf
Pond UIS1: UIS#1	Peak Elev=134.97' Storage=635 cf Inflow=0.59 cfs 2,217 cf Discarded=0.09 cfs 2,217 cf Primary=0.00 cfs 0 cf Outflow=0.09 cfs 2,217 cf
Pond UIS2: UIS #2	Peak Elev=125.77' Storage=1,135 cf Inflow=0.94 cfs 3,058 cf Discarded=0.10 cfs 3,058 cf Primary=0.00 cfs 0 cf Outflow=0.10 cfs 3,058 cf

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 7

Pond UIS3: MC-3500

Peak Elev=124.32' Storage=510 cf Inflow=0.55 cfs 1,942 cf
Discarded=0.11 cfs 1,942 cf Primary=0.00 cfs 0 cf Outflow=0.11 cfs 1,942 cf

Link SP-1: Study Point #1

Inflow=0.00 cfs 0 cf
Primary=0.00 cfs 0 cf

Link SP-2: Study Point #2

Inflow=0.01 cfs 74 cf
Primary=0.01 cfs 74 cf

Total Runoff Area = 360,797 sf Runoff Volume = 7,291 cf Average Runoff Depth = 0.24"
50.93% Pervious = 183,765 sf 49.07% Impervious = 177,032 sf

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 8

Summary for Subcatchment P-1: Off-site Runoff Northwest


Runoff = 0.00 cfs @ 0.00 hrs, Volume= 0 cf, Depth= 0.00"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 1-INCH Rainfall=1.00"

Area (sf)	CN	Description
3,360	39	>75% Grass cover, Good, HSG A
31,665	61	>75% Grass cover, Good, HSG B
33,947	55	Woods, Good, HSG B
68,972	57	Weighted Average
68,972		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-1: Off-site Runoff Northwest

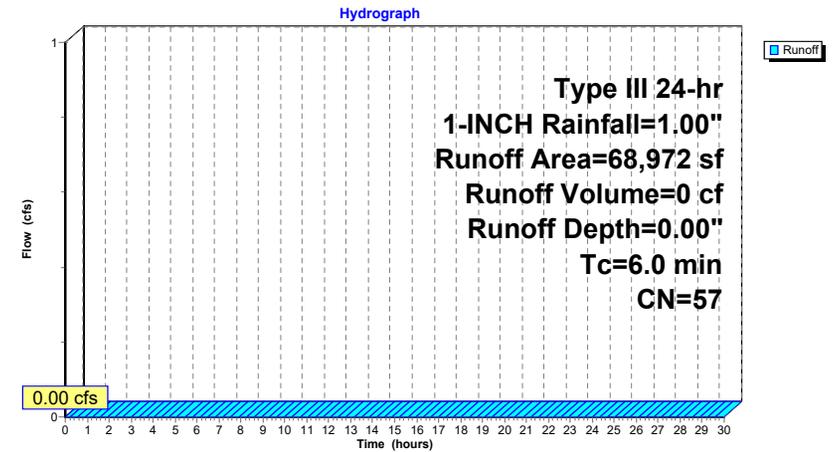

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 9

Summary for Subcatchment P-10: Building 2/3 - South Parking

Tc of 4.6 rounds to minimum of 5.0. Use Tc = 5.0 minutes for E-2.

Runoff = 0.03 cfs @ 12.27 hrs, Volume= 266 cf, Depth= 0.10"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 1-INCH Rainfall=1.00"

Area (sf)	CN	Description
17,860	98	Paved parking, HSG B
14,660	61	>75% Grass cover, Good, HSG B
32,520	81	Weighted Average
14,660		45.08% Pervious Area
17,860		54.92% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc

Subcatchment P-10: Building 2/3 - South Parking

Hydrograph

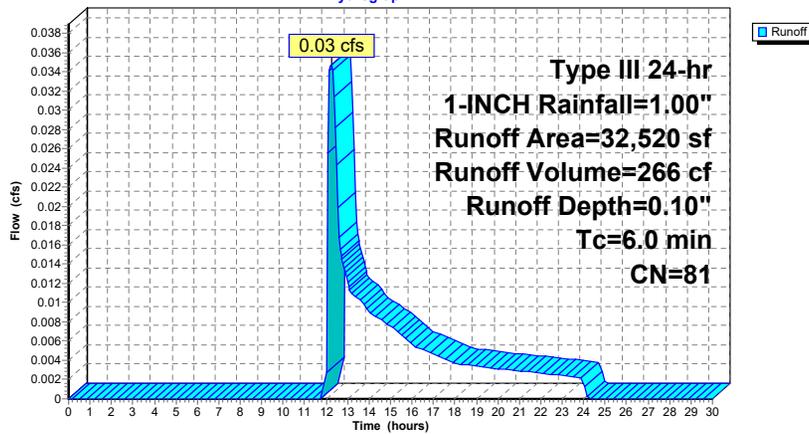

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 10

Summary for Subcatchment P-11: Building 1 - Southeast

Tc of 4.6 rounds to minimum of 5.0. Use Tc = 5.0 minutes for E-2.

Runoff = 0.01 cfs @ 12.36 hrs, Volume= 74 cf, Depth= 0.07"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 1-INCH Rainfall=1.00"

Area (sf)	CN	Description
6,226	98	Paved parking, HSG B
6,399	61	>75% Grass cover, Good, HSG B
12,625	79	Weighted Average
6,399		50.69% Pervious Area
6,226		49.31% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc

Subcatchment P-11: Building 1 - Southeast

Hydrograph

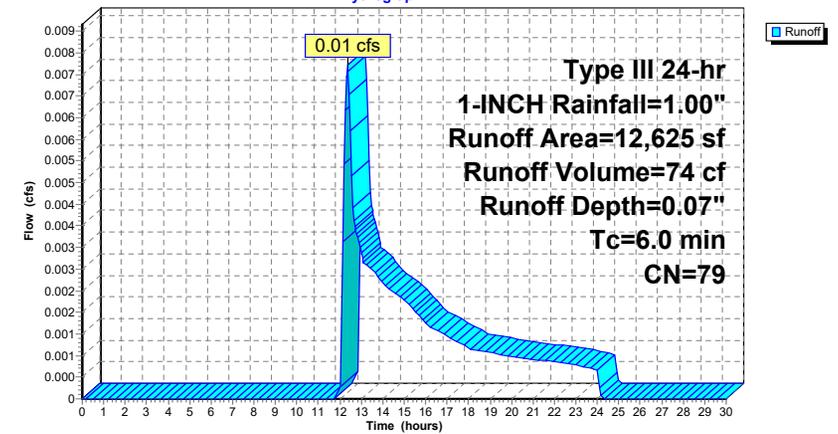

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 11

Summary for Subcatchment P-2: Building 2 Parking - North

Tc of 4.6 rounds to minimum of 5.0. Use Tc = 5.0 minutes for E-2.


Runoff = 0.38 cfs @ 12.10 hrs, Volume= 1,227 cf, Depth= 0.40"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 1-INCH Rainfall=1.00"

Area (sf)	CN	Description
30,279	98	Paved parking, HSG B
6,318	61	>75% Grass cover, Good, HSG B
36,597	92	Weighted Average
6,318		17.26% Pervious Area
30,279		82.74% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc

Subcatchment P-2: Building 2 Parking - North

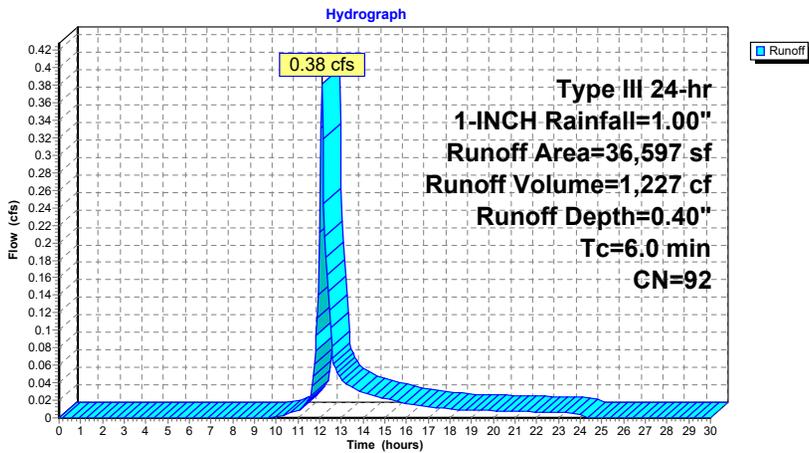

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 12

Summary for Subcatchment P-3: Building 1 Parking - East


Runoff = 0.11 cfs @ 12.11 hrs, Volume= 429 cf, Depth= 0.20"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 1-INCH Rainfall=1.00"

Area (sf)	CN	Description
17,708	98	Unconnected pavement, HSG B
8,353	61	>75% Grass cover, Good, HSG B
26,061	86	Weighted Average
8,353		32.05% Pervious Area
17,708		67.95% Impervious Area
17,708		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc

Subcatchment P-3: Building 1 Parking - East

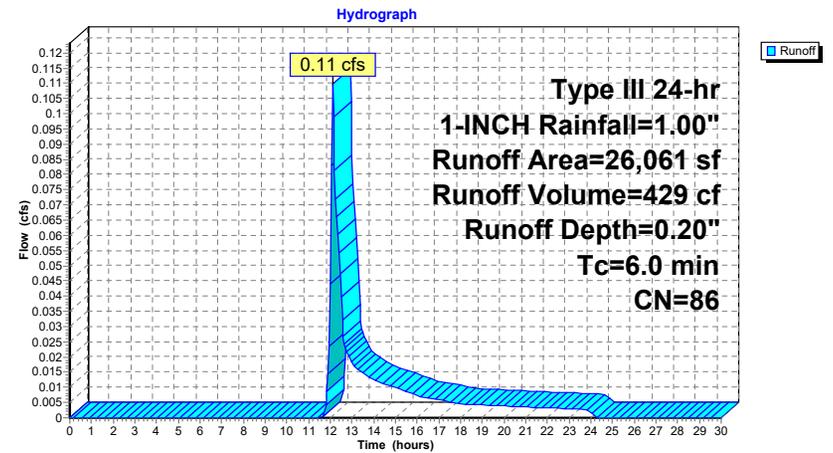

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 13

Summary for Subcatchment P-4: Building 3 - West


Runoff = 0.00 cfs @ 0.00 hrs, Volume= 0 cf, Depth= 0.00"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 1-INCH Rainfall=1.00"

Area (sf)	CN	Description
0	98	Unconnected pavement, HSG B
16,268	61	>75% Grass cover, Good, HSG B
16,268	61	Weighted Average
16,268		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.2	50	0.0200	0.10		Sheet Flow, Grass: Dense n= 0.240 P2= 3.16"
0.4	272	0.0350	11.12	215.66	Trap/Vee/Rect Channel Flow, Bot.W=6.00' D=2.00' Z= 0.7 & 3.0' Top.W=13.40' n= 0.030 Earth, grassed & winding
8.6	322	Total			

Subcatchment P-4: Building 3 - West

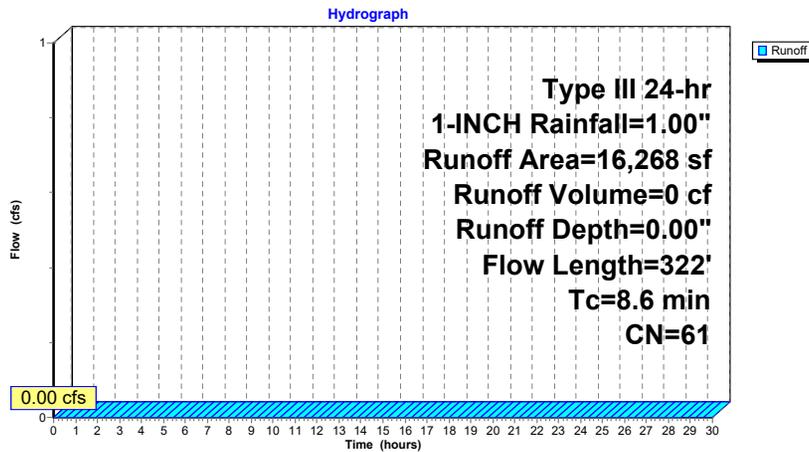

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 14

Summary for Subcatchment P-5A: Building 3 Roof - North


Runoff = 0.27 cfs @ 12.09 hrs, Volume= 875 cf, Depth= 0.79"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 1-INCH Rainfall=1.00"

Area (sf)	CN	Description
13,281	98	Unconnected pavement, HSG B
13,281		100.00% Impervious Area
13,281		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-5A: Building 3 Roof - North

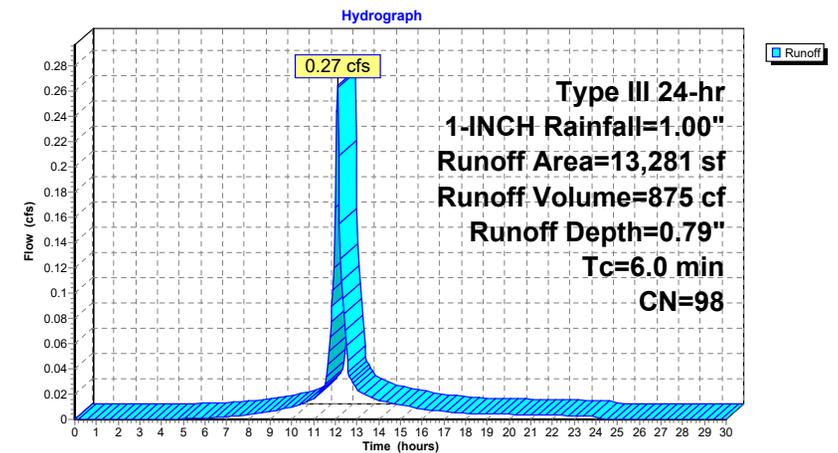

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 15

Summary for Subcatchment P-5B: Building 3 Roof - South


Runoff = 0.28 cfs @ 12.09 hrs, Volume= 924 cf, Depth= 0.79"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 1-INCH Rainfall=1.00"

Area (sf)	CN	Description
14,024	98	Unconnected pavement, HSG B
14,024		100.00% Impervious Area
14,024		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-5B: Building 3 Roof - South

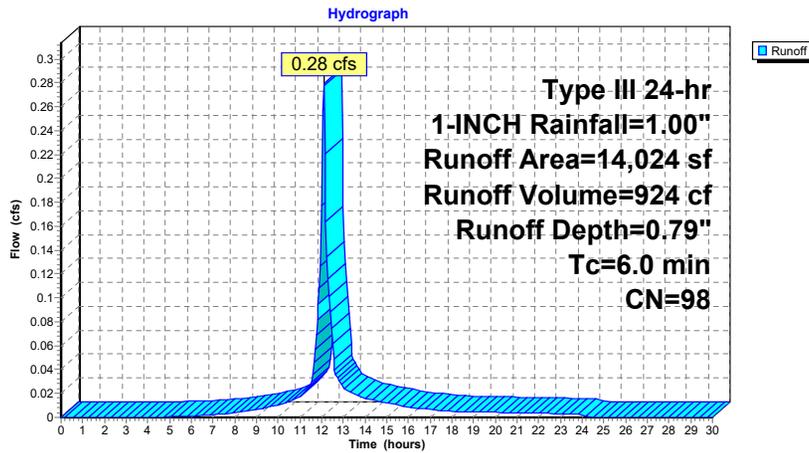

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 16

Summary for Subcatchment P-6A: Building 2 Roof - North


Runoff = 0.29 cfs @ 12.09 hrs, Volume= 955 cf, Depth= 0.79"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 1-INCH Rainfall=1.00"

Area (sf)	CN	Description
14,496	98	Unconnected pavement, HSG B
14,496		100.00% Impervious Area
14,496		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-6A: Building 2 Roof - North

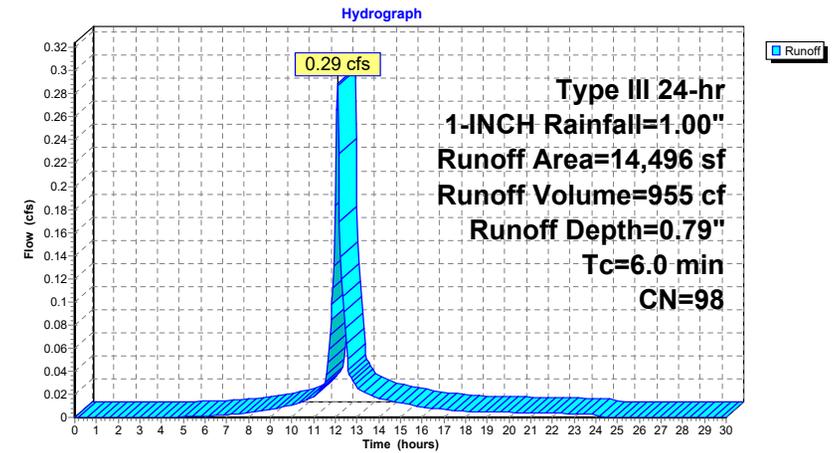

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 17

Summary for Subcatchment P-6B: Building 2 Roof - South


Runoff = 0.29 cfs @ 12.09 hrs, Volume= 956 cf, Depth= 0.79"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 1-INCH Rainfall=1.00"

Area (sf)	CN	Description
14,509	98	Unconnected pavement, HSG B
14,509		100.00% Impervious Area
14,509		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-6B: Building 2 Roof - South

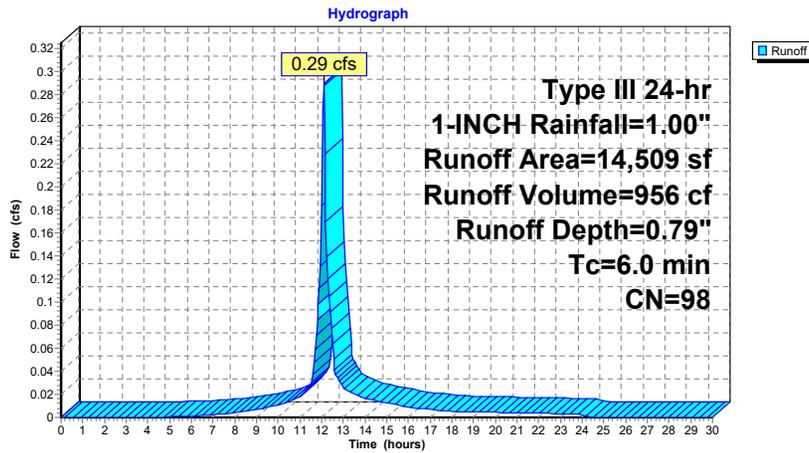

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 18

Summary for Subcatchment P-7: Building 1


Runoff = 0.45 cfs @ 12.09 hrs, Volume= 1,470 cf, Depth= 0.79"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 1-INCH Rainfall=1.00"

Area (sf)	CN	Description
22,302	98	Unconnected pavement, HSG B
22,302		100.00% Impervious Area
22,302		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-7: Building 1

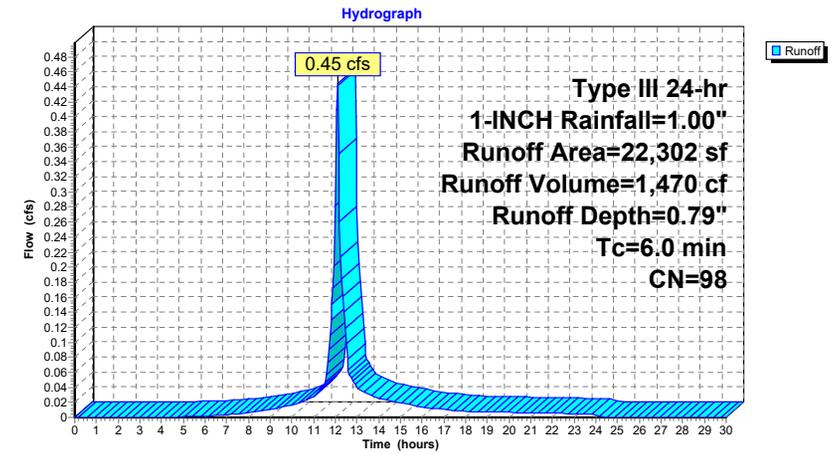

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 19

Summary for Subcatchment P-8: Pool Courtyard


Runoff = 0.00 cfs @ 14.01 hrs, Volume= 71 cf, Depth= 0.03"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 1-INCH Rainfall=1.00"

Area (sf)	CN	Description
10,200	98	Unconnected pavement, HSG B
17,726	61	>75% Grass cover, Good, HSG B
27,926	75	Weighted Average
17,726		63.47% Pervious Area
10,200		36.53% Impervious Area
10,200		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
21.6	267	0.0200	0.21		Sheet Flow, Grass: Short n= 0.150 P2= 3.16"

Subcatchment P-8: Pool Courtyard

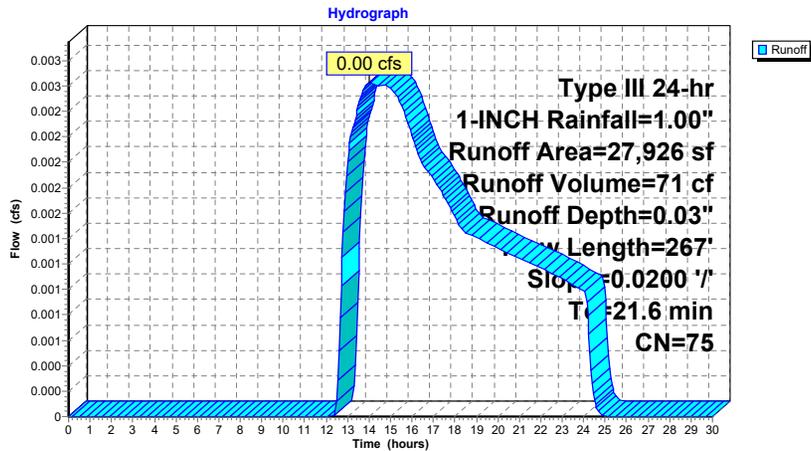

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 20

Summary for Subcatchment P-9A: Area Drains - Courtyard

Tc of 4.6 rounds to minimum of 5.0. Use Tc = 5.0 minutes for E-2.


Runoff = 0.00 cfs @ 0.00 hrs, Volume= 0 cf, Depth= 0.00"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 1-INCH Rainfall=1.00"

Area (sf)	CN	Adj	Description
3,074	98		Unconnected pavement, HSG B
15,069	61		>75% Grass cover, Good, HSG B
18,143	67	64	Weighted Average, UI Adjusted
15,069			83.06% Pervious Area
3,074			16.94% Impervious Area
3,074			100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc

Subcatchment P-9A: Area Drains - Courtyard

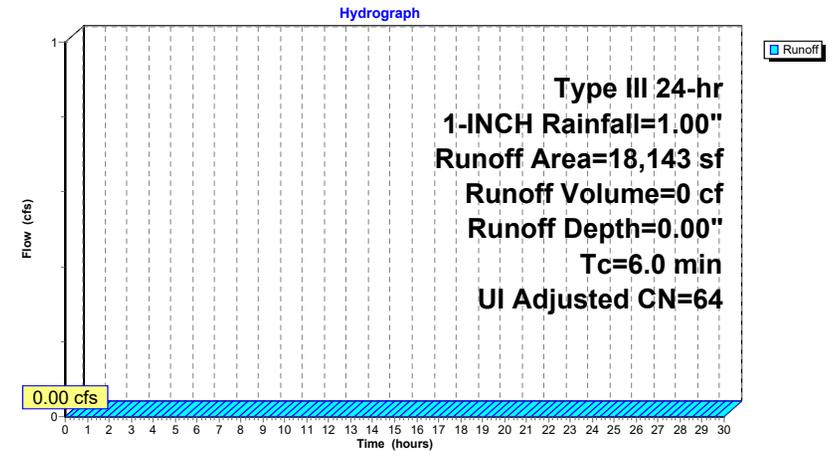

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 21

Summary for Subcatchment P-9B: Building 1/2 Courtyard

Runoff = 0.00 cfs @ 15.60 hrs, Volume= 43 cf, Depth= 0.01"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 1-INCH Rainfall=1.00"

Area (sf)	CN	Description
13,073	98	Unconnected pavement, HSG B
30,000	61	>75% Grass cover, Good, HSG B
43,073	72	Weighted Average
30,000		69.65% Pervious Area
13,073		30.35% Impervious Area
13,073		100.00% Unconnected


Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.9	50	0.0100	0.08		Sheet Flow, Grass: Dense n= 0.240 P2= 3.16"
0.9	52	0.0200	0.99		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.0	5	0.0150	2.49		Shallow Concentrated Flow, Paved Kv= 20.3 fps
0.2	29	0.1250	2.47		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.7	181	0.0500	4.54		Shallow Concentrated Flow, Paved Kv= 20.3 fps
12.7	317	Total			

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 22

Subcatchment P-9B: Building 1/2 Courtyard

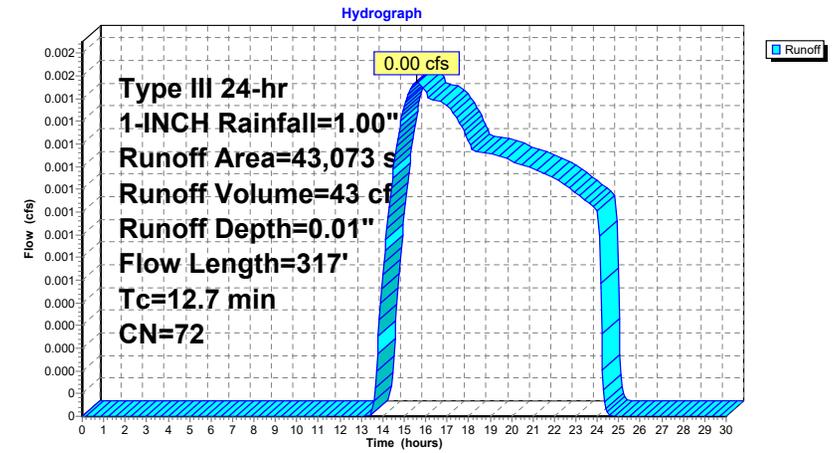

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 23

Summary for Pond UIS1: UIS#1

Inflow Area = 105,247 sf, 53.77% Impervious, Inflow Depth = 0.25" for 1-INCH event
Inflow = 0.59 cfs @ 12.09 hrs, Volume= 2,217 cf
Outflow = 0.09 cfs @ 11.80 hrs, Volume= 2,217 cf, Atten= 84%, Lag= 0.0 min
Discarded = 0.09 cfs @ 11.80 hrs, Volume= 2,217 cf
Primary = 0.00 cfs @ 0.00 hrs, Volume= 0 cf

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Peak Elev= 134.97' @ 12.62 hrs Surf.Area= 3,388 sf Storage= 635 cf

Plug-Flow detention time= 48.9 min calculated for 2,217 cf (100% of inflow)
Center-of-Mass det. time= 48.7 min (863.0 - 814.3)

Volume	Invert	Avail. Storage	Storage Description
#1A	134.50'	4,767 cf	29.92'W x 113.25'L x 5.50'H Field A 18,634 cf Overall - 6,716 cf Embedded = 11,918 cf x 40.0% Voids
#2A	135.25'	6,716 cf	ADS_StormTech MC-3500 d +Cap x 60 Inside #1 Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap 60 Chambers in 4 Rows Cap Storage= +14.9 cf x 2 x 4 rows = 119.2 cf
		11,484 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	135.25'	15.0" Round 15" HDPE L= 408.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 135.25' / 127.09' S= 0.0200' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf
#2	Device 1	136.60'	13.0" Vert. 13" Orifice C= 0.600
#3	Discarded	134.50'	1.205 in/hr Loamy Sand (1/2 Rawls Rate) over Surface area
#4	Device 1	139.75'	4.0' long x 0.5' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 Coef. (English) 2.80 2.92 3.08 3.30 3.32

Discarded OutFlow Max=0.09 cfs @ 11.80 hrs HW=134.56' (Free Discharge)
3=Loamy Sand (1/2 Rawls Rate) (Exfiltration Controls 0.09 cfs)

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=134.50' (Free Discharge)
1=15" HDPE (Controls 0.00 cfs)
2=13" Orifice (Controls 0.00 cfs)
4=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 24

Pond UIS1: UIS#1 - Chamber Wizard Field A

Chamber Model = ADS_StormTech MC-3500 d +Cap (ADS StormTech® MC-3500 d rev 03/14 with Cap volume)
Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf
Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap
Cap Storage= +14.9 cf x 2 x 4 rows = 119.2 cf

77.0" Wide + 9.0" Spacing = 86.0" C-C Row Spacing


15 Chambers/Row x 7.17' Long +1.85' Cap Length x 2 = 111.25' Row Length +12.0" End Stone x 2 = 113.25' Base Length
4 Rows x 77.0" Wide + 9.0" Spacing x 3 + 12.0" Side Stone x 2 = 29.92' Base Width
9.0" Base + 45.0" Chamber Height + 12.0" Cover = 5.50' Field Height

60 Chambers x 110.0 cf + 14.9 cf Cap Volume x 2 x 4 Rows = 6,716.3 cf Chamber Storage

18,634.3 cf Field - 6,716.3 cf Chambers = 11,918.0 cf Stone x 40.0% Voids = 4,767.2 cf Stone Storage

Chamber Storage + Stone Storage = 11,483.5 cf = 0.264 af
Overall Storage Efficiency = 61.6%
Overall System Size = 113.25' x 29.92' x 5.50'

60 Chambers
690.2 cy Field
441.4 cy Stone




Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 25

Pond UIS1: UIS#1

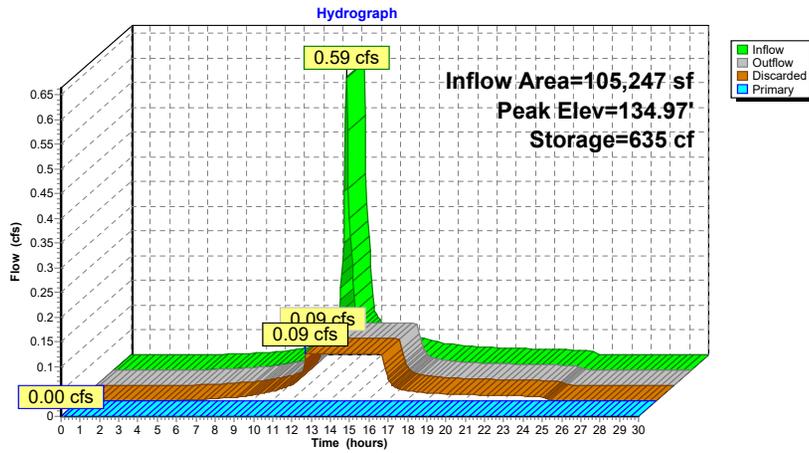

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 26

Summary for Pond UIS2: UIS #2

Inflow Area = 82,517 sf, 74.08% Impervious, Inflow Depth = 0.44" for 1-INCH event
Inflow = 0.94 cfs @ 12.09 hrs, Volume= 3,058 cf
Outflow = 0.10 cfs @ 12.50 hrs, Volume= 3,058 cf, Atten= 89%, Lag= 24.5 min
Discarded = 0.10 cfs @ 12.50 hrs, Volume= 3,058 cf
Primary = 0.00 cfs @ 0.00 hrs, Volume= 0 cf

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs / 3
Peak Elev= 125.77' @ 12.93 hrs Surf.Area= 3,615 sf Storage= 1,135 cf

Plug-Flow detention time= 94.6 min calculated for 3,053 cf (100% of inflow)
Center-of-Mass det. time= 94.5 min (906.7 - 812.2)

Volume	Invert	Avail. Storage	Storage Description
#1A	125.00'	5,063 cf	29.92'W x 120.42'L x 5.50'H Field A 19,814 cf Overall - 7,156 cf Embedded = 12,658 cf x 40.0% Voids
#2A	125.75'	7,156 cf	ADS_StormTech MC-3500 d +Cap x 64 Inside #1 Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap 64 Chambers in 4 Rows Cap Storage= +14.9 cf x 2 x 4 rows = 119.2 cf
#3	125.75'	82 cf	4.00'D x 6.50'H Vertical Cone/Cylinder
		12,301 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	125.75'	15.0" Round 15" HDPE L= 26.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 125.75' / 125.23' S= 0.0200'/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf
#2	Discarded	125.00'	1.205 in/hr Loamy Sand (1/2 Rawls Rate) over Surface area
#3	Device 1	127.10'	12.5" Vert. 13" Orifice C= 0.600

Discarded OutFlow Max=0.10 cfs @ 12.50 hrs HW=125.75' (Free Discharge)
↳2=Loamy Sand (1/2 Rawls Rate) (Exfiltration Controls 0.10 cfs)

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=125.00' (Free Discharge)
↳1=15" HDPE (Controls 0.00 cfs)
↳3=13" Orifice (Controls 0.00 cfs)

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 27

Pond UIS2: UIS #2 - Chamber Wizard Field A

Chamber Model = ADS_StormTech MC-3500 d +Cap (ADS StormTech® MC-3500 d rev 03/14 with Cap volume)

Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf

Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap

Cap Storage= +14.9 cf x 2 x 4 rows = 119.2 cf

77.0" Wide + 9.0" Spacing = 86.0" C-C Row Spacing

16 Chambers/Row x 7.17' Long +1.85' Cap Length x 2 = 118.42' Row Length +12.0" End Stone x 2 = 120.42' Base Length

4 Rows x 77.0" Wide + 9.0" Spacing x 3 + 12.0" Side Stone x 2 = 29.92' Base Width

9.0" Base + 45.0" Chamber Height + 12.0" Cover = 5.50' Field Height

64 Chambers x 110.0 cf + 14.9 cf Cap Volume x 2 x 4 Rows = 7,156.1 cf Chamber Storage

19,814.1 cf Field - 7,156.1 cf Chambers = 12,658.0 cf Stone x 40.0% Voids = 5,063.2 cf Stone Storage

Chamber Storage + Stone Storage = 12,219.3 cf = 0.281 af


Overall Storage Efficiency = 61.7%

Overall System Size = 120.42' x 29.92' x 5.50'

64 Chambers

733.9 cy Field

468.8 cy Stone




Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 28

Pond UIS2: UIS #2

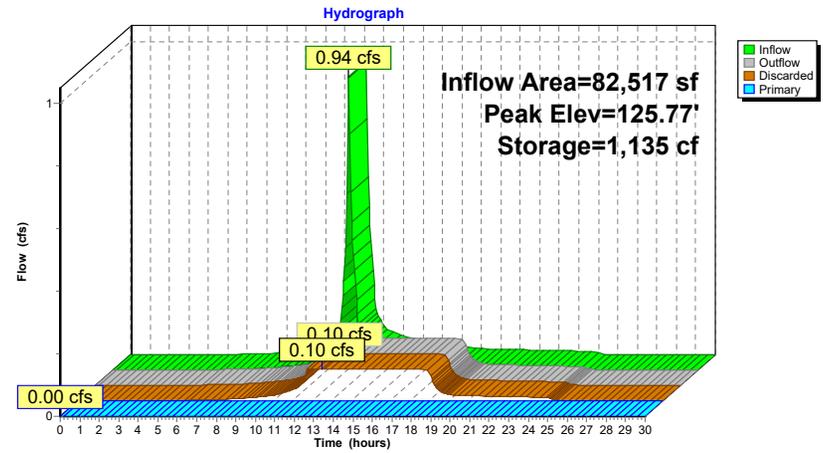

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 29

Summary for Pond UIS3: MC-3500

Inflow Area = 91,436 sf, 58.05% Impervious, Inflow Depth = 0.25" for 1-INCH event
Inflow = 0.55 cfs @ 12.09 hrs, Volume= 1,942 cf
Outflow = 0.11 cfs @ 11.95 hrs, Volume= 1,942 cf, Atten= 80%, Lag= 0.0 min
Discarded = 0.11 cfs @ 11.95 hrs, Volume= 1,942 cf
Primary = 0.00 cfs @ 0.00 hrs, Volume= 0 cf

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Peak Elev= 124.32' @ 12.55 hrs Surf.Area= 3,934 sf Storage= 510 cf

Plug-Flow detention time= 33.2 min calculated for 1,942 cf (100% of inflow)
Center-of-Mass det. time= 33.0 min (851.4 - 818.4)

Volume	Invert	Avail. Storage	Storage Description
#1A	124.00'	5,516 cf	37.08'W x 106.08'L x 5.50'H Field A 21,636 cf Overall - 7,846 cf Embedded = 13,790 cf x 40.0% Voids
#2A	124.75'	7,846 cf	ADS_StormTech MC-3500 d +Cap x 70 Inside #1 Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap 70 Chambers in 5 Rows Cap Storage= +14.9 cf x 2 x 5 rows = 149.0 cf
		13,362 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	124.75'	15.0" Round 15" HDPE L= 44.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 124.75' / 124.31' S= 0.0100'/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf
#2	Device 1	126.10'	12.0" Vert. 12" Orifice C= 0.600
#3	Discarded	124.00'	1.205 in/hr Loamy Sand (1/2 Rawls Rate) over Surface area
#4	Device 1	129.50'	4.0' long x 0.5' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 Coef. (English) 2.80 2.92 3.08 3.30 3.32

Discarded OutFlow Max=0.11 cfs @ 11.95 hrs HW=124.06' (Free Discharge)
3=Loamy Sand (1/2 Rawls Rate) (Exfiltration Controls 0.11 cfs)

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=124.00' (Free Discharge)
1=15" HDPE (Controls 0.00 cfs)
2=12" Orifice (Controls 0.00 cfs)
4=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 30

Pond UIS3: MC-3500 - Chamber Wizard Field A

Chamber Model = ADS_StormTech MC-3500 d +Cap (ADS StormTech® MC-3500 d rev 03/14 with Cap volume)
Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf
Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap
Cap Storage= +14.9 cf x 2 x 5 rows = 149.0 cf

77.0" Wide + 9.0" Spacing = 86.0" C-C Row Spacing


14 Chambers/Row x 7.17' Long +1.85' Cap Length x 2 = 104.08' Row Length +12.0" End Stone x 2 = 106.08' Base Length
5 Rows x 77.0" Wide + 9.0" Spacing x 4 + 12.0" Side Stone x 2 = 37.08' Base Width
9.0" Base + 45.0" Chamber Height + 12.0" Cover = 5.50' Field Height

70 Chambers x 110.0 cf + 14.9 cf Cap Volume x 2 x 5 Rows = 7,845.6 cf Chamber Storage

21,635.9 cf Field - 7,845.6 cf Chambers = 13,790.3 cf Stone x 40.0% Voids = 5,516.1 cf Stone Storage

Chamber Storage + Stone Storage = 13,361.7 cf = 0.307 af
Overall Storage Efficiency = 61.8%
Overall System Size = 106.08' x 37.08' x 5.50'

70 Chambers
801.3 cy Field
510.8 cy Stone

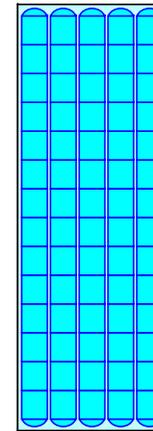


Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 31

Pond UIS3: MC-3500

Hydrograph

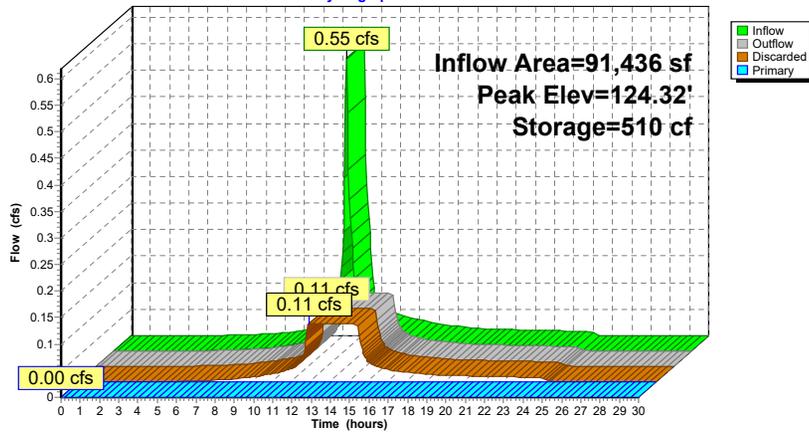

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 32


Summary for Link SP-1: Study Point #1

Inflow Area = 151,489 sf, 40.35% Impervious, Inflow Depth = 0.00" for 1-INCH event
Inflow = 0.00 cfs @ 0.00 hrs, Volume= 0 cf
Primary = 0.00 cfs @ 0.00 hrs, Volume= 0 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs

Link SP-1: Study Point #1

Hydrograph

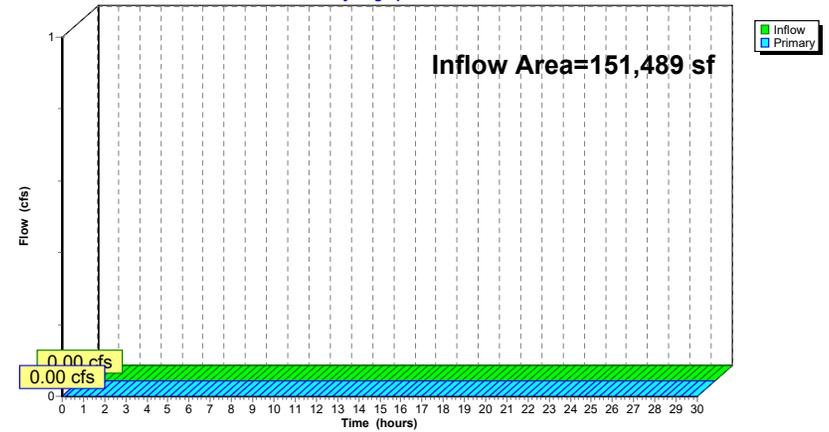

Proposed HydroCAD


Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 1-INCH Rainfall=1.00"
Printed 10/17/2019
Page 33

Summary for Link SP-2: Study Point #2

Inflow Area = 209,308 sf, 55.37% Impervious, Inflow Depth = 0.00" for 1-INCH event
Inflow = 0.01 cfs @ 12.36 hrs, Volume= 74 cf
Primary = 0.01 cfs @ 12.36 hrs, Volume= 74 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs

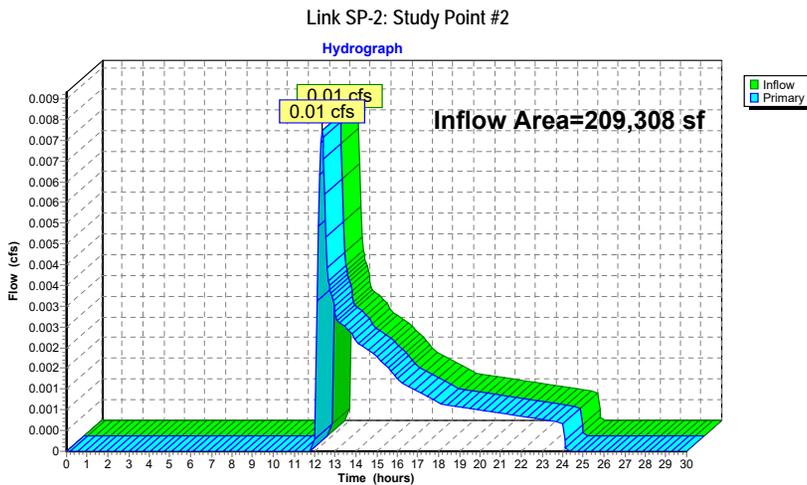

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 34

Time span=0.00-30.00 hrs, dt=0.05 hrs, 601 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment P-1: Off-site Runoff Northwest	Runoff Area=68,972 sf 0.00% Impervious Runoff Depth=0.34" Tc=6.0 min CN=57 Runoff=0.27 cfs 1,936 cf
Subcatchment P-10: Building 2/3 - South Parking	Runoff Area=32,520 sf 54.92% Impervious Runoff Depth=1.53" Tc=6.0 min CN=81 Runoff=1.31 cfs 4,152 cf
Subcatchment P-11: Building 1 - Southeast	Runoff Area=12,625 sf 49.31% Impervious Runoff Depth=1.40" Tc=6.0 min CN=79 Runoff=0.46 cfs 1,470 cf
Subcatchment P-2: Building 2 Parking - North	Runoff Area=36,597 sf 82.74% Impervious Runoff Depth=2.43" Tc=6.0 min CN=92 Runoff=2.28 cfs 7,401 cf
Subcatchment P-3: Building 1 Parking - East	Runoff Area=26,061 sf 67.95% Impervious Runoff Depth=1.90" Tc=6.0 min CN=86 Runoff=1.31 cfs 4,137 cf
Subcatchment P-4: Building 3 - West	Runoff Area=16,268 sf 0.00% Impervious Runoff Depth=0.48" Flow Length=322' Tc=8.6 min CN=61 Runoff=0.12 cfs 647 cf
Subcatchment P-5A: Building 3 Roof - North	Runoff Area=13,281 sf 100.00% Impervious Runoff Depth=3.05" Tc=6.0 min CN=98 Runoff=0.95 cfs 3,372 cf
Subcatchment P-5B: Building 3 Roof - South	Runoff Area=14,024 sf 100.00% Impervious Runoff Depth=3.05" Tc=6.0 min CN=98 Runoff=1.00 cfs 3,561 cf
Subcatchment P-6A: Building 2 Roof - North	Runoff Area=14,496 sf 100.00% Impervious Runoff Depth=3.05" Tc=6.0 min CN=98 Runoff=1.04 cfs 3,681 cf
Subcatchment P-6B: Building 2 Roof - South	Runoff Area=14,509 sf 100.00% Impervious Runoff Depth=3.05" Tc=6.0 min CN=98 Runoff=1.04 cfs 3,684 cf
Subcatchment P-7: Building 1	Runoff Area=22,302 sf 100.00% Impervious Runoff Depth=3.05" Tc=6.0 min CN=98 Runoff=1.59 cfs 5,663 cf
Subcatchment P-8: Pool Courtyard	Runoff Area=27,926 sf 36.53% Impervious Runoff Depth=1.15" Flow Length=267' Slope=0.0200' Tc=21.6 min CN=75 Runoff=0.54 cfs 2,673 cf
Subcatchment P-9A: Area Drains - Courtyard	Runoff Area=18,143 sf 16.94% Impervious Runoff Depth=0.60" Tc=6.0 min UI Adjusted CN=64 Runoff=0.22 cfs 902 cf
Subcatchment P-9B: Building 1/2 Courtyard	Runoff Area=43,073 sf 30.35% Impervious Runoff Depth=0.98" Flow Length=317' Tc=12.7 min CN=72 Runoff=0.84 cfs 3,516 cf
Pond UIS1: UIS#1	Peak Elev=137.04' Storage=5,972 cf Inflow=3.68 cfs 14,717 cf Discarded=0.09 cfs 7,738 cf Primary=0.78 cfs 4,537 cf Outflow=0.88 cfs 12,275 cf
Pond UIS2: UIS #2	Peak Elev=127.61' Storage=6,583 cf Inflow=4.48 cfs 15,357 cf Discarded=0.10 cfs 8,418 cf Primary=1.01 cfs 4,623 cf Outflow=1.11 cfs 13,040 cf

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 35

Pond UIS3: MC-3500

Peak Elev=126.33' Storage=6,327 cf Inflow=3.50 cfs 13,316 cf
Discarded=0.11 cfs 8,685 cf Primary=0.23 cfs 2,193 cf Outflow=0.34 cfs 10,878 cf

Link SP-1: Study Point #1

Inflow=1.21 cfs 6,559 cf
Primary=1.21 cfs 6,559 cf

Link SP-2: Study Point #2

Inflow=0.90 cfs 8,200 cf
Primary=0.90 cfs 8,200 cf

Total Runoff Area = 360,797 sf Runoff Volume = 46,796 cf Average Runoff Depth = 1.56"
50.93% Pervious = 183,765 sf 49.07% Impervious = 177,032 sf

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 36

Summary for Subcatchment P-1: Off-site Runoff Northwest


Runoff = 0.27 cfs @ 12.15 hrs, Volume= 1,936 cf, Depth= 0.34"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 2-Year Rainfall=3.28"

Area (sf)	CN	Description
3,360	39	>75% Grass cover, Good, HSG A
31,665	61	>75% Grass cover, Good, HSG B
33,947	55	Woods, Good, HSG B
68,972	57	Weighted Average
68,972		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-1: Off-site Runoff Northwest

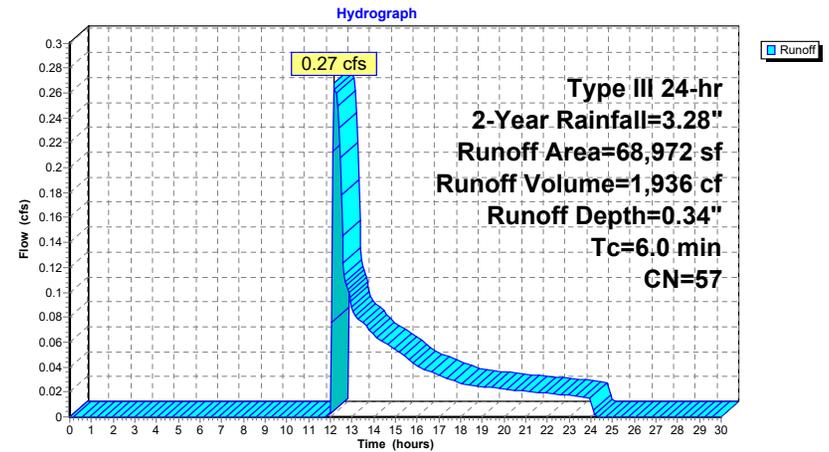

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 37

Summary for Subcatchment P-10: Building 2/3 - South Parking

Tc of 4.6 rounds to minimum of 5.0. Use Tc = 5.0 minutes for E-2.

Runoff = 1.31 cfs @ 12.09 hrs, Volume= 4,152 cf, Depth= 1.53"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 2-Year Rainfall=3.28"

Area (sf)	CN	Description
17,860	98	Paved parking, HSG B
14,660	61	>75% Grass cover, Good, HSG B
32,520	81	Weighted Average
14,660		45.08% Pervious Area
17,860		54.92% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc

Subcatchment P-10: Building 2/3 - South Parking

Hydrograph

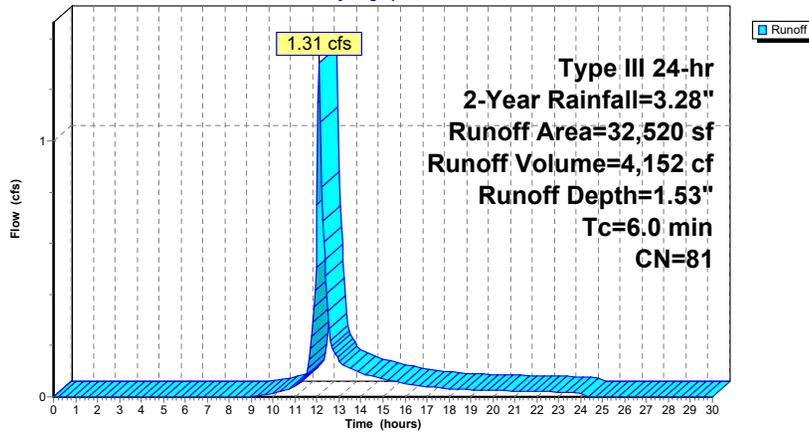

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 38

Summary for Subcatchment P-11: Building 1 - Southeast

Tc of 4.6 rounds to minimum of 5.0. Use Tc = 5.0 minutes for E-2.

Runoff = 0.46 cfs @ 12.10 hrs, Volume= 1,470 cf, Depth= 1.40"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 2-Year Rainfall=3.28"

Area (sf)	CN	Description
6,226	98	Paved parking, HSG B
6,399	61	>75% Grass cover, Good, HSG B
12,625	79	Weighted Average
6,399		50.69% Pervious Area
6,226		49.31% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc

Subcatchment P-11: Building 1 - Southeast

Hydrograph

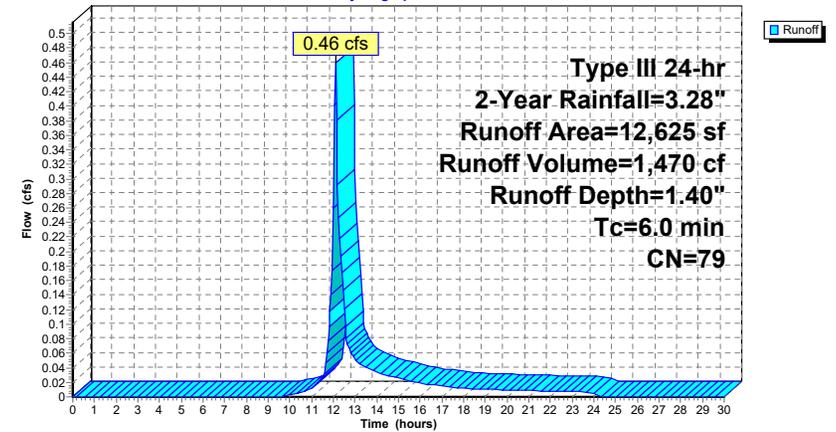

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 39

Summary for Subcatchment P-2: Building 2 Parking - North

Tc of 4.6 rounds to minimum of 5.0. Use Tc = 5.0 minutes for E-2.


Runoff = 2.28 cfs @ 12.09 hrs, Volume= 7,401 cf, Depth= 2.43"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 2-Year Rainfall=3.28"

Area (sf)	CN	Description
30,279	98	Paved parking, HSG B
6,318	61	>75% Grass cover, Good, HSG B
36,597	92	Weighted Average
6,318		17.26% Pervious Area
30,279		82.74% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc

Subcatchment P-2: Building 2 Parking - North

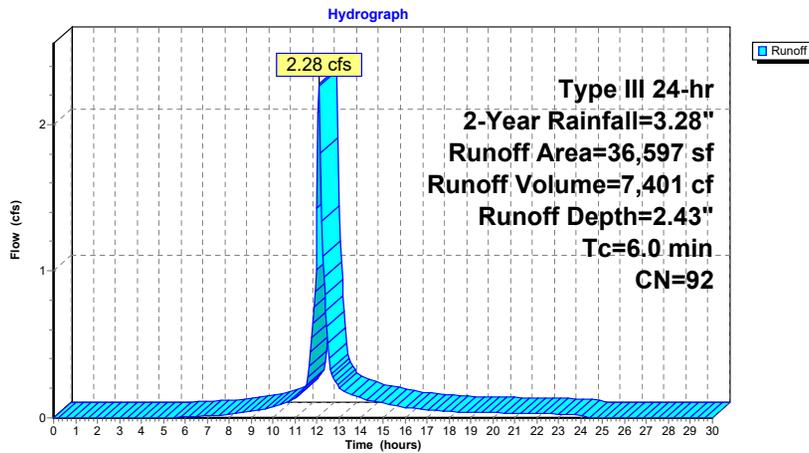

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 40

Summary for Subcatchment P-3: Building 1 Parking - East


Runoff = 1.31 cfs @ 12.09 hrs, Volume= 4,137 cf, Depth= 1.90"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 2-Year Rainfall=3.28"

Area (sf)	CN	Description
17,708	98	Unconnected pavement, HSG B
8,353	61	>75% Grass cover, Good, HSG B
26,061	86	Weighted Average
8,353		32.05% Pervious Area
17,708		67.95% Impervious Area
17,708		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc

Subcatchment P-3: Building 1 Parking - East

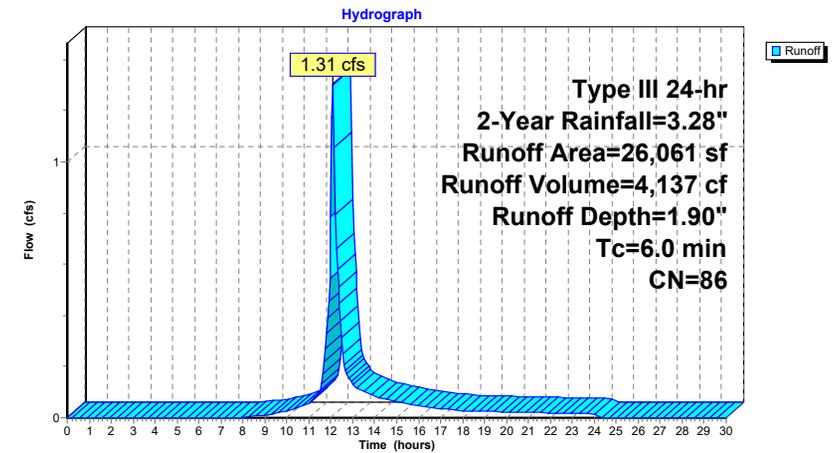

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 41


Summary for Subcatchment P-4: Building 3 - West

Runoff = 0.12 cfs @ 12.17 hrs, Volume= 647 cf, Depth= 0.48"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 2-Year Rainfall=3.28"

Area (sf)	CN	Description
0	98	Unconnected pavement, HSG B
16,268	61	>75% Grass cover, Good, HSG B
16,268	61	Weighted Average
16,268		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.2	50	0.0200	0.10		Sheet Flow, Grass: Dense n= 0.240 P2= 3.16"
0.4	272	0.0350	11.12	215.66	Trap/Vee/Rect Channel Flow, Bot.W=6.00' D=2.00' Z= 0.7 & 3.0' Top.W=13.40' n= 0.030 Earth, grassed & winding
8.6	322	Total			

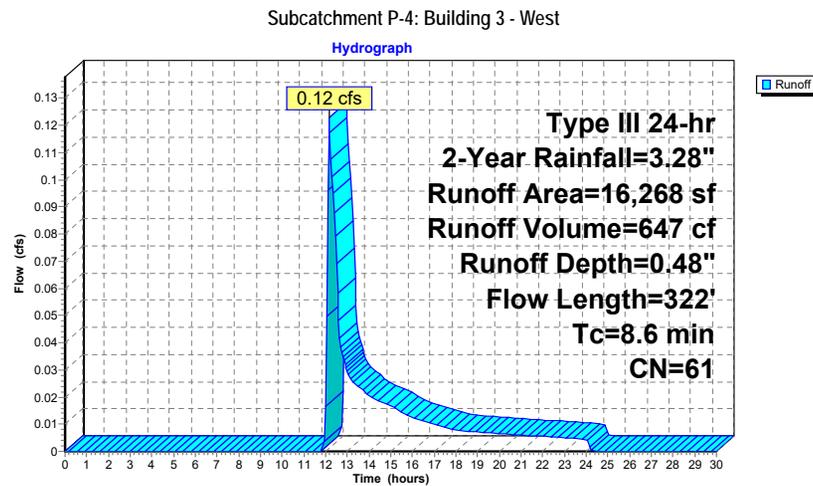

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 42

Summary for Subcatchment P-5A: Building 3 Roof - North


Runoff = 0.95 cfs @ 12.09 hrs, Volume= 3,372 cf, Depth= 3.05"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 2-Year Rainfall=3.28"

Area (sf)	CN	Description
13,281	98	Unconnected pavement, HSG B
13,281		100.00% Impervious Area
13,281		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-5A: Building 3 Roof - North

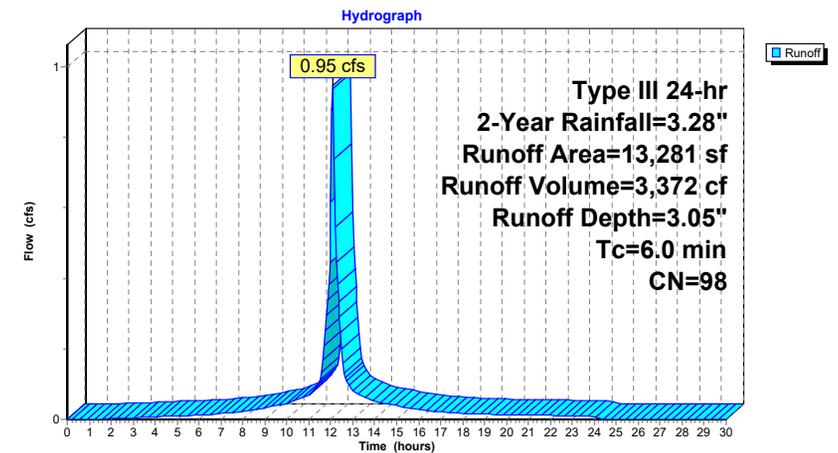

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 43

Summary for Subcatchment P-5B: Building 3 Roof - South


Runoff = 1.00 cfs @ 12.09 hrs, Volume= 3,561 cf, Depth= 3.05"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 2-Year Rainfall=3.28"

Area (sf)	CN	Description
14,024	98	Unconnected pavement, HSG B
14,024		100.00% Impervious Area
14,024		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-5B: Building 3 Roof - South

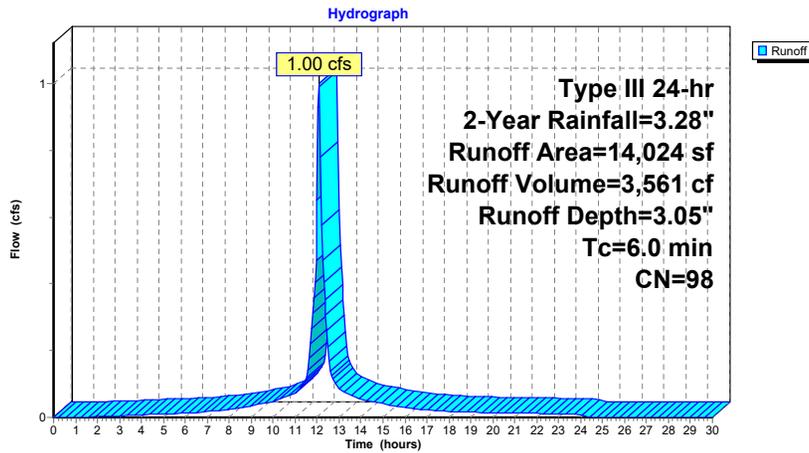

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 44

Summary for Subcatchment P-6A: Building 2 Roof - North


Runoff = 1.04 cfs @ 12.09 hrs, Volume= 3,681 cf, Depth= 3.05"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 2-Year Rainfall=3.28"

Area (sf)	CN	Description
14,496	98	Unconnected pavement, HSG B
14,496		100.00% Impervious Area
14,496		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-6A: Building 2 Roof - North

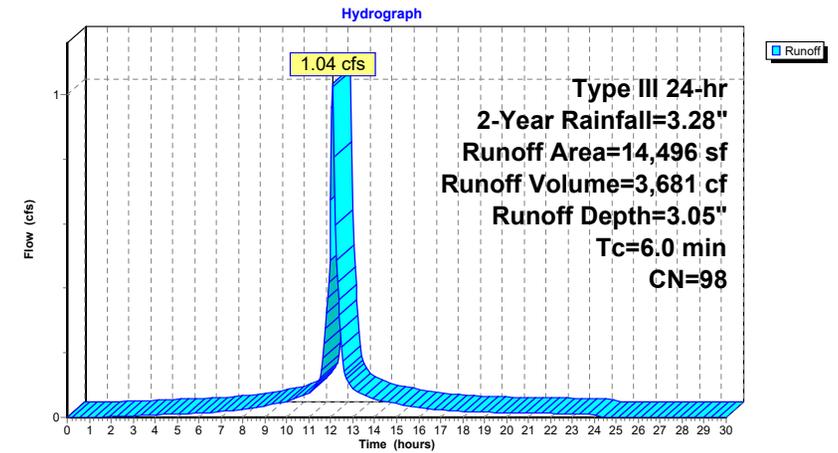

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 45

Summary for Subcatchment P-6B: Building 2 Roof - South


Runoff = 1.04 cfs @ 12.09 hrs, Volume= 3,684 cf, Depth= 3.05"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 2-Year Rainfall=3.28"

Area (sf)	CN	Description
14,509	98	Unconnected pavement, HSG B
14,509		100.00% Impervious Area
14,509		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-6B: Building 2 Roof - South

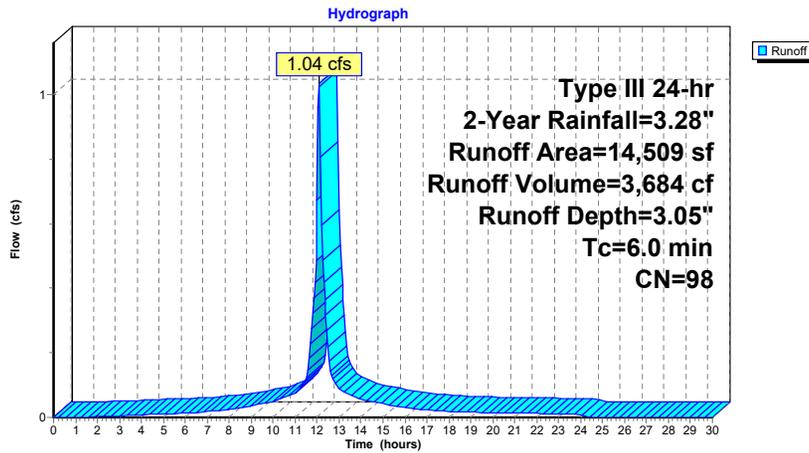

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 46

Summary for Subcatchment P-7: Building 1


Runoff = 1.59 cfs @ 12.09 hrs, Volume= 5,663 cf, Depth= 3.05"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 2-Year Rainfall=3.28"

Area (sf)	CN	Description
22,302	98	Unconnected pavement, HSG B
22,302		100.00% Impervious Area
22,302		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-7: Building 1

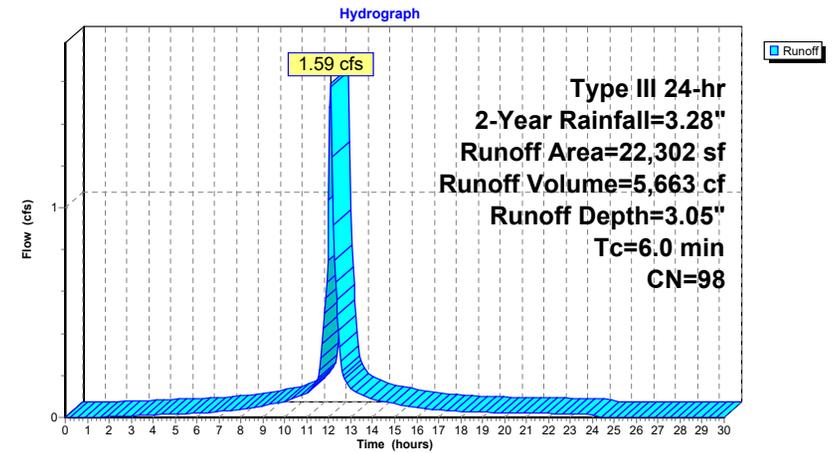

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 47

Summary for Subcatchment P-8: Pool Courtyard


Runoff = 0.54 cfs @ 12.32 hrs, Volume= 2,673 cf, Depth= 1.15"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 2-Year Rainfall=3.28"

Area (sf)	CN	Description
10,200	98	Unconnected pavement, HSG B
17,726	61	>75% Grass cover, Good, HSG B
27,926	75	Weighted Average
17,726		63.47% Pervious Area
10,200		36.53% Impervious Area
10,200		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
21.6	267	0.0200	0.21		Sheet Flow, Grass: Short n= 0.150 P2= 3.16"

Subcatchment P-8: Pool Courtyard

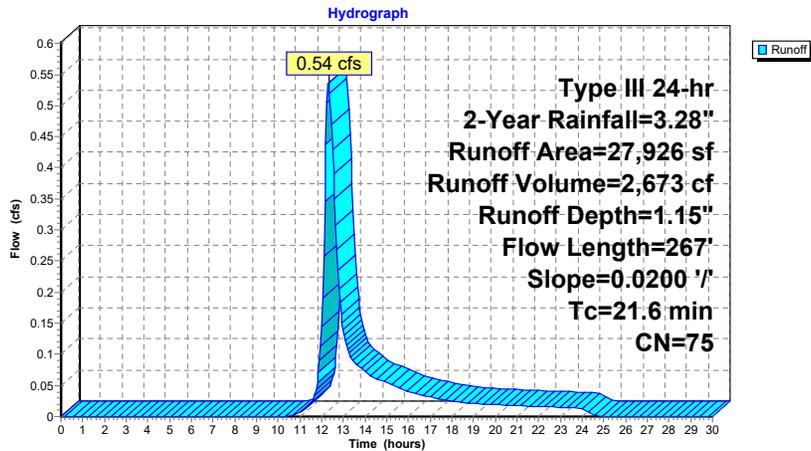

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 48

Summary for Subcatchment P-9A: Area Drains - Courtyard

Tc of 4.6 rounds to minimum of 5.0. Use Tc = 5.0 minutes for E-2.


Runoff = 0.22 cfs @ 12.11 hrs, Volume= 902 cf, Depth= 0.60"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 2-Year Rainfall=3.28"

Area (sf)	CN	Adj	Description
3,074	98		Unconnected pavement, HSG B
15,069	61		>75% Grass cover, Good, HSG B
18,143	67	64	Weighted Average, UI Adjusted
15,069			83.06% Pervious Area
3,074			16.94% Impervious Area
3,074			100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc

Subcatchment P-9A: Area Drains - Courtyard

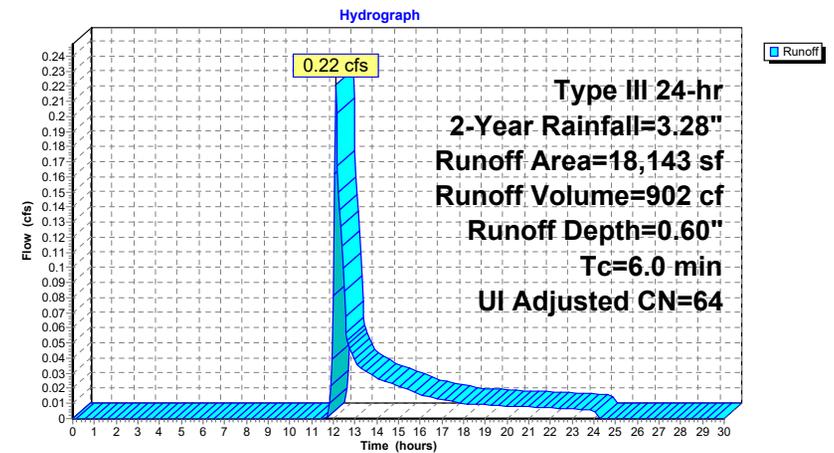

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 49

Summary for Subcatchment P-9B: Building 1/2 Courtyard

Runoff = 0.84 cfs @ 12.20 hrs, Volume= 3,516 cf, Depth= 0.98"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 2-Year Rainfall=3.28"

Area (sf)	CN	Description
13,073	98	Unconnected pavement, HSG B
30,000	61	>75% Grass cover, Good, HSG B
43,073	72	Weighted Average
30,000		69.65% Pervious Area
13,073		30.35% Impervious Area
13,073		100.00% Unconnected


Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.9	50	0.0100	0.08		Sheet Flow, Grass: Dense n= 0.240 P2= 3.16"
0.9	52	0.0200	0.99		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.0	5	0.0150	2.49		Shallow Concentrated Flow, Paved Kv= 20.3 fps
0.2	29	0.1250	2.47		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.7	181	0.0500	4.54		Shallow Concentrated Flow, Paved Kv= 20.3 fps
12.7	317	Total			

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 50

Subcatchment P-9B: Building 1/2 Courtyard

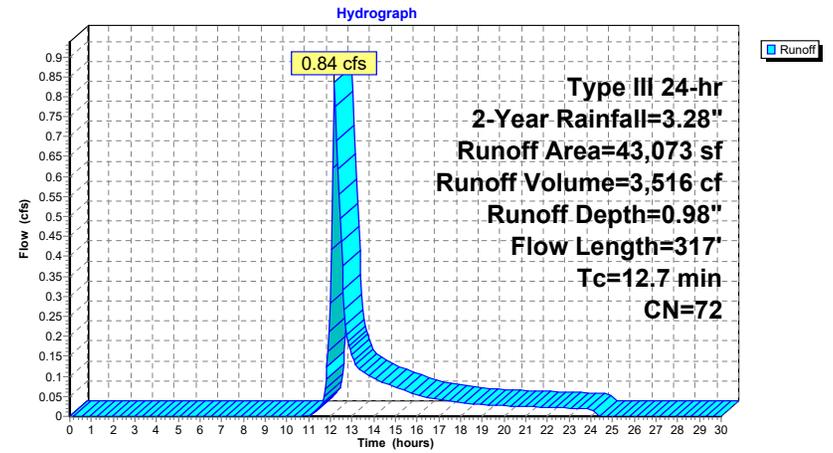

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 51

Summary for Pond UIS1: UIS#1

Inflow Area = 105,247 sf, 53.77% Impervious, Inflow Depth = 1.68" for 2-Year event
Inflow = 3.68 cfs @ 12.10 hrs, Volume= 14,717 cf
Outflow = 0.88 cfs @ 12.62 hrs, Volume= 12,275 cf, Atten= 76%, Lag= 31.2 min
Discarded = 0.09 cfs @ 9.90 hrs, Volume= 7,738 cf
Primary = 0.78 cfs @ 12.62 hrs, Volume= 4,537 cf

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Peak Elev= 137.04' @ 12.62 hrs Surf.Area= 3,388 sf Storage= 5,972 cf

Plug-Flow detention time= 276.4 min calculated for 12,275 cf (83% of inflow)
Center-of-Mass det. time= 204.3 min (1,011.4 - 807.1)

Volume	Invert	Avail.Storage	Storage Description
#1A	134.50'	4,767 cf	29.92'W x 113.25'L x 5.50'H Field A 18,634 cf Overall - 6,716 cf Embedded = 11,918 cf x 40.0% Voids
#2A	135.25'	6,716 cf	ADS_StormTech MC-3500 d +Cap x 60 Inside #1 Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap 60 Chambers in 4 Rows Cap Storage= +14.9 cf x 2 x 4 rows = 119.2 cf
		11,484 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	135.25'	15.0" Round 15" HDPE L= 408.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 135.25' / 127.09' S= 0.0200' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf
#2	Device 1	136.60'	13.0" Vert. 13" Orifice C= 0.600
#3	Discarded	134.50'	1.205 in/hr Loamy Sand (1/2 Rawls Rate) over Surface area
#4	Device 1	139.75'	4.0' long x 0.5' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 Coef. (English) 2.80 2.92 3.08 3.30 3.32

Discarded OutFlow Max=0.09 cfs @ 9.90 hrs HW=134.56' (Free Discharge)
3=Loamy Sand (1/2 Rawls Rate) (Exfiltration Controls 0.09 cfs)

Primary OutFlow Max=0.78 cfs @ 12.62 hrs HW=137.04' (Free Discharge)
1=15" HDPE (Passes 0.78 cfs of 5.02 cfs potential flow)
2=13" Orifice (Orifice Controls 0.78 cfs @ 2.25 fps)
4=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 52

Pond UIS1: UIS#1 - Chamber Wizard Field A

Chamber Model = ADS_StormTech MC-3500 d +Cap (ADS StormTech® MC-3500 d rev 03/14 with Cap volume)
Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf
Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap
Cap Storage= +14.9 cf x 2 x 4 rows = 119.2 cf

77.0" Wide + 9.0" Spacing = 86.0" C-C Row Spacing


15 Chambers/Row x 7.17' Long +1.85' Cap Length x 2 = 111.25' Row Length +12.0" End Stone x 2 = 113.25' Base Length
4 Rows x 77.0" Wide + 9.0" Spacing x 3 + 12.0" Side Stone x 2 = 29.92' Base Width
9.0" Base + 45.0" Chamber Height + 12.0" Cover = 5.50' Field Height

60 Chambers x 110.0 cf + 14.9 cf Cap Volume x 2 x 4 Rows = 6,716.3 cf Chamber Storage

18,634.3 cf Field - 6,716.3 cf Chambers = 11,918.0 cf Stone x 40.0% Voids = 4,767.2 cf Stone Storage

Chamber Storage + Stone Storage = 11,483.5 cf = 0.264 af
Overall Storage Efficiency = 61.6%
Overall System Size = 113.25' x 29.92' x 5.50'

60 Chambers
690.2 cy Field
441.4 cy Stone




Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 53

Pond UIS1: UIS#1

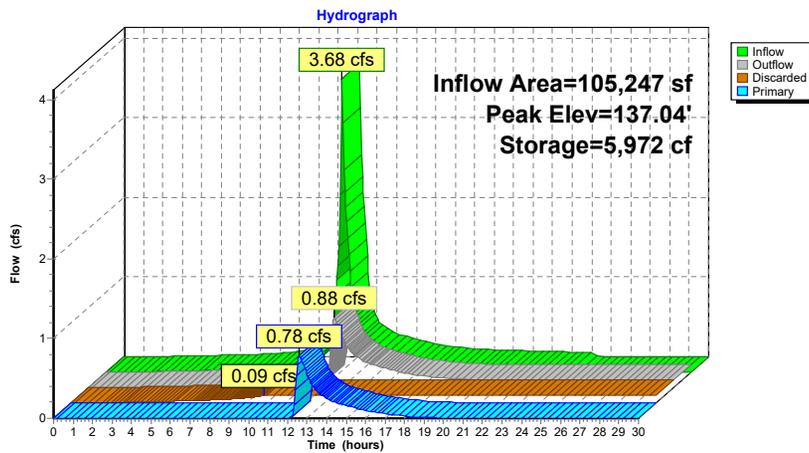

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 54

Summary for Pond UIS2: UIS #2

Inflow Area = 82,517 sf, 74.08% Impervious, Inflow Depth = 2.23" for 2-Year event
 Inflow = 4.48 cfs @ 12.09 hrs, Volume= 15,357 cf
 Outflow = 1.11 cfs @ 12.48 hrs, Volume= 13,040 cf, Atten= 75%, Lag= 23.3 min
 Discarded = 0.10 cfs @ 11.50 hrs, Volume= 8,418 cf
 Primary = 1.01 cfs @ 12.48 hrs, Volume= 4,623 cf

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs / 3
 Peak Elev= 127.61' @ 12.48 hrs Surf.Area= 3,615 sf Storage= 6,583 cf

Plug-Flow detention time= 281.2 min calculated for 13,019 cf (85% of inflow)
 Center-of-Mass det. time= 216.4 min (1,000.3 - 783.9)

Volume	Invert	Avail. Storage	Storage Description
#1A	125.00'	5,063 cf	29.92'W x 120.42'L x 5.50'H Field A 19,814 cf Overall - 7,156 cf Embedded = 12,658 cf x 40.0% Voids
#2A	125.75'	7,156 cf	ADS_StormTech MC-3500 d +Cap x 64 Inside #1 Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap 64 Chambers in 4 Rows Cap Storage= +14.9 cf x 2 x 4 rows = 119.2 cf
#3	125.75'	82 cf	4.00'D x 6.50'H Vertical Cone/Cylinder
		12,301 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	125.75'	15.0" Round 15" HDPE L= 26.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 125.75' / 125.23' S= 0.0200 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf
#2	Discarded	125.00'	1.205 in/hr Loamy Sand (1/2 Rawls Rate) over Surface area
#3	Device 1	127.10'	12.5" Vert. 13" Orifice C= 0.600

Discarded OutFlow Max=0.10 cfs @ 11.50 hrs HW=125.76' (Free Discharge)
 ↳2=Loamy Sand (1/2 Rawls Rate) (Exfiltration Controls 0.10 cfs)

Primary OutFlow Max=1.00 cfs @ 12.48 hrs HW=127.61' (Free Discharge)
 ↳1=15" HDPE (Passes 1.00 cfs of 5.18 cfs potential flow)
 ↳3=13" Orifice (Orifice Controls 1.00 cfs @ 2.43 fps)

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 55

Pond UIS2: UIS #2 - Chamber Wizard Field A

Chamber Model = ADS_StormTech MC-3500 d +Cap (ADS StormTech® MC-3500 d rev 03/14 with Cap volume)

Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf
Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap
Cap Storage= +14.9 cf x 2 x 4 rows = 119.2 cf

77.0" Wide + 9.0" Spacing = 86.0" C-C Row Spacing


16 Chambers/Row x 7.17' Long +1.85' Cap Length x 2 = 118.42' Row Length +12.0" End Stone x 2 = 120.42' Base Length
4 Rows x 77.0" Wide + 9.0" Spacing x 3 + 12.0" Side Stone x 2 = 29.92' Base Width
9.0" Base + 45.0" Chamber Height + 12.0" Cover = 5.50' Field Height

64 Chambers x 110.0 cf + 14.9 cf Cap Volume x 2 x 4 Rows = 7,156.1 cf Chamber Storage

19,814.1 cf Field - 7,156.1 cf Chambers = 12,658.0 cf Stone x 40.0% Voids = 5,063.2 cf Stone Storage

Chamber Storage + Stone Storage = 12,219.3 cf = 0.281 af
Overall Storage Efficiency = 61.7%
Overall System Size = 120.42' x 29.92' x 5.50'

64 Chambers
733.9 cy Field
468.8 cy Stone




Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 56

Pond UIS2: UIS #2

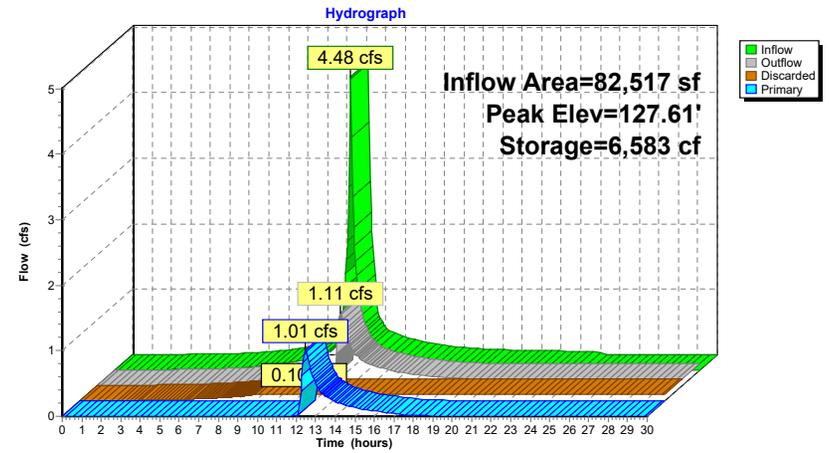

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 57

Summary for Pond UIS3: MC-3500

Inflow Area = 91,436 sf, 58.05% Impervious, Inflow Depth = 1.75" for 2-Year event
Inflow = 3.50 cfs @ 12.10 hrs, Volume= 13,316 cf
Outflow = 0.34 cfs @ 13.37 hrs, Volume= 10,878 cf, Atten= 90%, Lag= 76.4 min
Discarded = 0.11 cfs @ 10.40 hrs, Volume= 8,685 cf
Primary = 0.23 cfs @ 13.37 hrs, Volume= 2,193 cf

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Peak Elev= 126.33' @ 13.37 hrs Surf.Area= 3,934 sf Storage= 6,327 cf

Plug-Flow detention time= 350.3 min calculated for 10,878 cf (82% of inflow)
Center-of-Mass det. time= 274.1 min (1,081.3 - 807.3)

Volume	Invert	Avail. Storage	Storage Description
#1A	124.00'	5,516 cf	37.08'W x 106.08'L x 5.50'H Field A 21,636 cf Overall - 7,846 cf Embedded = 13,790 cf x 40.0% Voids
#2A	124.75'	7,846 cf	ADS_StormTech MC-3500 d +Cap x 70 Inside #1 Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap 70 Chambers in 5 Rows Cap Storage= +14.9 cf x 2 x 5 rows = 149.0 cf
		13,362 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	124.75'	15.0" Round 15" HDPE L= 44.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 124.75' / 124.31' S= 0.0100' /" Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf
#2	Device 1	126.10'	12.0" Vert. 12" Orifice C= 0.600
#3	Discarded	124.00'	1.205 in/hr Loamy Sand (1/2 Rawls Rate) over Surface area
#4	Device 1	129.50'	4.0' long x 0.5' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 Coef. (English) 2.80 2.92 3.08 3.30 3.32

Discarded OutFlow Max=0.11 cfs @ 10.40 hrs HW=124.06' (Free Discharge)
3=Loamy Sand (1/2 Rawls Rate) (Exfiltration Controls 0.11 cfs)

Primary OutFlow Max=0.23 cfs @ 13.37 hrs HW=126.33' (Free Discharge)
1=15" HDPE (Passes 0.23 cfs of 4.56 cfs potential flow)
2=12" Orifice (Orifice Controls 0.23 cfs @ 1.64 fps)
4=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 58

Pond UIS3: MC-3500 - Chamber Wizard Field A

Chamber Model = ADS_StormTech MC-3500 d +Cap (ADS StormTech® MC-3500 d rev 03/14 with Cap volume)
Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf
Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap
Cap Storage= +14.9 cf x 2 x 5 rows = 149.0 cf

77.0" Wide + 9.0" Spacing = 86.0" C-C Row Spacing


14 Chambers/Row x 7.17' Long +1.85' Cap Length x 2 = 104.08' Row Length +12.0" End Stone x 2 = 106.08' Base Length
5 Rows x 77.0" Wide + 9.0" Spacing x 4 + 12.0" Side Stone x 2 = 37.08' Base Width
9.0" Base + 45.0" Chamber Height + 12.0" Cover = 5.50' Field Height

70 Chambers x 110.0 cf + 14.9 cf Cap Volume x 2 x 5 Rows = 7,845.6 cf Chamber Storage

21,635.9 cf Field - 7,845.6 cf Chambers = 13,790.3 cf Stone x 40.0% Voids = 5,516.1 cf Stone Storage

Chamber Storage + Stone Storage = 13,361.7 cf = 0.307 af
Overall Storage Efficiency = 61.8%
Overall System Size = 106.08' x 37.08' x 5.50'

70 Chambers
801.3 cy Field
510.8 cy Stone

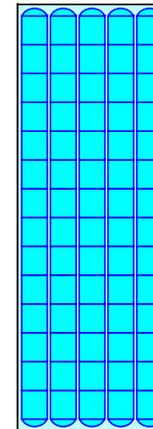

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.

HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC


ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"

Printed 10/17/2019

Page 59

Pond UIS3: MC-3500

Hydrograph

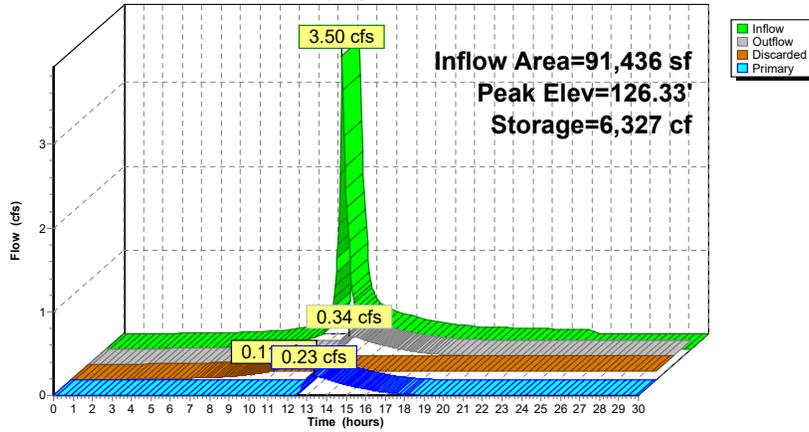

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.

HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"

Printed 10/17/2019

Page 60


Summary for Link SP-1: Study Point #1

Inflow Area = 151,489 sf, 40.35% Impervious, Inflow Depth = 0.52" for 2-Year event
Inflow = 1.21 cfs @ 12.45 hrs, Volume= 6,559 cf
Primary = 1.21 cfs @ 12.45 hrs, Volume= 6,559 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs

Link SP-1: Study Point #1

Hydrograph

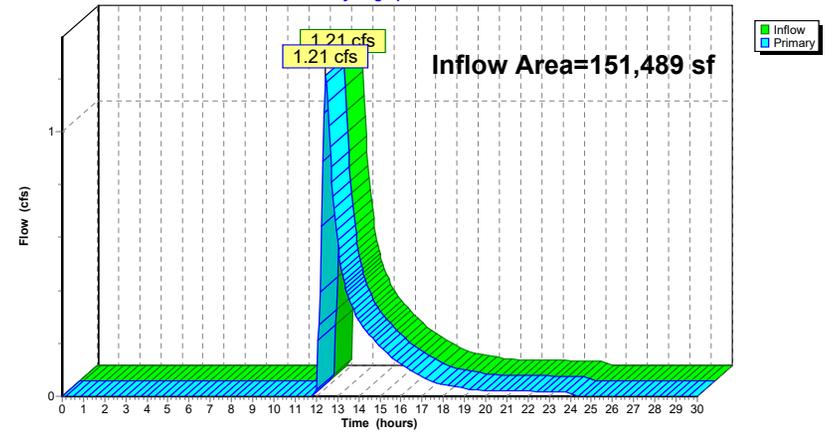

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 2-Year Rainfall=3.28"
Printed 10/17/2019
Page 61


Summary for Link SP-2: Study Point #2

Inflow Area = 209,308 sf, 55.37% Impervious, Inflow Depth = 0.47" for 2-Year event
Inflow = 0.90 cfs @ 12.69 hrs, Volume= 8,200 cf
Primary = 0.90 cfs @ 12.69 hrs, Volume= 8,200 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs

Link SP-2: Study Point #2

Hydrograph

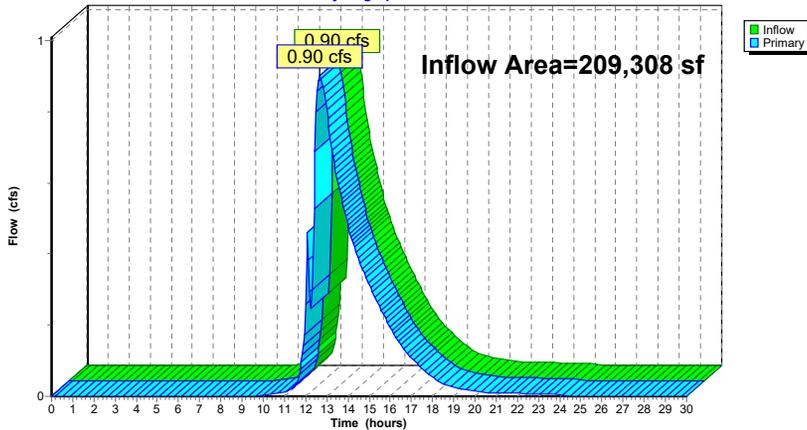

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 62

Time span=0.00-30.00 hrs, dt=0.05 hrs, 601 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment P-1: Off-site Runoff Northwest	Runoff Area=68,972 sf 0.00% Impervious Runoff Depth=1.16" Tc=6.0 min CN=57 Runoff=1.82 cfs 6,688 cf
Subcatchment P-10: Building 2/3 - South Parking	Runoff Area=32,520 sf 54.92% Impervious Runoff Depth=3.08" Tc=6.0 min CN=81 Runoff=2.64 cfs 8,354 cf
Subcatchment P-11: Building 1 - Southeast	Runoff Area=12,625 sf 49.31% Impervious Runoff Depth=2.90" Tc=6.0 min CN=79 Runoff=0.96 cfs 3,047 cf
Subcatchment P-2: Building 2 Parking - North	Runoff Area=36,597 sf 82.74% Impervious Runoff Depth=4.20" Tc=6.0 min CN=92 Runoff=3.83 cfs 12,799 cf
Subcatchment P-3: Building 1 Parking - East	Runoff Area=26,061 sf 67.95% Impervious Runoff Depth=3.57" Tc=6.0 min CN=86 Runoff=2.41 cfs 7,753 cf
Subcatchment P-4: Building 3 - West	Runoff Area=16,268 sf 0.00% Impervious Runoff Depth=1.44" Flow Length=322' Tc=8.6 min CN=61 Runoff=0.51 cfs 1,946 cf
Subcatchment P-5A: Building 3 Roof - North	Runoff Area=13,281 sf 100.00% Impervious Runoff Depth=4.87" Tc=6.0 min CN=98 Runoff=1.49 cfs 5,393 cf
Subcatchment P-5B: Building 3 Roof - South	Runoff Area=14,024 sf 100.00% Impervious Runoff Depth=4.87" Tc=6.0 min CN=98 Runoff=1.57 cfs 5,695 cf
Subcatchment P-6A: Building 2 Roof - North	Runoff Area=14,496 sf 100.00% Impervious Runoff Depth=4.87" Tc=6.0 min CN=98 Runoff=1.62 cfs 5,887 cf
Subcatchment P-6B: Building 2 Roof - South	Runoff Area=14,509 sf 100.00% Impervious Runoff Depth=4.87" Tc=6.0 min CN=98 Runoff=1.63 cfs 5,892 cf
Subcatchment P-7: Building 1	Runoff Area=22,302 sf 100.00% Impervious Runoff Depth=4.87" Tc=6.0 min CN=98 Runoff=2.50 cfs 9,056 cf
Subcatchment P-8: Pool Courtyard	Runoff Area=27,926 sf 36.53% Impervious Runoff Depth=2.54" Flow Length=267' Slope=0.0200 ' Tc=21.6 min CN=75 Runoff=1.24 cfs 5,908 cf
Subcatchment P-9A: Area Drains - Courtyard	Runoff Area=18,143 sf 16.94% Impervious Runoff Depth=1.65" Tc=6.0 min UI Adjusted CN=64 Runoff=0.75 cfs 2,498 cf
Subcatchment P-9B: Building 1/2 Courtyard	Runoff Area=43,073 sf 30.35% Impervious Runoff Depth=2.28" Flow Length=317' Tc=12.7 min CN=72 Runoff=2.08 cfs 8,194 cf
Pond UIS1: UIS#1	Peak Elev=137.90' Storage=8,085 cf Inflow=6.96 cfs 27,795 cf Discarded=0.09 cfs 8,340 cf Primary=3.85 cfs 16,515 cf Outflow=3.95 cfs 24,855 cf
Pond UIS2: UIS #2	Peak Elev=128.52' Storage=8,935 cf Inflow=7.69 cfs 26,577 cf Discarded=0.10 cfs 9,099 cf Primary=3.89 cfs 14,514 cf Outflow=3.99 cfs 23,613 cf

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 63

Pond UIS3: MC-3500

Peak Elev=127.15' Storage=8,753 cf Inflow=6.54 cfs 25,004 cf
Discarded=0.11 cfs 9,364 cf Primary=2.81 cfs 12,389 cf Outflow=2.92 cfs 21,753 cf

Link SP-1: Study Point #1

Inflow=5.27 cfs 21,203 cf
Primary=5.27 cfs 21,203 cf

Link SP-2: Study Point #2

Inflow=7.02 cfs 31,951 cf
Primary=7.02 cfs 31,951 cf

Total Runoff Area = 360,797 sf Runoff Volume = 89,112 cf Average Runoff Depth = 2.96"
50.93% Pervious = 183,765 sf 49.07% Impervious = 177,032 sf

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 64

Summary for Subcatchment P-1: Off-site Runoff Northwest


Runoff = 1.82 cfs @ 12.11 hrs, Volume= 6,688 cf, Depth= 1.16"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 10-Year Rainfall=5.11"

Area (sf)	CN	Description
3,360	39	>75% Grass cover, Good, HSG A
31,665	61	>75% Grass cover, Good, HSG B
33,947	55	Woods, Good, HSG B
68,972	57	Weighted Average
68,972		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-1: Off-site Runoff Northwest

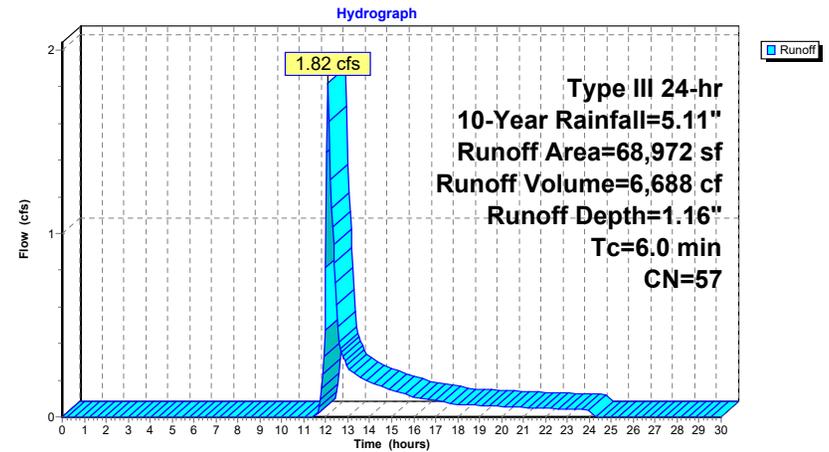

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 65

Summary for Subcatchment P-10: Building 2/3 - South Parking

Tc of 4.6 rounds to minimum of 5.0. Use Tc = 5.0 minutes for E-2.

Runoff = 2.64 cfs @ 12.09 hrs, Volume= 8,354 cf, Depth= 3.08"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 10-Year Rainfall=5.11"

Area (sf)	CN	Description
17,860	98	Paved parking, HSG B
14,660	61	>75% Grass cover, Good, HSG B
32,520	81	Weighted Average
14,660		45.08% Pervious Area
17,860		54.92% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc

Subcatchment P-10: Building 2/3 - South Parking

Hydrograph

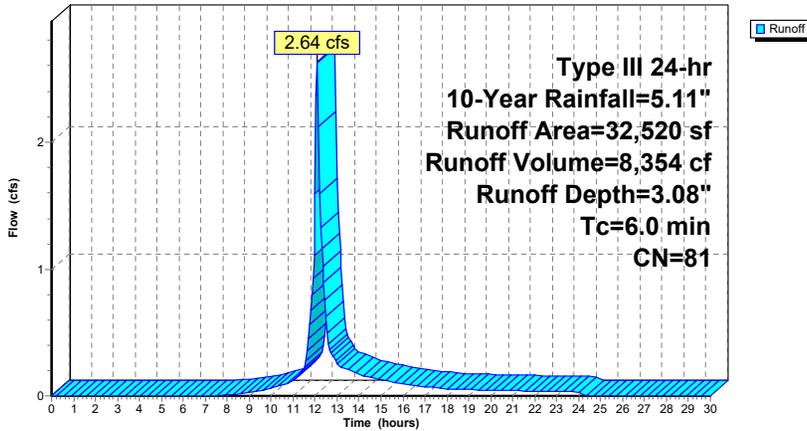

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 66

Summary for Subcatchment P-11: Building 1 - Southeast

Tc of 4.6 rounds to minimum of 5.0. Use Tc = 5.0 minutes for E-2.

Runoff = 0.96 cfs @ 12.09 hrs, Volume= 3,047 cf, Depth= 2.90"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 10-Year Rainfall=5.11"

Area (sf)	CN	Description
6,226	98	Paved parking, HSG B
6,399	61	>75% Grass cover, Good, HSG B
12,625	79	Weighted Average
6,399		50.69% Pervious Area
6,226		49.31% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc

Subcatchment P-11: Building 1 - Southeast

Hydrograph

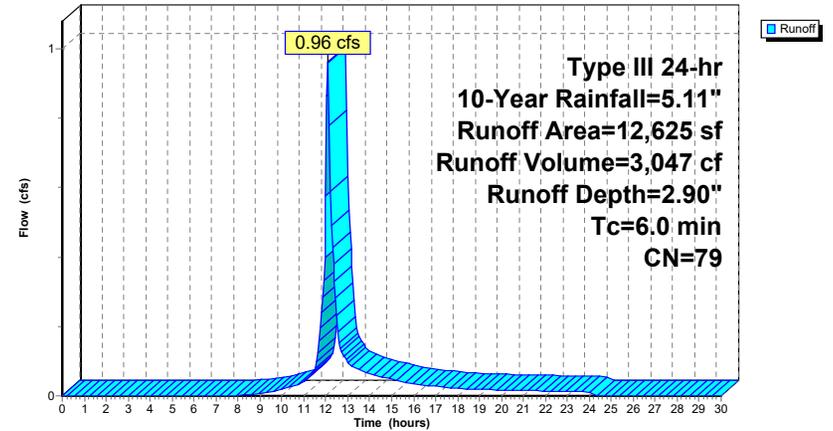

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 67

Summary for Subcatchment P-2: Building 2 Parking - North

Tc of 4.6 rounds to minimum of 5.0. Use Tc = 5.0 minutes for E-2.


Runoff = 3.83 cfs @ 12.09 hrs, Volume= 12,799 cf, Depth= 4.20"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 10-Year Rainfall=5.11"

Area (sf)	CN	Description
30,279	98	Paved parking, HSG B
6,318	61	>75% Grass cover, Good, HSG B
36,597	92	Weighted Average
6,318		17.26% Pervious Area
30,279		82.74% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc

Subcatchment P-2: Building 2 Parking - North

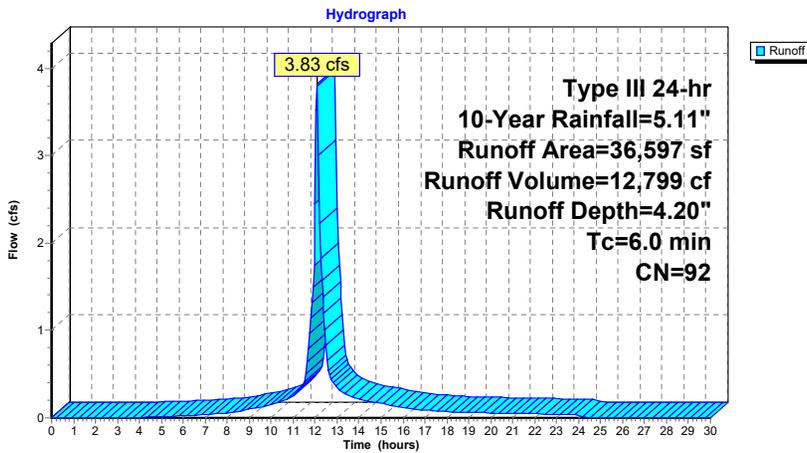

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 68

Summary for Subcatchment P-3: Building 1 Parking - East


Runoff = 2.41 cfs @ 12.09 hrs, Volume= 7,753 cf, Depth= 3.57"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 10-Year Rainfall=5.11"

Area (sf)	CN	Description
17,708	98	Unconnected pavement, HSG B
8,353	61	>75% Grass cover, Good, HSG B
26,061	86	Weighted Average
8,353		32.05% Pervious Area
17,708		67.95% Impervious Area
17,708		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-3: Building 1 Parking - East

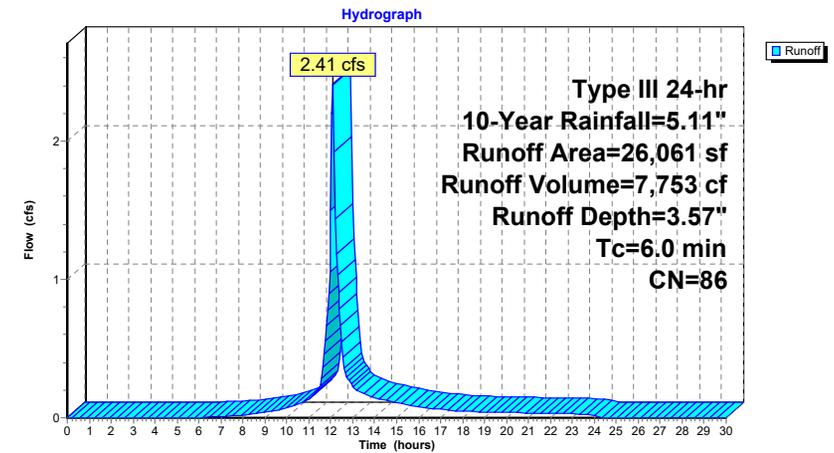

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 69


Summary for Subcatchment P-4: Building 3 - West

Runoff = 0.51 cfs @ 12.14 hrs, Volume= 1,946 cf, Depth= 1.44"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 10-Year Rainfall=5.11"

Area (sf)	CN	Description
0	98	Unconnected pavement, HSG B
16,268	61	>75% Grass cover, Good, HSG B
16,268	61	Weighted Average
16,268		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.2	50	0.0200	0.10		Sheet Flow, Grass: Dense n= 0.240 P2= 3.16"
0.4	272	0.0350	11.12	215.66	Trap/Vee/Rect Channel Flow, Bot.W=6.00' D=2.00' Z= 0.7 & 3.0' Top.W=13.40' n= 0.030 Earth, grassed & winding
8.6	322	Total			

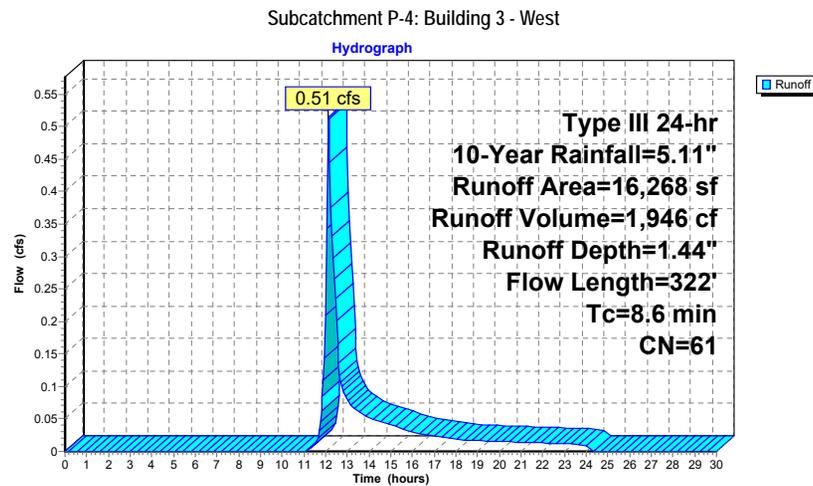

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 70

Summary for Subcatchment P-5A: Building 3 Roof - North


Runoff = 1.49 cfs @ 12.09 hrs, Volume= 5,393 cf, Depth= 4.87"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 10-Year Rainfall=5.11"

Area (sf)	CN	Description
13,281	98	Unconnected pavement, HSG B
13,281		100.00% Impervious Area
13,281		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-5A: Building 3 Roof - North

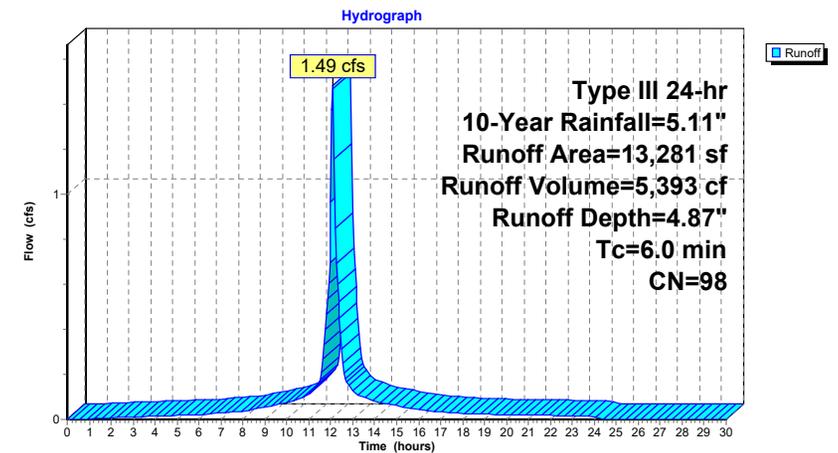

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 71

Summary for Subcatchment P-5B: Building 3 Roof - South


Runoff = 1.57 cfs @ 12.09 hrs, Volume= 5,695 cf, Depth= 4.87"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 10-Year Rainfall=5.11"

Area (sf)	CN	Description
14,024	98	Unconnected pavement, HSG B
14,024		100.00% Impervious Area
14,024		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-5B: Building 3 Roof - South

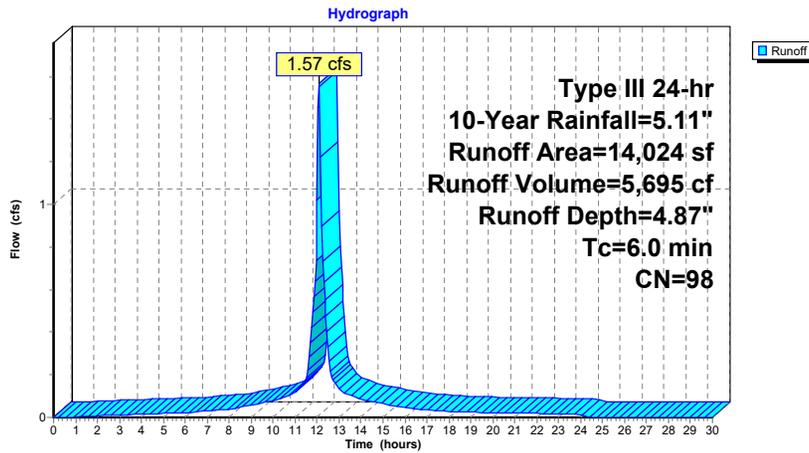

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 72

Summary for Subcatchment P-6A: Building 2 Roof - North


Runoff = 1.62 cfs @ 12.09 hrs, Volume= 5,887 cf, Depth= 4.87"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 10-Year Rainfall=5.11"

Area (sf)	CN	Description
14,496	98	Unconnected pavement, HSG B
14,496		100.00% Impervious Area
14,496		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-6A: Building 2 Roof - North

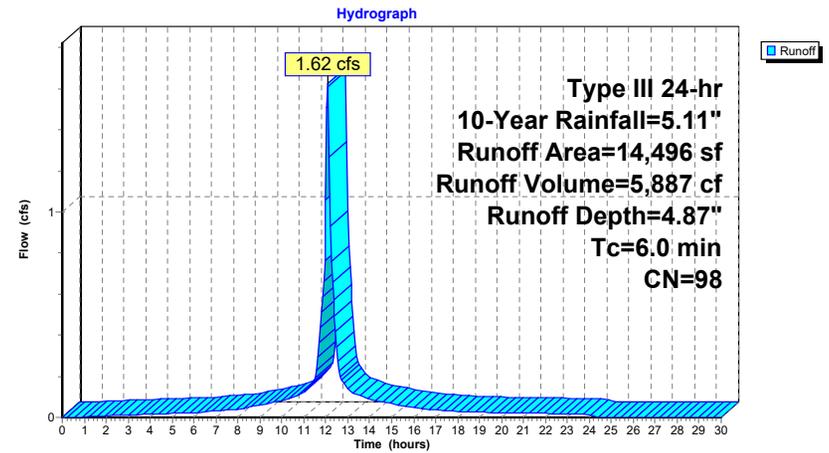

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
 HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
 Type III 24-hr 10-Year Rainfall=5.11"
 Printed 10/17/2019
 Page 73

Summary for Subcatchment P-6B: Building 2 Roof - South


Runoff = 1.63 cfs @ 12.09 hrs, Volume= 5,892 cf, Depth= 4.87"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10-Year Rainfall=5.11"

Area (sf)	CN	Description
14,509	98	Unconnected pavement, HSG B
14,509		100.00% Impervious Area
14,509		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-6B: Building 2 Roof - South

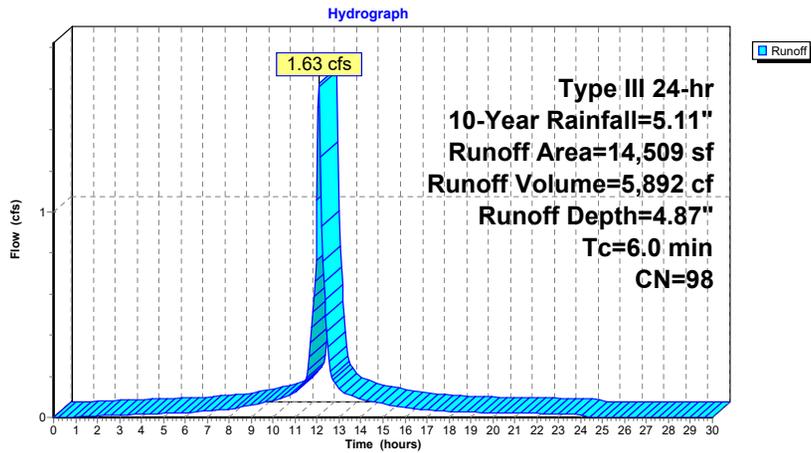

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
 HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
 Type III 24-hr 10-Year Rainfall=5.11"
 Printed 10/17/2019
 Page 74

Summary for Subcatchment P-7: Building 1


Runoff = 2.50 cfs @ 12.09 hrs, Volume= 9,056 cf, Depth= 4.87"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10-Year Rainfall=5.11"

Area (sf)	CN	Description
22,302	98	Unconnected pavement, HSG B
22,302		100.00% Impervious Area
22,302		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-7: Building 1

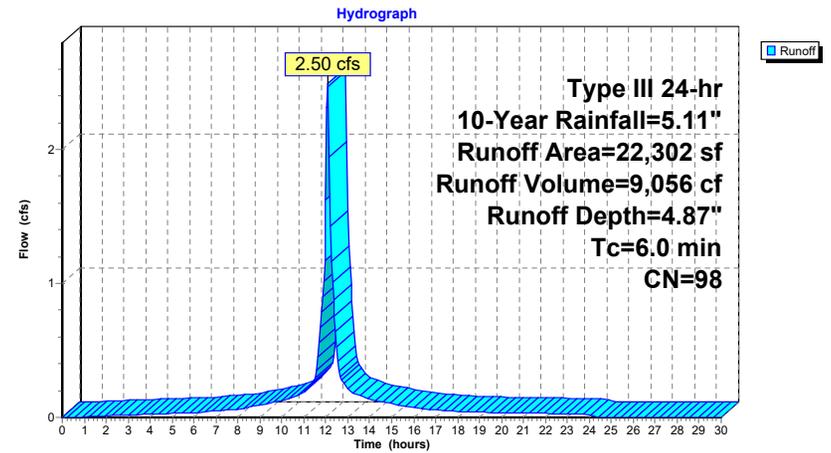

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 75

Summary for Subcatchment P-8: Pool Courtyard


Runoff = 1.24 cfs @ 12.31 hrs, Volume= 5,908 cf, Depth= 2.54"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 10-Year Rainfall=5.11"

Area (sf)	CN	Description
10,200	98	Unconnected pavement, HSG B
17,726	61	>75% Grass cover, Good, HSG B
27,926	75	Weighted Average
17,726		63.47% Pervious Area
10,200		36.53% Impervious Area
10,200		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
21.6	267	0.0200	0.21		Sheet Flow, Grass: Short n= 0.150 P2= 3.16"

Subcatchment P-8: Pool Courtyard

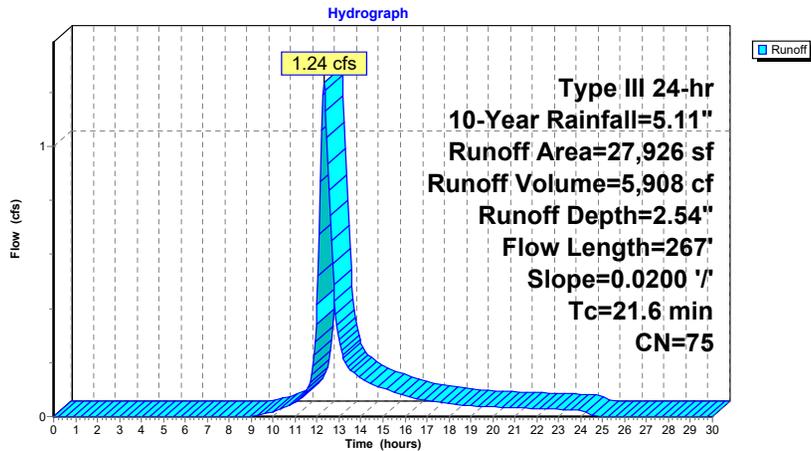

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 76

Summary for Subcatchment P-9A: Area Drains - Courtyard

Tc of 4.6 rounds to minimum of 5.0. Use Tc = 5.0 minutes for E-2.


Runoff = 0.75 cfs @ 12.10 hrs, Volume= 2,498 cf, Depth= 1.65"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 10-Year Rainfall=5.11"

Area (sf)	CN	Adj	Description
3,074	98		Unconnected pavement, HSG B
15,069	61		>75% Grass cover, Good, HSG B
18,143	67	64	Weighted Average, UI Adjusted
15,069			83.06% Pervious Area
3,074			16.94% Impervious Area
3,074			100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc

Subcatchment P-9A: Area Drains - Courtyard

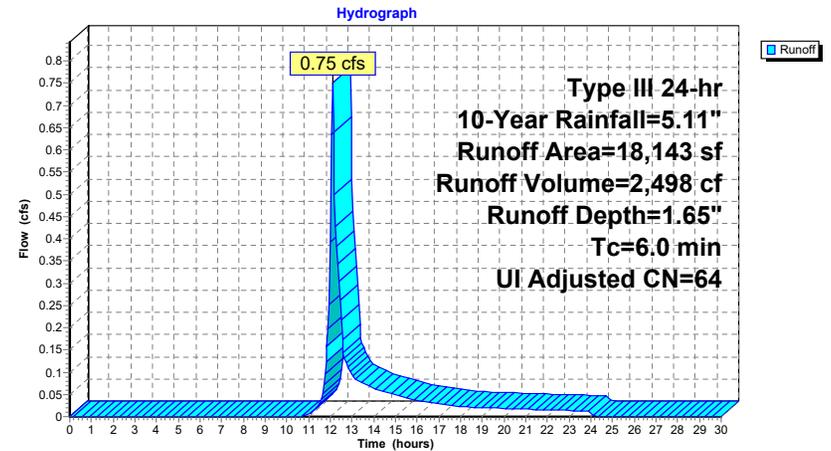

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
 HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
 Type III 24-hr 10-Year Rainfall=5.11"
 Printed 10/17/2019
 Page 77

Summary for Subcatchment P-9B: Building 1/2 Courtyard

Runoff = 2.08 cfs @ 12.18 hrs, Volume= 8,194 cf, Depth= 2.28"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10-Year Rainfall=5.11"

Area (sf)	CN	Description
13,073	98	Unconnected pavement, HSG B
30,000	61	>75% Grass cover, Good, HSG B
43,073	72	Weighted Average
30,000		69.65% Pervious Area
13,073		30.35% Impervious Area
13,073		100.00% Unconnected


Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.9	50	0.0100	0.08		Sheet Flow, Grass: Dense n= 0.240 P2= 3.16"
0.9	52	0.0200	0.99		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.0	5	0.0150	2.49		Shallow Concentrated Flow, Paved Kv= 20.3 fps
0.2	29	0.1250	2.47		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.7	181	0.0500	4.54		Shallow Concentrated Flow, Paved Kv= 20.3 fps
12.7	317	Total			

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
 HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
 Type III 24-hr 10-Year Rainfall=5.11"
 Printed 10/17/2019
 Page 78

Subcatchment P-9B: Building 1/2 Courtyard

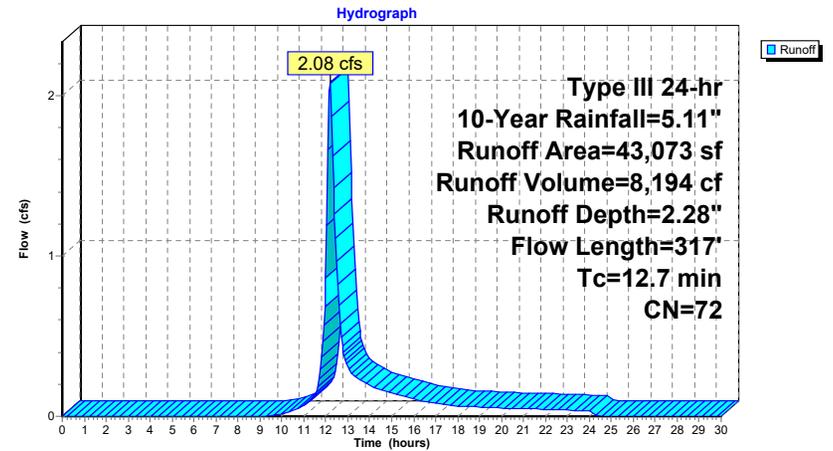

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 79

Summary for Pond UIS1: UIS#1

Inflow Area = 105,247 sf, 53.77% Impervious, Inflow Depth = 3.17" for 10-Year event
Inflow = 6.96 cfs @ 12.10 hrs, Volume= 27,795 cf
Outflow = 3.95 cfs @ 12.31 hrs, Volume= 24,855 cf, Atten= 43%, Lag= 12.9 min
Discarded = 0.09 cfs @ 8.40 hrs, Volume= 8,340 cf
Primary = 3.85 cfs @ 12.31 hrs, Volume= 16,515 cf

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Peak Elev= 137.90' @ 12.31 hrs Surf.Area= 3,388 sf Storage= 8,085 cf

Plug-Flow detention time= 156.8 min calculated for 24,814 cf (89% of inflow)
Center-of-Mass det. time= 105.6 min (904.6 - 799.0)

Volume	Invert	Avail.Storage	Storage Description
#1A	134.50'	4,767 cf	29.92'W x 113.25'L x 5.50'H Field A 18,634 cf Overall - 6,716 cf Embedded = 11,918 cf x 40.0% Voids
#2A	135.25'	6,716 cf	ADS_StormTech MC-3500 d +Cap x 60 Inside #1 Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap 60 Chambers in 4 Rows Cap Storage= +14.9 cf x 2 x 4 rows = 119.2 cf
		11,484 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	135.25'	15.0" Round 15" HDPE L= 408.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 135.25' / 127.09' S= 0.0200' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf
#2	Device 1	136.60'	13.0" Vert. 13" Orifice C= 0.600
#3	Discarded	134.50'	1.205 in/hr Loamy Sand (1/2 Rawls Rate) over Surface area
#4	Device 1	139.75'	4.0' long x 0.5' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 Coef. (English) 2.80 2.92 3.08 3.30 3.32

Discarded OutFlow Max=0.09 cfs @ 8.40 hrs HW=134.56' (Free Discharge)
3=Loamy Sand (1/2 Rawls Rate) (Exfiltration Controls 0.09 cfs)

Primary OutFlow Max=3.85 cfs @ 12.31 hrs HW=137.89' (Free Discharge)
1=15" HDPE (Passes 3.85 cfs of 6.63 cfs potential flow)
2=13" Orifice (Orifice Controls 3.85 cfs @ 4.17 fps)
4=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 80

Pond UIS1: UIS#1 - Chamber Wizard Field A

Chamber Model = ADS_StormTech MC-3500 d +Cap (ADS StormTech® MC-3500 d rev 03/14 with Cap volume)
Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf
Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap
Cap Storage= +14.9 cf x 2 x 4 rows = 119.2 cf

77.0" Wide + 9.0" Spacing = 86.0" C-C Row Spacing


15 Chambers/Row x 7.17' Long +1.85' Cap Length x 2 = 111.25' Row Length +12.0" End Stone x 2 = 113.25' Base Length
4 Rows x 77.0" Wide + 9.0" Spacing x 3 + 12.0" Side Stone x 2 = 29.92' Base Width
9.0" Base + 45.0" Chamber Height + 12.0" Cover = 5.50' Field Height

60 Chambers x 110.0 cf + 14.9 cf Cap Volume x 2 x 4 Rows = 6,716.3 cf Chamber Storage

18,634.3 cf Field - 6,716.3 cf Chambers = 11,918.0 cf Stone x 40.0% Voids = 4,767.2 cf Stone Storage

Chamber Storage + Stone Storage = 11,483.5 cf = 0.264 af
Overall Storage Efficiency = 61.6%
Overall System Size = 113.25' x 29.92' x 5.50'

60 Chambers
690.2 cy Field
441.4 cy Stone




Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 81

Pond UIS1: UIS#1

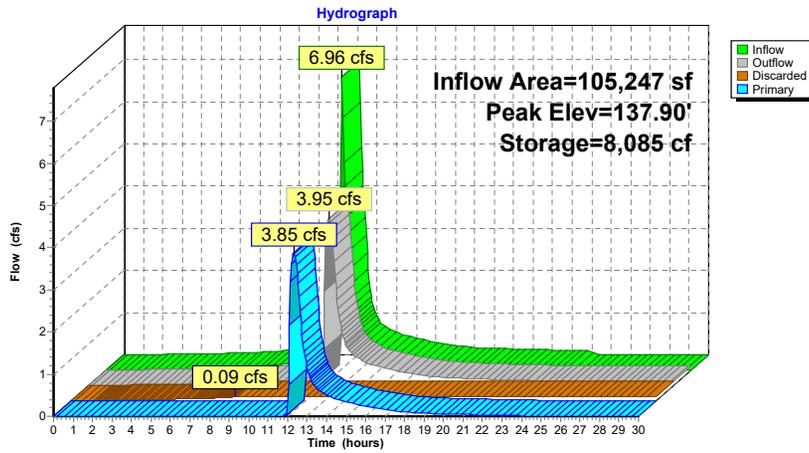

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 82

Summary for Pond UIS2: UIS #2

Inflow Area = 82,517 sf, 74.08% Impervious, Inflow Depth = 3.86" for 10-Year event
 Inflow = 7.69 cfs @ 12.09 hrs, Volume= 26,577 cf
 Outflow = 3.99 cfs @ 12.23 hrs, Volume= 23,613 cf, Atten= 48%, Lag= 8.8 min
 Discarded = 0.10 cfs @ 10.15 hrs, Volume= 9,099 cf
 Primary = 3.89 cfs @ 12.23 hrs, Volume= 14,514 cf

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs / 3
 Peak Elev= 128.52' @ 12.23 hrs Surf.Area= 3,615 sf Storage= 8,935 cf

Plug-Flow detention time= 176.9 min calculated for 23,613 cf (89% of inflow)
 Center-of-Mass det. time= 123.1 min (898.1 - 775.0)

Volume	Invert	Avail. Storage	Storage Description
#1A	125.00'	5,063 cf	29.92'W x 120.42'L x 5.50'H Field A 19,814 cf Overall - 7,156 cf Embedded = 12,658 cf x 40.0% Voids
#2A	125.75'	7,156 cf	ADS_StormTech MC-3500 d +Cap x 64 Inside #1 Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap 64 Chambers in 4 Rows Cap Storage= +14.9 cf x 2 x 4 rows = 119.2 cf
#3	125.75'	82 cf	4.00'D x 6.50'H Vertical Cone/Cylinder
		12,301 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	125.75'	15.0" Round 15" HDPE L= 26.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 125.75' / 125.23' S= 0.0200'/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf
#2	Discarded	125.00'	1.205 in/hr Loamy Sand (1/2 Rawls Rate) over Surface area
#3	Device 1	127.10'	12.5" Vert. 13" Orifice C= 0.600

Discarded OutFlow Max=0.10 cfs @ 10.15 hrs HW=125.75' (Free Discharge)
 ↳2=Loamy Sand (1/2 Rawls Rate) (Exfiltration Controls 0.10 cfs)

Primary OutFlow Max=3.88 cfs @ 12.23 hrs HW=128.51' (Free Discharge)
 ↳1=15" HDPE (Passes 3.88 cfs of 6.82 cfs potential flow)
 ↳3=13" Orifice (Orifice Controls 3.88 cfs @ 4.55 fps)

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 83

Pond UIS2: UIS #2 - Chamber Wizard Field A

Chamber Model = ADS_StormTech MC-3500 d +Cap (ADS StormTech® MC-3500 d rev 03/14 with Cap volume)

Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf
Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap
Cap Storage= +14.9 cf x 2 x 4 rows = 119.2 cf

77.0" Wide + 9.0" Spacing = 86.0" C-C Row Spacing


16 Chambers/Row x 7.17' Long +1.85' Cap Length x 2 = 118.42' Row Length +12.0" End Stone x 2 = 120.42' Base Length
4 Rows x 77.0" Wide + 9.0" Spacing x 3 + 12.0" Side Stone x 2 = 29.92' Base Width
9.0" Base + 45.0" Chamber Height + 12.0" Cover = 5.50' Field Height

64 Chambers x 110.0 cf + 14.9 cf Cap Volume x 2 x 4 Rows = 7,156.1 cf Chamber Storage

19,814.1 cf Field - 7,156.1 cf Chambers = 12,658.0 cf Stone x 40.0% Voids = 5,063.2 cf Stone Storage

Chamber Storage + Stone Storage = 12,219.3 cf = 0.281 af
Overall Storage Efficiency = 61.7%
Overall System Size = 120.42' x 29.92' x 5.50'

64 Chambers
733.9 cy Field
468.8 cy Stone




Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 84

Pond UIS2: UIS #2

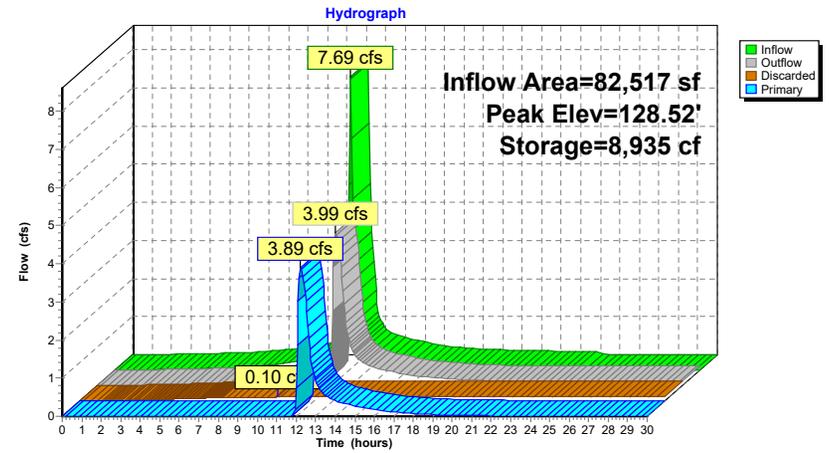

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 85

Summary for Pond UIS3: MC-3500

Inflow Area = 91,436 sf, 58.05% Impervious, Inflow Depth = 3.28" for 10-Year event
Inflow = 6.54 cfs @ 12.10 hrs, Volume= 25,004 cf
Outflow = 2.92 cfs @ 12.39 hrs, Volume= 21,753 cf, Atten= 55%, Lag= 17.0 min
Discarded = 0.11 cfs @ 8.85 hrs, Volume= 9,364 cf
Primary = 2.81 cfs @ 12.39 hrs, Volume= 12,389 cf

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Peak Elev= 127.15' @ 12.39 hrs Surf.Area= 3,934 sf Storage= 8,753 cf

Plug-Flow detention time= 196.5 min calculated for 21,717 cf (87% of inflow)
Center-of-Mass det. time= 137.4 min (935.2 - 797.8)

Volume	Invert	Avail.Storage	Storage Description
#1A	124.00'	5,516 cf	37.08'W x 106.08'L x 5.50'H Field A 21,636 cf Overall - 7,846 cf Embedded = 13,790 cf x 40.0% Voids
#2A	124.75'	7,846 cf	ADS_StormTech MC-3500 d +Cap x 70 Inside #1 Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap 70 Chambers in 5 Rows Cap Storage= +14.9 cf x 2 x 5 rows = 149.0 cf
		13,362 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	124.75'	15.0" Round 15" HDPE L= 44.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 124.75' / 124.31' S= 0.0100' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf
#2	Device 1	126.10'	12.0" Vert. 12" Orifice C= 0.600
#3	Discarded	124.00'	1.205 in/hr Loamy Sand (1/2 Rawls Rate) over Surface area
#4	Device 1	129.50'	4.0' long x 0.5' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 Coef. (English) 2.80 2.92 3.08 3.30 3.32

Discarded OutFlow Max=0.11 cfs @ 8.85 hrs HW=124.06' (Free Discharge)
3=Loamy Sand (1/2 Rawls Rate) (Exfiltration Controls 0.11 cfs)

Primary OutFlow Max=2.81 cfs @ 12.39 hrs HW=127.15' (Free Discharge)
1=15" HDPE (Passes 2.81 cfs of 6.22 cfs potential flow)
2=12" Orifice (Orifice Controls 2.81 cfs @ 3.58 fps)
4=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 86

Pond UIS3: MC-3500 - Chamber Wizard Field A

Chamber Model = ADS_StormTech MC-3500 d +Cap (ADS StormTech® MC-3500 d rev 03/14 with Cap volume)
Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf
Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap
Cap Storage= +14.9 cf x 2 x 5 rows = 149.0 cf

77.0" Wide + 9.0" Spacing = 86.0" C-C Row Spacing


14 Chambers/Row x 7.17' Long +1.85' Cap Length x 2 = 104.08' Row Length +12.0" End Stone x 2 = 106.08' Base Length
5 Rows x 77.0" Wide + 9.0" Spacing x 4 + 12.0" Side Stone x 2 = 37.08' Base Width
9.0" Base + 45.0" Chamber Height + 12.0" Cover = 5.50' Field Height

70 Chambers x 110.0 cf + 14.9 cf Cap Volume x 2 x 5 Rows = 7,845.6 cf Chamber Storage

21,635.9 cf Field - 7,845.6 cf Chambers = 13,790.3 cf Stone x 40.0% Voids = 5,516.1 cf Stone Storage

Chamber Storage + Stone Storage = 13,361.7 cf = 0.307 af
Overall Storage Efficiency = 61.8%
Overall System Size = 106.08' x 37.08' x 5.50'

70 Chambers
801.3 cy Field
510.8 cy Stone

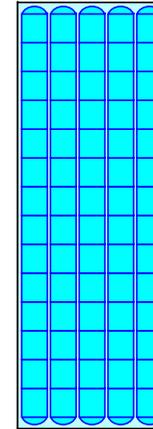


Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 87

Pond UIS3: MC-3500

Hydrograph

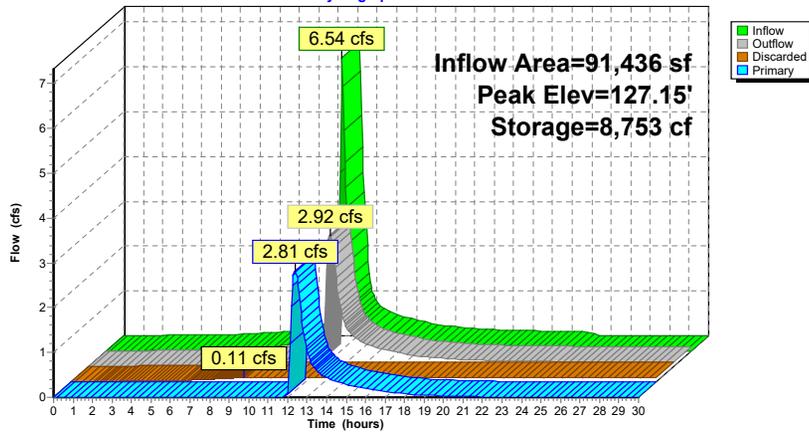

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 88


Summary for Link SP-1: Study Point #1

Inflow Area = 151,489 sf, 40.35% Impervious, Inflow Depth = 1.68" for 10-Year event
Inflow = 5.27 cfs @ 12.17 hrs, Volume= 21,203 cf
Primary = 5.27 cfs @ 12.17 hrs, Volume= 21,203 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs

Link SP-1: Study Point #1

Hydrograph

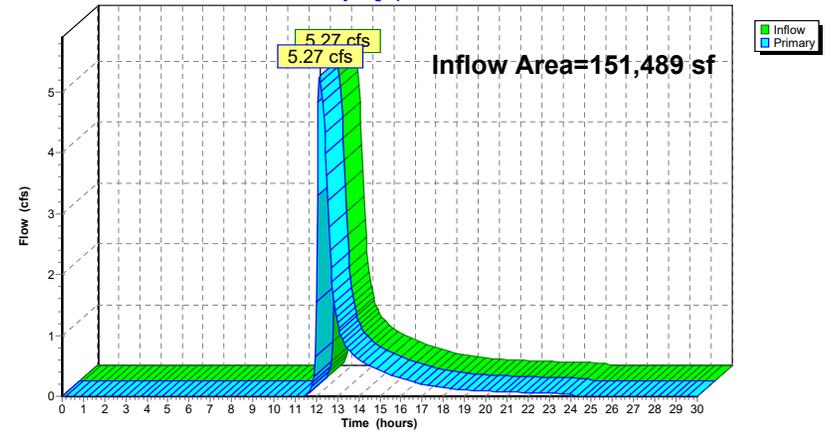

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 10-Year Rainfall=5.11"
Printed 10/17/2019
Page 89


Summary for Link SP-2: Study Point #2

Inflow Area = 209,308 sf, 55.37% Impervious, Inflow Depth = 1.83" for 10-Year event
Inflow = 7.02 cfs @ 12.33 hrs, Volume= 31,951 cf
Primary = 7.02 cfs @ 12.33 hrs, Volume= 31,951 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs

Link SP-2: Study Point #2

Hydrograph

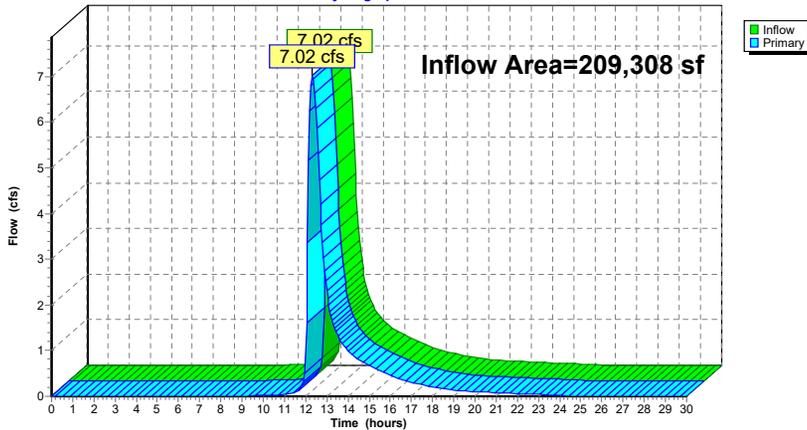

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 90

Time span=0.00-30.00 hrs, dt=0.05 hrs, 601 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment P-1: Off-site Runoff Northwest	Runoff Area=68,972 sf 0.00% Impervious Runoff Depth=3.02" Tc=6.0 min CN=57 Runoff=5.35 cfs 17,337 cf
Subcatchment P-10: Building 2/3 - South Parking	Runoff Area=32,520 sf 54.92% Impervious Runoff Depth=5.76" Tc=6.0 min CN=81 Runoff=4.84 cfs 15,613 cf
Subcatchment P-11: Building 1 - Southeast	Runoff Area=12,625 sf 49.31% Impervious Runoff Depth=5.53" Tc=6.0 min CN=79 Runoff=1.81 cfs 5,814 cf
Subcatchment P-2: Building 2 Parking - North	Runoff Area=36,597 sf 82.74% Impervious Runoff Depth=7.06" Tc=6.0 min CN=92 Runoff=6.25 cfs 21,541 cf
Subcatchment P-3: Building 1 Parking - East	Runoff Area=26,061 sf 67.95% Impervious Runoff Depth=6.35" Tc=6.0 min CN=86 Runoff=4.18 cfs 13,792 cf
Subcatchment P-4: Building 3 - West	Runoff Area=16,268 sf 0.00% Impervious Runoff Depth=3.46" Flow Length=322' Tc=8.6 min CN=61 Runoff=1.34 cfs 4,691 cf
Subcatchment P-5A: Building 3 Roof - North	Runoff Area=13,281 sf 100.00% Impervious Runoff Depth=7.78" Tc=6.0 min CN=98 Runoff=2.34 cfs 8,611 cf
Subcatchment P-5B: Building 3 Roof - South	Runoff Area=14,024 sf 100.00% Impervious Runoff Depth=7.78" Tc=6.0 min CN=98 Runoff=2.48 cfs 9,092 cf
Subcatchment P-6A: Building 2 Roof - North	Runoff Area=14,496 sf 100.00% Impervious Runoff Depth=7.78" Tc=6.0 min CN=98 Runoff=2.56 cfs 9,398 cf
Subcatchment P-6B: Building 2 Roof - South	Runoff Area=14,509 sf 100.00% Impervious Runoff Depth=7.78" Tc=6.0 min CN=98 Runoff=2.56 cfs 9,407 cf
Subcatchment P-7: Building 1	Runoff Area=22,302 sf 100.00% Impervious Runoff Depth=7.78" Tc=6.0 min CN=98 Runoff=3.94 cfs 14,459 cf
Subcatchment P-8: Pool Courtyard	Runoff Area=27,926 sf 36.53% Impervious Runoff Depth=5.06" Flow Length=267' Slope=0.0200 ' / Tc=21.6 min CN=75 Runoff=2.47 cfs 11,775 cf
Subcatchment P-9A: Area Drains - Courtyard	Runoff Area=18,143 sf 16.94% Impervious Runoff Depth=3.80" Tc=6.0 min UI Adjusted CN=64 Runoff=1.81 cfs 5,741 cf
Subcatchment P-9B: Building 1/2 Courtyard	Runoff Area=43,073 sf 30.35% Impervious Runoff Depth=4.71" Flow Length=317' Tc=12.7 min CN=72 Runoff=4.35 cfs 16,913 cf
Pond UIS1: UIS#1	Peak Elev=140.02' Storage=11,484 cf Inflow=12.54 cfs 50,577 cf Discarded=0.09 cfs 9,005 cf Primary=9.01 cfs 38,478 cf Outflow=9.11 cfs 47,483 cf
Pond UIS2: UIS #2	Peak Elev=130.63' Storage=12,281 cf Inflow=12.96 cfs 45,291 cf Discarded=0.10 cfs 9,793 cf Primary=7.11 cfs 32,100 cf Outflow=7.21 cfs 41,893 cf

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 91

Pond UIS3: MC-3500

Peak Elev=129.47' Storage=13,314 cf Inflow=11.64 cfs 45,165 cf
Discarded=0.11 cfs 10,125 cf Primary=6.41 cfs 31,494 cf Outflow=6.52 cfs 41,619 cf

Link SP-1: Study Point #1

Inflow=11.62 cfs 49,437 cf
Primary=11.62 cfs 49,437 cf

Link SP-2: Study Point #2

Inflow=16.18 cfs 75,786 cf
Primary=16.18 cfs 75,786 cf

Total Runoff Area = 360,797 sf Runoff Volume = 164,186 cf Average Runoff Depth = 5.46"
50.93% Pervious = 183,765 sf 49.07% Impervious = 177,032 sf

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 92

Summary for Subcatchment P-1: Off-site Runoff Northwest


Runoff = 5.35 cfs @ 12.10 hrs, Volume= 17,337 cf, Depth= 3.02"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 100-Year Rainfall=8.02"

Area (sf)	CN	Description
3,360	39	>75% Grass cover, Good, HSG A
31,665	61	>75% Grass cover, Good, HSG B
33,947	55	Woods, Good, HSG B
68,972	57	Weighted Average
68,972		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-1: Off-site Runoff Northwest

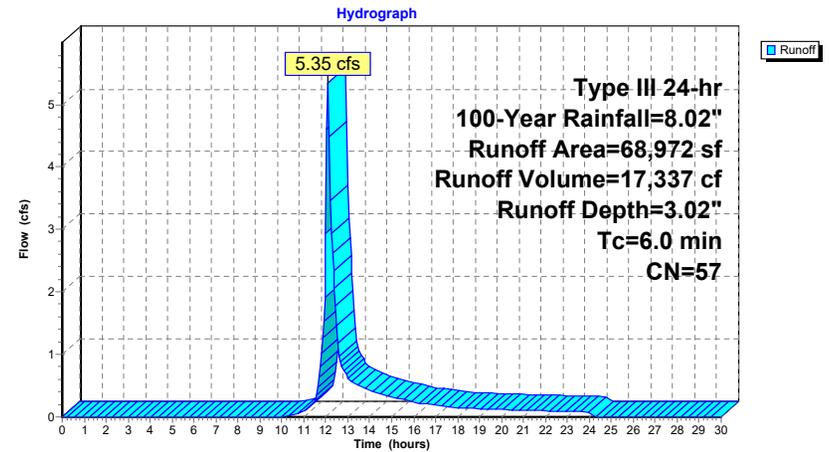

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 93

Summary for Subcatchment P-10: Building 2/3 - South Parking

Tc of 4.6 rounds to minimum of 5.0. Use Tc = 5.0 minutes for E-2.


Runoff = 4.84 cfs @ 12.09 hrs, Volume= 15,613 cf, Depth= 5.76"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 100-Year Rainfall=8.02"

Area (sf)	CN	Description
17,860	98	Paved parking, HSG B
14,660	61	>75% Grass cover, Good, HSG B
32,520	81	Weighted Average
14,660		45.08% Pervious Area
17,860		54.92% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc

Subcatchment P-10: Building 2/3 - South Parking

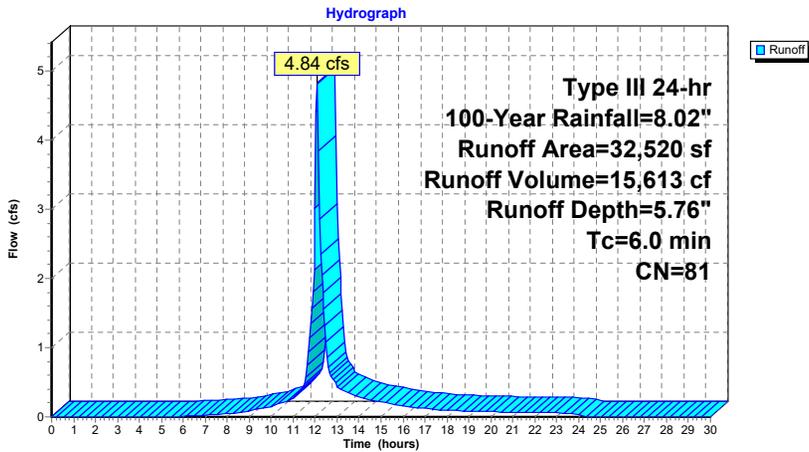

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 94

Summary for Subcatchment P-11: Building 1 - Southeast

Tc of 4.6 rounds to minimum of 5.0. Use Tc = 5.0 minutes for E-2.


Runoff = 1.81 cfs @ 12.09 hrs, Volume= 5,814 cf, Depth= 5.53"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 100-Year Rainfall=8.02"

Area (sf)	CN	Description
6,226	98	Paved parking, HSG B
6,399	61	>75% Grass cover, Good, HSG B
12,625	79	Weighted Average
6,399		50.69% Pervious Area
6,226		49.31% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc

Subcatchment P-11: Building 1 - Southeast

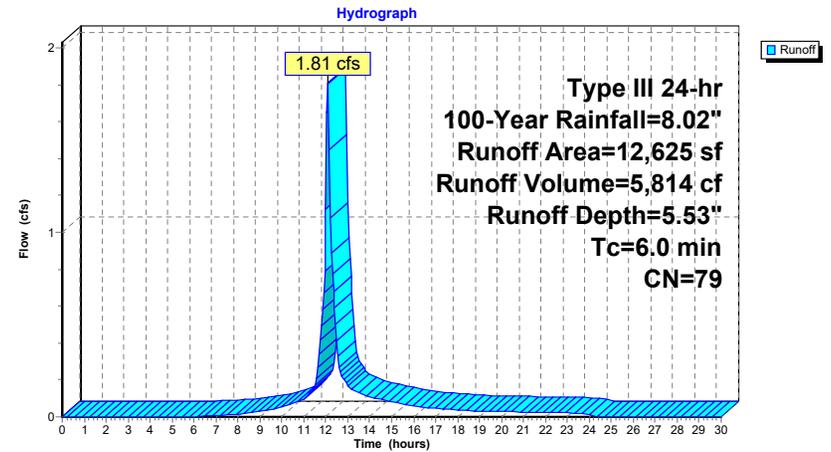

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 95

Summary for Subcatchment P-2: Building 2 Parking - North

Tc of 4.6 rounds to minimum of 5.0. Use Tc = 5.0 minutes for E-2.


Runoff = 6.25 cfs @ 12.09 hrs, Volume= 21,541 cf, Depth= 7.06"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 100-Year Rainfall=8.02"

Area (sf)	CN	Description
30,279	98	Paved parking, HSG B
6,318	61	>75% Grass cover, Good, HSG B
36,597	92	Weighted Average
6,318		17.26% Pervious Area
30,279		82.74% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc

Subcatchment P-2: Building 2 Parking - North

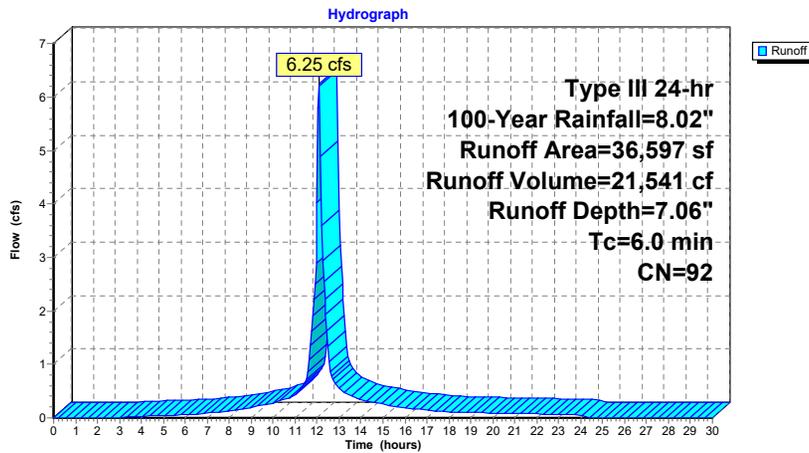

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 96

Summary for Subcatchment P-3: Building 1 Parking - East


Runoff = 4.18 cfs @ 12.09 hrs, Volume= 13,792 cf, Depth= 6.35"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 100-Year Rainfall=8.02"

Area (sf)	CN	Description
17,708	98	Unconnected pavement, HSG B
8,353	61	>75% Grass cover, Good, HSG B
26,061	86	Weighted Average
8,353		32.05% Pervious Area
17,708		67.95% Impervious Area
17,708		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-3: Building 1 Parking - East

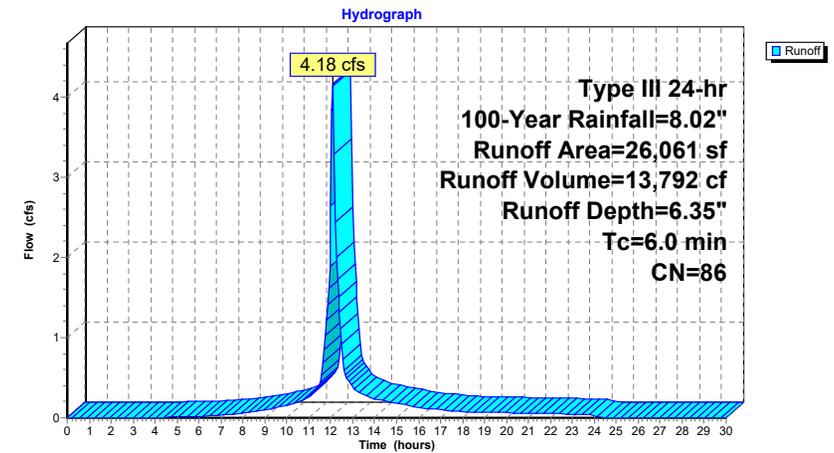

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 97


Summary for Subcatchment P-4: Building 3 - West

Runoff = 1.34 cfs @ 12.13 hrs, Volume= 4,691 cf, Depth= 3.46"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 100-Year Rainfall=8.02"

Area (sf)	CN	Description
0	98	Unconnected pavement, HSG B
16,268	61	>75% Grass cover, Good, HSG B
16,268	61	Weighted Average
16,268		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.2	50	0.0200	0.10		Sheet Flow, Grass: Dense n= 0.240 P2= 3.16"
0.4	272	0.0350	11.12	215.66	Trap/Vee/Rect Channel Flow, Bot.W=6.00' D=2.00' Z= 0.7 & 3.0' Top.W=13.40' n= 0.030 Earth, grassed & winding
8.6	322	Total			

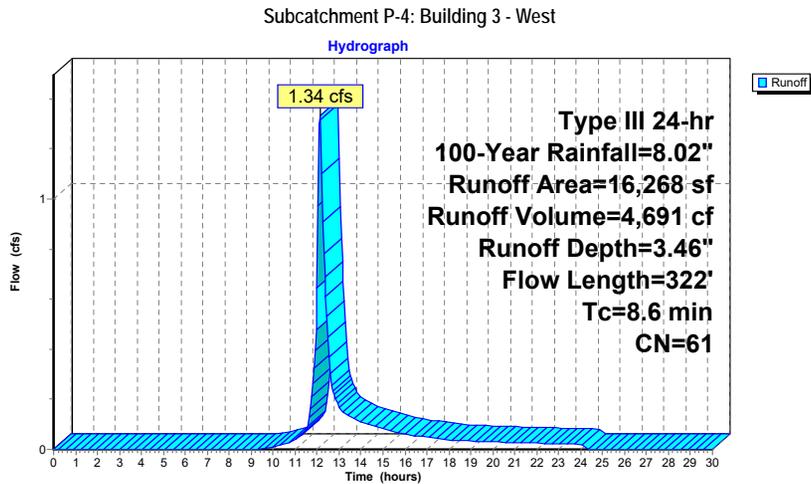

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 98

Summary for Subcatchment P-5A: Building 3 Roof - North


Runoff = 2.34 cfs @ 12.09 hrs, Volume= 8,611 cf, Depth= 7.78"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 100-Year Rainfall=8.02"

Area (sf)	CN	Description
13,281	98	Unconnected pavement, HSG B
13,281		100.00% Impervious Area
13,281		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-5A: Building 3 Roof - North

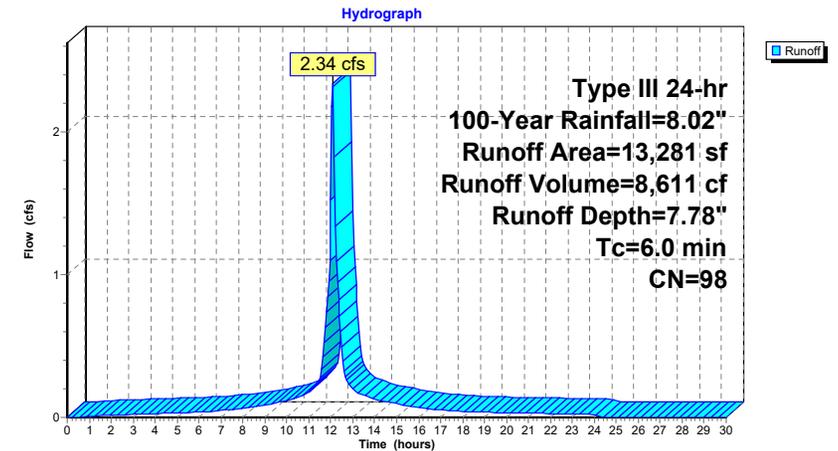

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 99

Summary for Subcatchment P-5B: Building 3 Roof - South


Runoff = 2.48 cfs @ 12.09 hrs, Volume= 9,092 cf, Depth= 7.78"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 100-Year Rainfall=8.02"

Area (sf)	CN	Description
14,024	98	Unconnected pavement, HSG B
14,024		100.00% Impervious Area
14,024		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-5B: Building 3 Roof - South

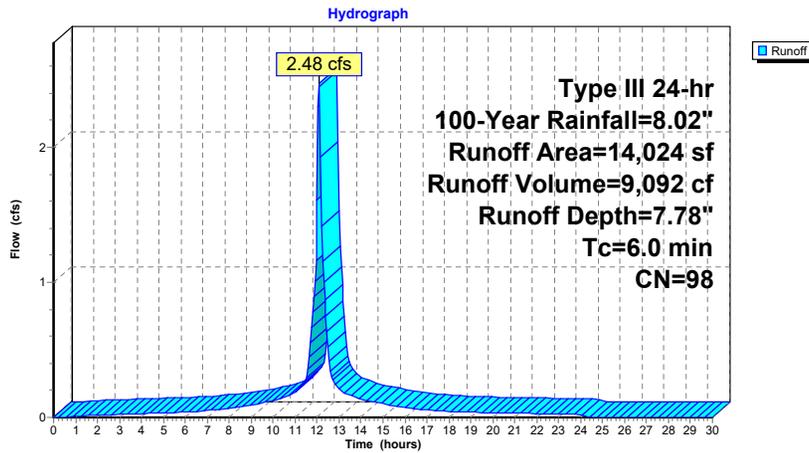

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 100

Summary for Subcatchment P-6A: Building 2 Roof - North


Runoff = 2.56 cfs @ 12.09 hrs, Volume= 9,398 cf, Depth= 7.78"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 100-Year Rainfall=8.02"

Area (sf)	CN	Description
14,496	98	Unconnected pavement, HSG B
14,496		100.00% Impervious Area
14,496		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-6A: Building 2 Roof - North

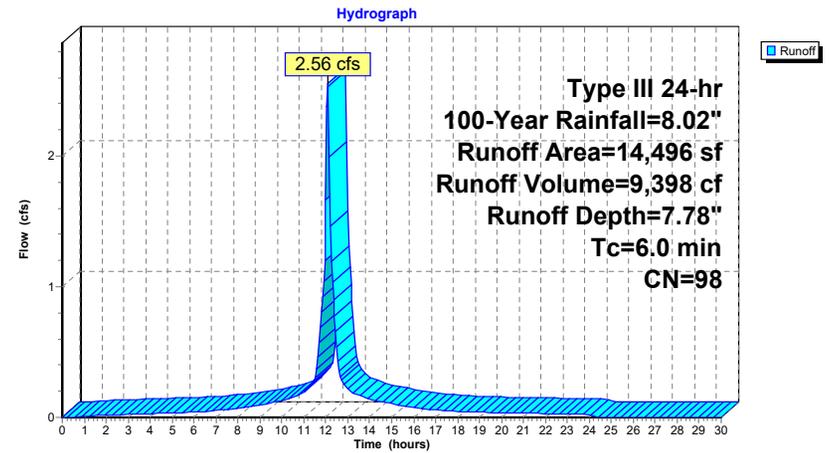

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 101

Summary for Subcatchment P-6B: Building 2 Roof - South


Runoff = 2.56 cfs @ 12.09 hrs, Volume= 9,407 cf, Depth= 7.78"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 100-Year Rainfall=8.02"

Area (sf)	CN	Description
14,509	98	Unconnected pavement, HSG B
14,509		100.00% Impervious Area
14,509		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-6B: Building 2 Roof - South

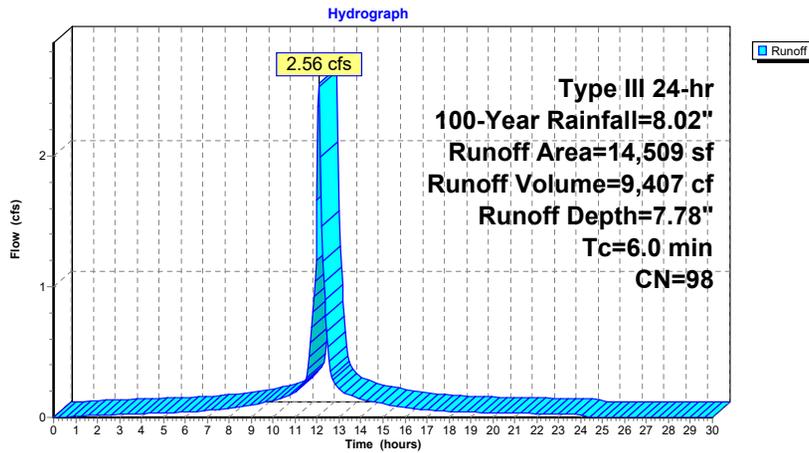

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 102

Summary for Subcatchment P-7: Building 1


Runoff = 3.94 cfs @ 12.09 hrs, Volume= 14,459 cf, Depth= 7.78"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 100-Year Rainfall=8.02"

Area (sf)	CN	Description
22,302	98	Unconnected pavement, HSG B
22,302		100.00% Impervious Area
22,302		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc.

Subcatchment P-7: Building 1

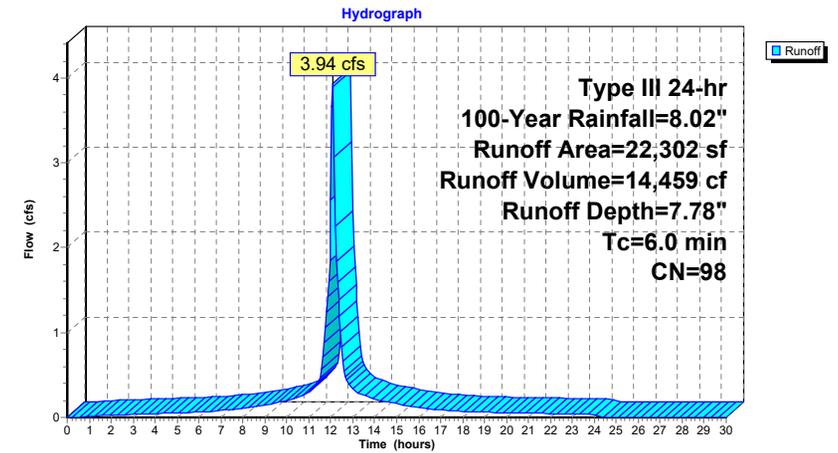

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 103

Summary for Subcatchment P-8: Pool Courtyard


Runoff = 2.47 cfs @ 12.30 hrs, Volume= 11,775 cf, Depth= 5.06"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 100-Year Rainfall=8.02"

Area (sf)	CN	Description
10,200	98	Unconnected pavement, HSG B
17,726	61	>75% Grass cover, Good, HSG B
27,926	75	Weighted Average
17,726		63.47% Pervious Area
10,200		36.53% Impervious Area
10,200		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
21.6	267	0.0200	0.21		Sheet Flow, Grass: Short n= 0.150 P2= 3.16"

Subcatchment P-8: Pool Courtyard

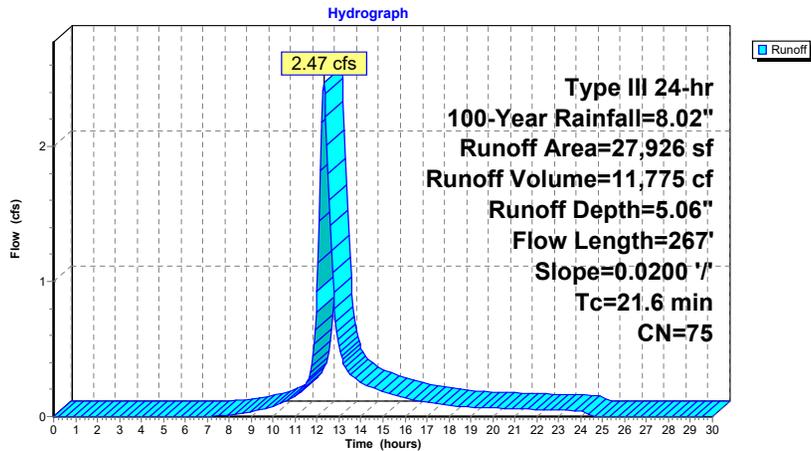

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 104

Summary for Subcatchment P-9A: Area Drains - Courtyard

Tc of 4.6 rounds to minimum of 5.0. Use Tc = 5.0 minutes for E-2.


Runoff = 1.81 cfs @ 12.09 hrs, Volume= 5,741 cf, Depth= 3.80"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 100-Year Rainfall=8.02"

Area (sf)	CN	Adj	Description
3,074	98		Unconnected pavement, HSG B
15,069	61		>75% Grass cover, Good, HSG B
18,143	67	64	Weighted Average, UI Adjusted
15,069			83.06% Pervious Area
3,074			16.94% Impervious Area
3,074			100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Min. Tc

Subcatchment P-9A: Area Drains - Courtyard

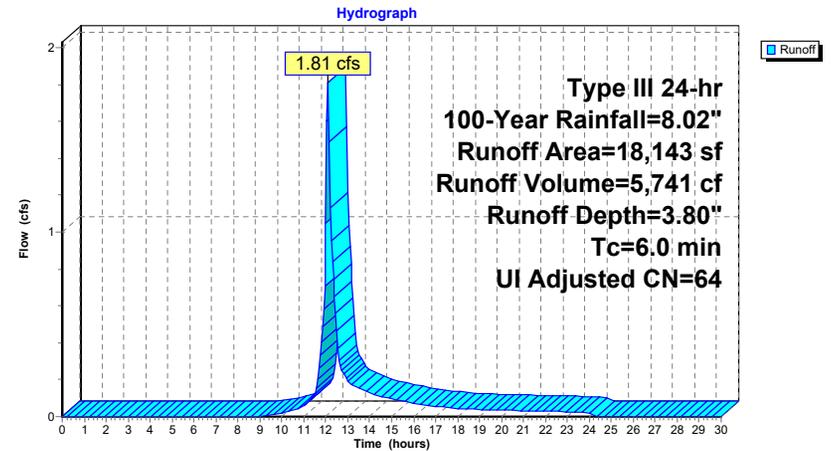

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 105

Summary for Subcatchment P-9B: Building 1/2 Courtyard

Runoff = 4.35 cfs @ 12.18 hrs, Volume= 16,913 cf, Depth= 4.71"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Type III 24-hr 100-Year Rainfall=8.02"

Area (sf)	CN	Description
13,073	98	Unconnected pavement, HSG B
30,000	61	>75% Grass cover, Good, HSG B
43,073	72	Weighted Average
30,000		69.65% Pervious Area
13,073		30.35% Impervious Area
13,073		100.00% Unconnected


Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.9	50	0.0100	0.08		Sheet Flow, Grass: Dense n= 0.240 P2= 3.16"
0.9	52	0.0200	0.99		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.0	5	0.0150	2.49		Shallow Concentrated Flow, Paved Kv= 20.3 fps
0.2	29	0.1250	2.47		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.7	181	0.0500	4.54		Shallow Concentrated Flow, Paved Kv= 20.3 fps
12.7	317	Total			

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 106

Subcatchment P-9B: Building 1/2 Courtyard

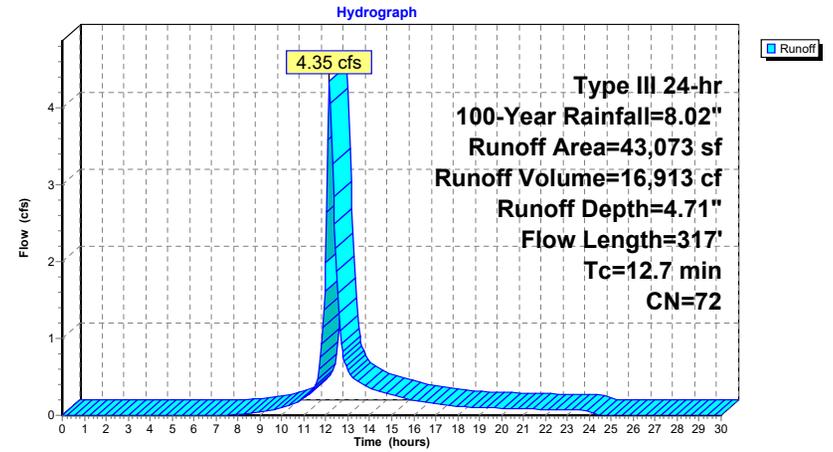

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 107

Summary for Pond UIS1: UIS#1

Inflow Area = 105,247 sf, 53.77% Impervious, Inflow Depth = 5.77" for 100-Year event
Inflow = 12.54 cfs @ 12.10 hrs, Volume= 50,577 cf
Outflow = 9.11 cfs @ 12.22 hrs, Volume= 47,483 cf, Atten= 27%, Lag= 7.1 min
Discarded = 0.09 cfs @ 6.50 hrs, Volume= 9,005 cf
Primary = 9.01 cfs @ 12.22 hrs, Volume= 38,478 cf

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Peak Elev= 140.02' @ 12.22 hrs Surf.Area= 3,388 sf Storage= 11,484 cf

Plug-Flow detention time= 102.0 min calculated for 47,483 cf (94% of inflow)
Center-of-Mass det. time= 68.1 min (857.7 - 789.5)

Volume	Invert	Avail. Storage	Storage Description
#1A	134.50'	4,767 cf	29.92'W x 113.25'L x 5.50'H Field A 18,634 cf Overall - 6,716 cf Embedded = 11,918 cf x 40.0% Voids
#2A	135.25'	6,716 cf	ADS_StormTech MC-3500 d +Cap x 60 Inside #1 Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap 60 Chambers in 4 Rows Cap Storage= +14.9 cf x 2 x 4 rows = 119.2 cf
		11,484 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	135.25'	15.0" Round 15" HDPE L= 408.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 135.25' / 127.09' S= 0.0200' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf
#2	Device 1	136.60'	13.0" Vert. 13" Orifice C= 0.600
#3	Discarded	134.50'	1.205 in/hr Loamy Sand (1/2 Rawls Rate) over Surface area
#4	Device 1	139.75'	4.0' long x 0.5' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 Coef. (English) 2.80 2.92 3.08 3.30 3.32

Discarded OutFlow Max=0.09 cfs @ 6.50 hrs HW=134.56' (Free Discharge)
↳3=Loamy Sand (1/2 Rawls Rate) (Exfiltration Controls 0.09 cfs)

Primary OutFlow Max=8.78 cfs @ 12.22 hrs HW=139.99' (Free Discharge)
↳1=15" HDPE (Passes 8.78 cfs of 9.46 cfs potential flow)
↳2=13" Orifice (Orifice Controls 7.48 cfs @ 8.12 fps)
↳4=Broad-Crested Rectangular Weir (Weir Controls 1.29 cfs @ 1.37 fps)

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 108

Pond UIS1: UIS#1 - Chamber Wizard Field A

Chamber Model = ADS_StormTech MC-3500 d +Cap (ADS StormTech® MC-3500 d rev 03/14 with Cap volume)
Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf
Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap
Cap Storage= +14.9 cf x 2 x 4 rows = 119.2 cf

77.0" Wide + 9.0" Spacing = 86.0" C-C Row Spacing


15 Chambers/Row x 7.17' Long +1.85' Cap Length x 2 = 111.25' Row Length +12.0" End Stone x 2 = 113.25' Base Length
4 Rows x 77.0" Wide + 9.0" Spacing x 3 + 12.0" Side Stone x 2 = 29.92' Base Width
9.0" Base + 45.0" Chamber Height + 12.0" Cover = 5.50' Field Height

60 Chambers x 110.0 cf + 14.9 cf Cap Volume x 2 x 4 Rows = 6,716.3 cf Chamber Storage

18,634.3 cf Field - 6,716.3 cf Chambers = 11,918.0 cf Stone x 40.0% Voids = 4,767.2 cf Stone Storage

Chamber Storage + Stone Storage = 11,483.5 cf = 0.264 af
Overall Storage Efficiency = 61.6%
Overall System Size = 113.25' x 29.92' x 5.50'

60 Chambers
690.2 cy Field
441.4 cy Stone




Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 109

Pond UIS1: UIS#1

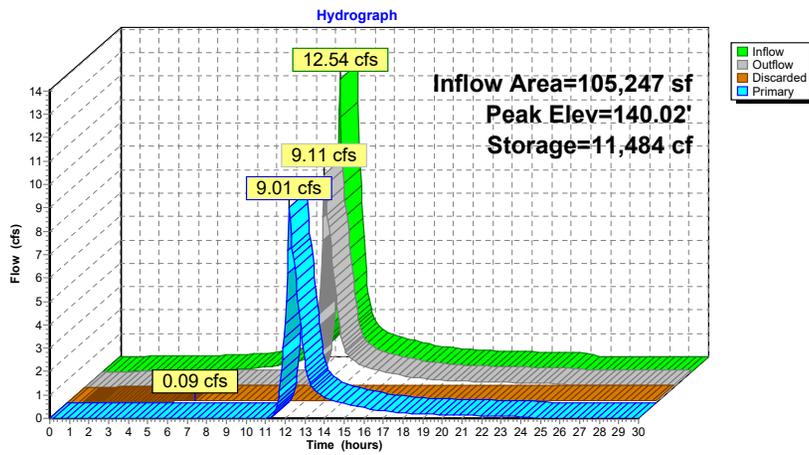

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 110

Summary for Pond UIS2: UIS #2

Inflow Area = 82,517 sf, 74.08% Impervious, Inflow Depth = 6.59" for 100-Year event
 Inflow = 12.96 cfs @ 12.09 hrs, Volume= 45,291 cf
 Outflow = 7.21 cfs @ 12.20 hrs, Volume= 41,893 cf, Atten= 44%, Lag= 6.9 min
 Discarded = 0.10 cfs @ 8.50 hrs, Volume= 9,793 cf
 Primary = 7.11 cfs @ 12.20 hrs, Volume= 32,100 cf

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs / 3
 Peak Elev= 130.63' @ 12.20 hrs Surf.Area= 3,615 sf Storage= 12,281 cf

Plug-Flow detention time= 123.8 min calculated for 41,824 cf (92% of inflow)
 Center-of-Mass det. time= 84.5 min (851.1 - 766.6)

Volume	Invert	Avail. Storage	Storage Description
#1A	125.00'	5,063 cf	29.92'W x 120.42'L x 5.50'H Field A 19,814 cf Overall - 7,156 cf Embedded = 12,658 cf x 40.0% Voids
#2A	125.75'	7,156 cf	ADS_StormTech MC-3500 d +Cap x 64 Inside #1 Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap 64 Chambers in 4 Rows Cap Storage= +14.9 cf x 2 x 4 rows = 119.2 cf
#3	125.75'	82 cf	4.00'D x 6.50'H Vertical Cone/Cylinder
		12,301 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	125.75'	15.0" Round 15" HDPE L= 26.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 125.75' / 125.23' S= 0.0200 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf
#2	Discarded	125.00'	1.205 in/hr Loamy Sand (1/2 Rawls Rate) over Surface area
#3	Device 1	127.10'	12.5" Vert. 13" Orifice C= 0.600

Discarded OutFlow Max=0.10 cfs @ 8.50 hrs HW=125.76' (Free Discharge)
 ↳2=Loamy Sand (1/2 Rawls Rate) (Exfiltration Controls 0.10 cfs)

Primary OutFlow Max=7.10 cfs @ 12.20 hrs HW=130.61' (Free Discharge)
 ↳1=15" HDPE (Passes 7.10 cfs of 9.60 cfs potential flow)
 ↳3=13" Orifice (Orifice Controls 7.10 cfs @ 8.33 fps)

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 111

Pond UIS2: UIS #2 - Chamber Wizard Field A

Chamber Model = ADS_StormTech MC-3500 d +Cap (ADS StormTech® MC-3500 d rev 03/14 with Cap volume)

Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf

Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap

Cap Storage= +14.9 cf x 2 x 4 rows = 119.2 cf

77.0" Wide + 9.0" Spacing = 86.0" C-C Row Spacing

16 Chambers/Row x 7.17' Long +1.85' Cap Length x 2 = 118.42' Row Length +12.0" End Stone x 2 = 120.42' Base Length

4 Rows x 77.0" Wide + 9.0" Spacing x 3 + 12.0" Side Stone x 2 = 29.92' Base Width

9.0" Base + 45.0" Chamber Height + 12.0" Cover = 5.50' Field Height

64 Chambers x 110.0 cf + 14.9 cf Cap Volume x 2 x 4 Rows = 7,156.1 cf Chamber Storage

19,814.1 cf Field - 7,156.1 cf Chambers = 12,658.0 cf Stone x 40.0% Voids = 5,063.2 cf Stone Storage

Chamber Storage + Stone Storage = 12,219.3 cf = 0.281 af


Overall Storage Efficiency = 61.7%

Overall System Size = 120.42' x 29.92' x 5.50'

64 Chambers

733.9 cy Field

468.8 cy Stone




Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 112

Pond UIS2: UIS #2

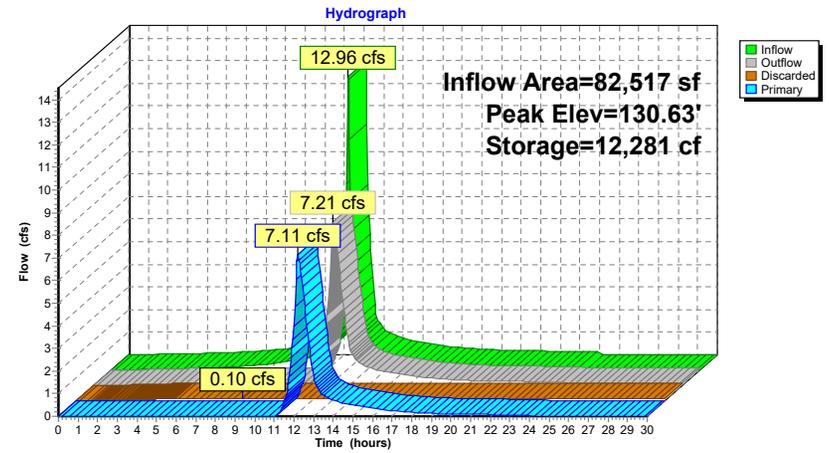

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 113

Summary for Pond UIS3: MC-3500

Inflow Area = 91,436 sf, 58.05% Impervious, Inflow Depth = 5.93" for 100-Year event
Inflow = 11.64 cfs @ 12.10 hrs, Volume= 45,165 cf
Outflow = 6.52 cfs @ 12.31 hrs, Volume= 41,619 cf, Atten= 44%, Lag= 12.2 min
Discarded = 0.11 cfs @ 7.10 hrs, Volume= 10,125 cf
Primary = 6.41 cfs @ 12.31 hrs, Volume= 31,494 cf

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs
Peak Elev= 129.47' @ 12.31 hrs Surf.Area= 3,934 sf Storage= 13,314 cf

Plug-Flow detention time= 126.7 min calculated for 41,619 cf (92% of inflow)
Center-of-Mass det. time= 85.4 min (872.8 - 787.4)

Volume	Invert	Avail.Storage	Storage Description
#1A	124.00'	5,516 cf	37.08'W x 106.08'L x 5.50'H Field A 21,636 cf Overall - 7,846 cf Embedded = 13,790 cf x 40.0% Voids
#2A	124.75'	7,846 cf	ADS_StormTech MC-3500 d +Cap x 70 Inside #1 Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap 70 Chambers in 5 Rows Cap Storage= +14.9 cf x 2 x 5 rows = 149.0 cf
			13,362 cf Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	124.75'	15.0" Round 15" HDPE L= 44.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 124.75' / 124.31' S= 0.0100' /' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf
#2	Device 1	126.10'	12.0" Vert. 12" Orifice C= 0.600
#3	Discarded	124.00'	1.205 in/hr Loamy Sand (1/2 Rawls Rate) over Surface area
#4	Device 1	129.50'	4.0' long x 0.5' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 Coef. (English) 2.80 2.92 3.08 3.30 3.32

Discarded OutFlow Max=0.11 cfs @ 7.10 hrs HW=124.06' (Free Discharge)
↳3=Loamy Sand (1/2 Rawls Rate) (Exfiltration Controls 0.11 cfs)

Primary OutFlow Max=6.40 cfs @ 12.31 hrs HW=129.46' (Free Discharge)
↳1=15" HDPE (Passes 6.40 cfs of 9.43 cfs potential flow)
↳2=12" Orifice (Orifice Controls 6.40 cfs @ 8.15 fps)
↳4=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 114

Pond UIS3: MC-3500 - Chamber Wizard Field A

Chamber Model = ADS_StormTech MC-3500 d +Cap (ADS StormTech® MC-3500 d rev 03/14 with Cap volume)
Effective Size= 70.4"W x 45.0"H => 15.33 sf x 7.17'L = 110.0 cf
Overall Size= 77.0"W x 45.0"H x 7.50'L with 0.33' Overlap
Cap Storage= +14.9 cf x 2 x 5 rows = 149.0 cf

77.0" Wide + 9.0" Spacing = 86.0" C-C Row Spacing


14 Chambers/Row x 7.17' Long +1.85' Cap Length x 2 = 104.08' Row Length +12.0" End Stone x 2 = 106.08' Base Length
5 Rows x 77.0" Wide + 9.0" Spacing x 4 + 12.0" Side Stone x 2 = 37.08' Base Width
9.0" Base + 45.0" Chamber Height + 12.0" Cover = 5.50' Field Height

70 Chambers x 110.0 cf + 14.9 cf Cap Volume x 2 x 5 Rows = 7,845.6 cf Chamber Storage

21,635.9 cf Field - 7,845.6 cf Chambers = 13,790.3 cf Stone x 40.0% Voids = 5,516.1 cf Stone Storage

Chamber Storage + Stone Storage = 13,361.7 cf = 0.307 af
Overall Storage Efficiency = 61.8%
Overall System Size = 106.08' x 37.08' x 5.50'

70 Chambers
801.3 cy Field
510.8 cy Stone

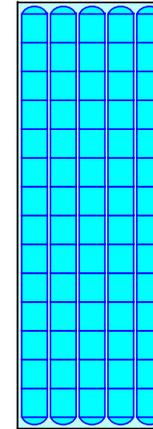


Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 115

Pond UIS3: MC-3500

Hydrograph

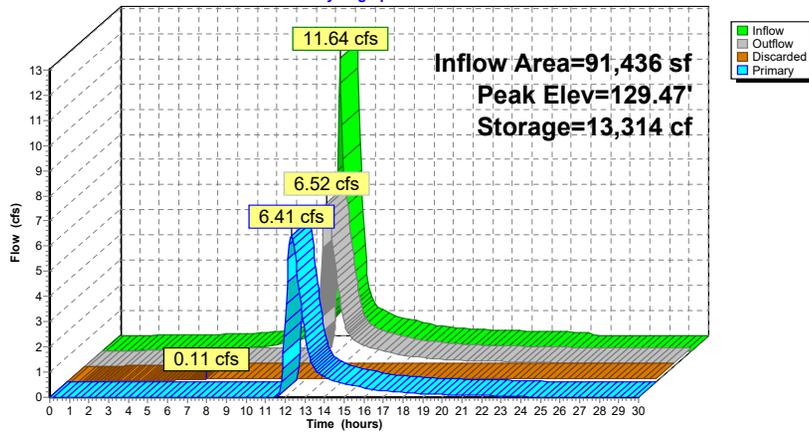

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.
HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"
Printed 10/17/2019
Page 116


Summary for Link SP-1: Study Point #1

Inflow Area = 151,489 sf, 40.35% Impervious, Inflow Depth = 3.92" for 100-Year event
Inflow = 11.62 cfs @ 12.12 hrs, Volume= 49,437 cf
Primary = 11.62 cfs @ 12.12 hrs, Volume= 49,437 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs

Link SP-1: Study Point #1

Hydrograph

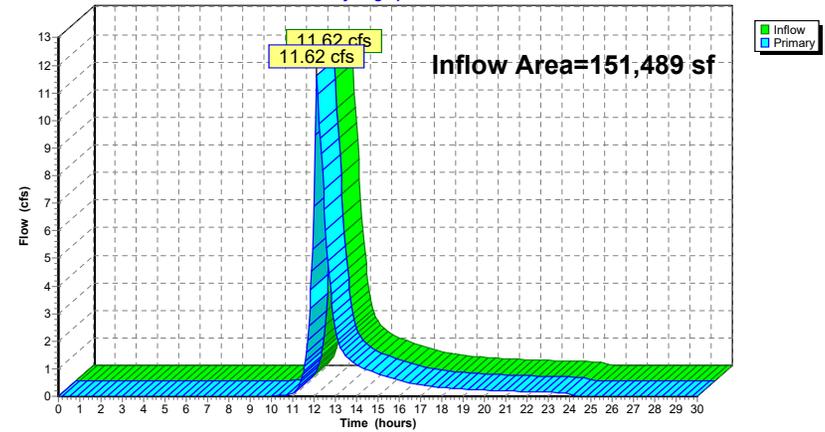

Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.

HydroCAD® 10.00-24 s/n 02881 © 2018 HydroCAD Software Solutions LLC

ALTA at River's Edge
Type III 24-hr 100-Year Rainfall=8.02"

Printed 10/17/2019

Page 117


Summary for Link SP-2: Study Point #2

Inflow Area = 209,308 sf, 55.37% Impervious, Inflow Depth = 4.34" for 100-Year event
Inflow = 16.18 cfs @ 12.22 hrs, Volume= 75,786 cf
Primary = 16.18 cfs @ 12.22 hrs, Volume= 75,786 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-30.00 hrs, dt= 0.05 hrs

Link SP-2: Study Point #2

Hydrograph

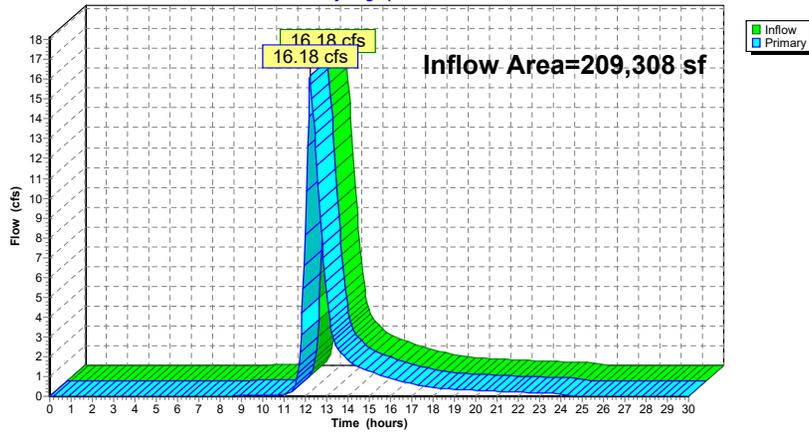

STUDY POINT 1 NORTH FLOW TO WETLANDS			
STORM EVENT	PEAK RATE	VOLUME	
1-INCH STORM	0.00 CFS	66 CF	
2YR STORM	2.18 CFS	7,823 CF	
10YR STORM	5.59 CFS	18,575 CF	
100YR STORM	11.84 CFS	38,811 CF	

STUDY POINT 2 OFF-SITE RUNOFF SOUTHEAST			
STORM EVENT	PEAK RATE	VOLUME	
1-INCH STORM	0.01 CFS	346 CF	
2YR STORM	3.57 CFS	13,112 CF	
10YR STORM	8.19 CFS	28,986 CF	
100YR STORM	16.29 CFS	57,768 CF	

LEGEND

EXISTING WATERSHED	
SCS SOILS BOUNDARY	
Tc FLOW PATH	
SUBCATCHMENT LABEL	
SUBCATCHMENT BOUNDARY	
FLOW DIRECTION	

NOTES:

- THE LOCATIONS OF EXISTING UNDERGROUND UTILITIES ARE SHOWN IN AN APPROXIMATE WAY ONLY AND HAVE NOT BEEN INDEPENDENTLY VERIFIED BY THE OWNER OR ITS REPRESENTATIVE. THE CONTRACTOR SHALL DETERMINE THE EXACT LOCATION OF ALL EXISTING UTILITIES BEFORE COMMENCING WORK, AND AGREES TO BE FULLY RESPONSIBLE FOR ANY AND ALL DAMAGES WHICH MIGHT BE OCCASIONED BY THE CONTRACTOR'S FAILURE TO EXACTLY LOCATE AND PRESERVE ANY AND ALL UNDERGROUND UTILITIES.
- THE INFORMATION SHOWN ON THIS PLAN IS THE SOLE PROPERTY OF ALLEN & MAJOR ASSOCIATES, INC. ITS INTENDED USE IS TO PROVIDE INFORMATION. ANY ALTERATION, MISUSE, OR RECALCULATION OF INFORMATION OR DATA WITHOUT THE EXPRESSED, WRITTEN CONSENT OF ALLEN & MAJOR ASSOCIATES, INC. IS STRICTLY PROHIBITED.
- BASE PLAN TAKEN FROM PLAN ENTITLED "EXISTING CONDITIONS" PREPARED BY ALLEN & MAJOR ASSOCIATES.
- ADDITIONAL SURVEY INFORMATION TAKEN FROM BASE PLAN ENTITLED "EXISTING CONDITIONS SURVEY - 484-490 BOSTON POST ROAD, WAYLAND, MASSACHUSETTS" PREPARED BY WSP SELLS, PREPARED FOR TATA & HOWARD, DATED JULY 16, 2015, ORIGINAL SCALE 1"=60'.
- ALL EXISTING AND PROPOSED COVER TYPES SHALL BE CONSIDERED "GOOD" FOR MODELING PURPOSES UNLESS OTHERWISE NOTED.
- TOTAL SITE WATERSHED AREA IS 359,288± S.F.

**ISSUED FOR
DRAINAGE REPORT
OCTOBER 18, 2019**

PROFESSIONAL ENGINEER FOR
ALLEN & MAJOR ASSOCIATES, INC.

REV	DATE	DESCRIPTION
D.	10/18/2019	REVISED PER TOWN COMMENTS
C.	10/10/2019	REVISED PER TOWN COMMENTS
B.	09/27/2019	REVISED PER TOWN COMMENTS
A.	07/03/2019	ISSUED FOR NOTICE OF INTENT

APPLICANT/OWNER:

WP EAST ACQUISITIONS, LLC.
91 HARTWELL AVENUE
LEXINGTON, MA 02421

PROJECT:

ALTA AT RIVER'S EDGE
490 BOSTON POST ROAD
WAYLAND, MA

PROJECT NO. 1670-09A DATE: 06-20-2019

SCALE: 1"=40' DWG. NAME: 1670-09A

DESIGNED BY: SJL CHECKED BY: CMQ

PREPARED BY:



**ALLEN & MAJOR
ASSOCIATES, INC.**

civil & structural engineering • land surveying
environmental consulting • landscape architecture
www.allenmajor.com

100 COMMERCE WAY, SUITE 5
WOBURN MA 01801
TEL: (781) 535-6889
FAX: (781) 535-2896


WOBURN, MA • LAKEVILLE, MA • MANCHESTER, NH

THIS DRAWING HAS BEEN PREPARED IN ELECTRONIC FORMAT. CLIENT/CLIENT'S REPRESENTATIVE OR CONSULTANT MAY BE PROVIDED COPIES OF DRAWINGS AND SPECIFICATIONS ON MAGNETIC MEDIA FOR HIS/HER INFORMATION AND USE FOR SPECIFIC APPLICATION TO THIS PROJECT. DUE TO THE POTENTIAL THAT THE MAGNETIC INFORMATION MAY BE MODIFIED UNINTENTIONALLY OR OTHERWISE, ALLEN & MAJOR ASSOCIATES, INC. MAY REMOVE ALL INDICATION OF THE DOCUMENT'S AUTHORSHIP ON THE MAGNETIC MEDIA. PRINTED REPRESENTATIONS OF THE DRAWINGS AND SPECIFICATIONS ISSUED SHALL BE THE ONLY RECORD COPIES OF ALLEN & MAJOR ASSOCIATES, INC.'S WORK PRODUCT.


DRAWING TITLE: SHEET No.

EXISTING WATERSHED PLAN EWP

Copyright © 2019 Allen & Major Associates, Inc.
All Rights Reserved.

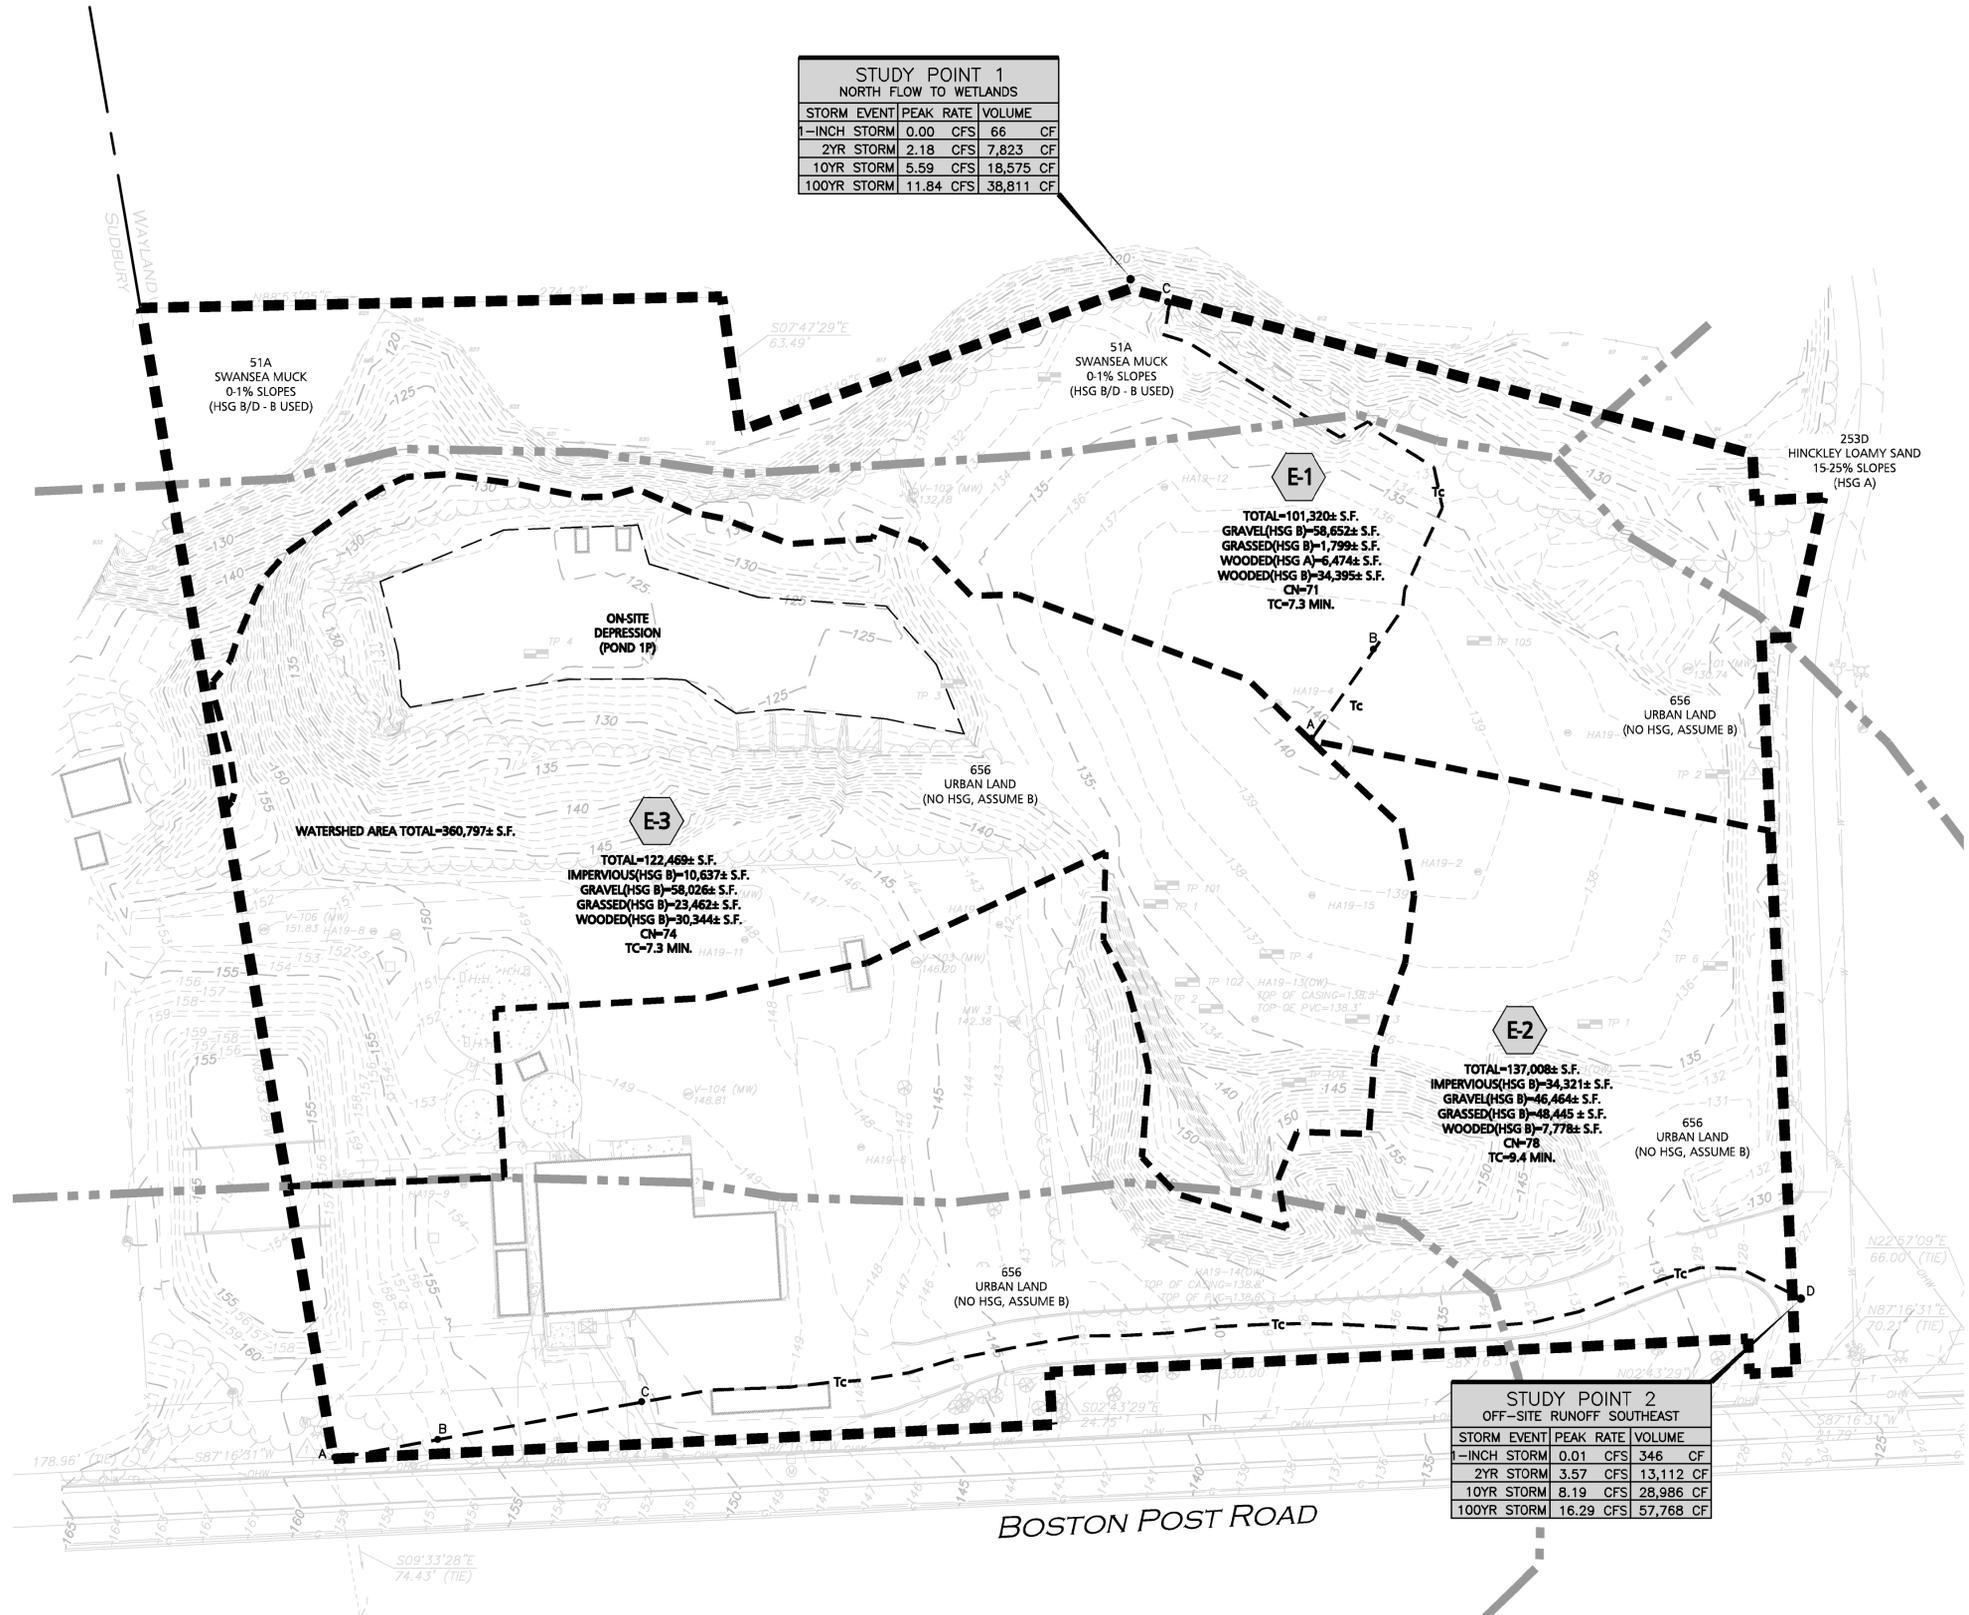

GRAPHIC SCALE



DIG SAFE




BEFORE YOU DIG
CALL 811 OR
1-888-DIG-SAFE
1-888-344-7233

N:\PROJECTS\1670-09A\CIVIL\DRAWINGS\CURRENT\C-1670-09A_WATERSHED-EXISTING.DWG

N:\PROJECTS\1670-09A\CIVIL\DRAWINGS\CURRENT\C-1670-09A_WATERSHED-PROPOSED.DWG

STUDY POINT 1 NORTH FLOW TO WETLANDS			
STORM EVENT	PEAK RATE	VOLUME	
1-INCH STORM	0.00 CFS	0 CF	
2YR STORM	1.21 CFS	6,559 CF	
10YR STORM	5.27 CFS	21,203 CF	
100YR STORM	11.62 CFS	49,437 CF	

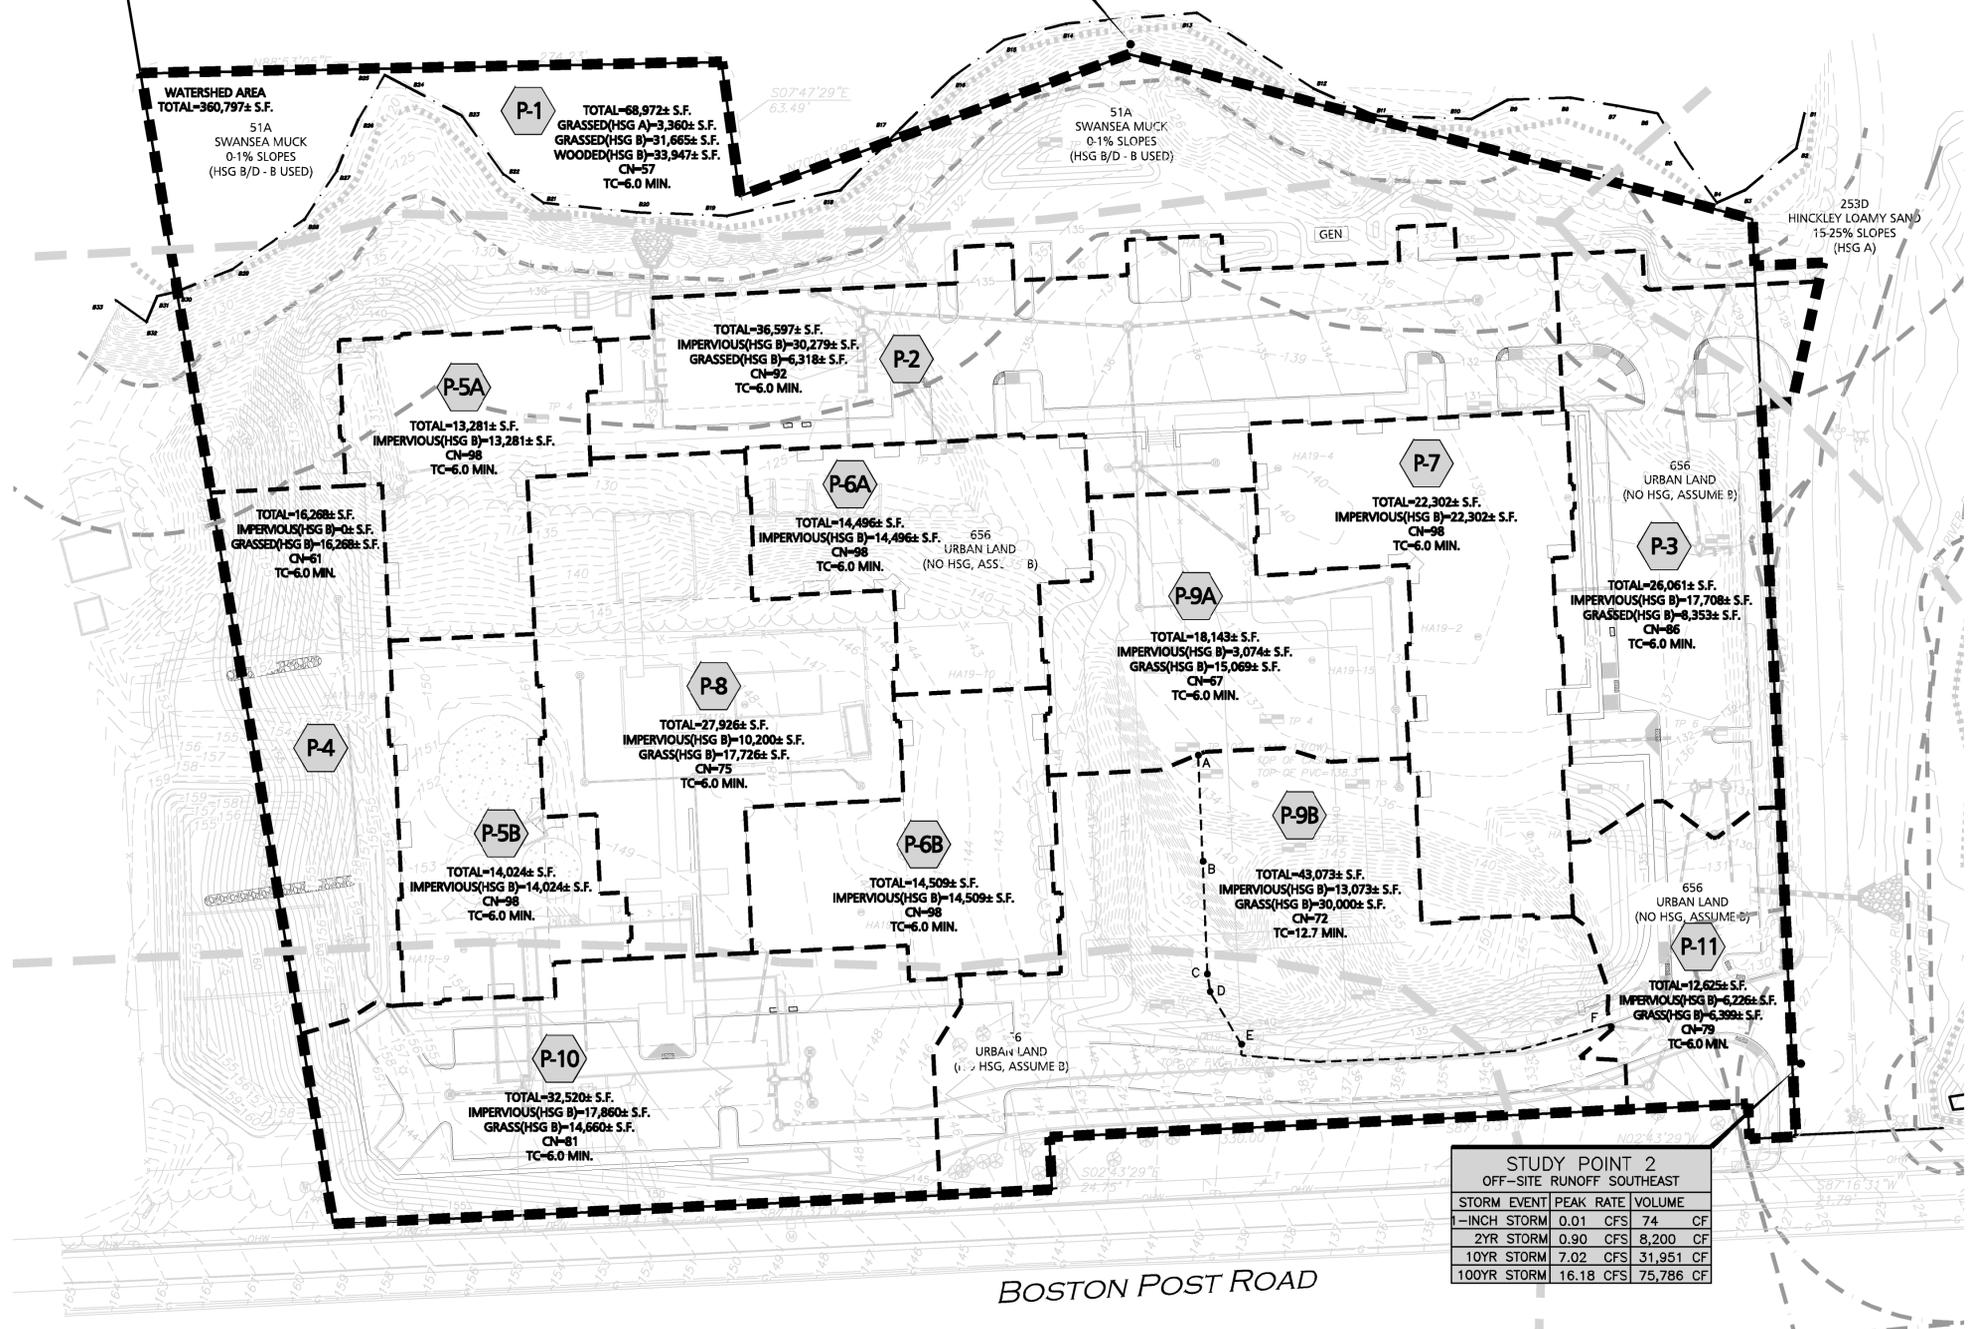

LEGEND

PROPOSED WATERSHED

SCS SOILS BOUNDARY

Tc FLOW PATH

SUBCATCHMENT LABEL

SUBCATCHMENT BOUNDARY

FLOW DIRECTION

- NOTES:**
1. THE LOCATIONS OF EXISTING UNDERGROUND UTILITIES ARE SHOWN IN AN APPROXIMATE WAY ONLY AND HAVE NOT BEEN INDEPENDENTLY VERIFIED BY THE OWNER OR ITS REPRESENTATIVE. THE CONTRACTOR SHALL DETERMINE THE EXACT LOCATION OF ALL EXISTING UTILITIES BEFORE COMMENCING WORK, AND AGREES TO BE FULLY RESPONSIBLE FOR ANY AND ALL DAMAGES WHICH MIGHT BE OCCASIONED BY THE CONTRACTOR'S FAILURE TO EXACTLY LOCATE AND PRESERVE ANY AND ALL UNDERGROUND UTILITIES.
 2. THE INFORMATION SHOWN ON THIS PLAN IS THE SOLE PROPERTY OF ALLEN & MAJOR ASSOCIATES, INC. ITS INTENDED USE IS TO PROVIDE INFORMATION. ANY ALTERATION, MISUSE, OR RECALCULATION OF INFORMATION OR DATA WITHOUT THE EXPRESSED, WRITTEN CONSENT OF ALLEN & MAJOR ASSOCIATES, INC. IS STRICTLY PROHIBITED.
 3. BASE PLAN TAKEN FROM PLAN ENTITLED "EXISTING CONDITIONS" PREPARED BY ALLEN & MAJOR ASSOCIATES.
 4. ADDITIONAL SURVEY INFORMATION TAKEN FROM BASE PLAN ENTITLED "EXISTING CONDITIONS SURVEY - 484-490 BOSTON POST ROAD, WAYLAND MASSACHUSETTS" PREPARED BY WSP SELLS, PREPARED FOR TATA & HOWARD, DATED JULY 16, 2015, ORIGINAL SCALE 1"=60'.
 5. ALL EXISTING AND PROPOSED COVER TYPES SHALL BE CONSIDERED "GOOD" FOR MODELING PURPOSES UNLESS OTHERWISE NOTED.
 6. TOTAL SITE WATERSHED AREA IS 359,288± S.F.

ISSUED FOR DRAINAGE REPORT
OCTOBER 18, 2019

PROFESSIONAL ENGINEER FOR ALLEN & MAJOR ASSOCIATES, INC.

REV	DATE	DESCRIPTION
D.	10/18/2019	REVISED PER TOWN COMMENTS
C.	10/10/2019	REVISED PER TOWN COMMENTS
B.	09/27/2019	REVISED PER TOWN COMMENTS
A.	07/03/2019	ISSUED FOR NOTICE OF INTENT

APPLICANT/OWNER:
WP EAST ACQUISITIONS, LLC.
91 HARTWELL AVENUE
LEXINGTON, MA 02421

PROJECT:
ALTA AT RIVER'S EDGE
490 BOSTON POST ROAD
WAYLAND, MA

PROJECT NO.	1670-09A	DATE:	06-20-2019
SCALE:	1"=60'	DWG. NAME:	1670-09A
DESIGNED BY:	SJL	CHECKED BY:	CMQ



ALLEN & MAJOR ASSOCIATES, INC.

civil & structural engineering • land surveying
environmental consulting • landscape architecture
www.allenmajor.com
100 COMMERCE WAY, SUITE 5
WOBURN MA 01801
TEL: (781) 535-6889
FAX: (781) 535-2896

WOBURN, MA • LAKEVILLE, MA • MANCHESTER, NH

THIS DRAWING HAS BEEN PREPARED IN ELECTRONIC FORMAT. CLIENT/CLIENT'S REPRESENTATIVE OR CONSULTANT MAY BE PROVIDED COPIES OF DRAWINGS AND SPECIFICATIONS ON MAGNETIC MEDIA FOR HIS/HER INFORMATION AND USE FOR SPECIFIC APPLICATION TO THIS PROJECT. DUE TO THE POTENTIAL THAT THE MAGNETIC INFORMATION MAY BE MODIFIED UNINTENTIONALLY OR OTHERWISE, ALLEN & MAJOR ASSOCIATES, INC. MAY REMOVE ALL INDICATION OF THE DOCUMENT'S AUTHORSHIP ON THE MAGNETIC MEDIA. PRINTED REPRESENTATIONS OF THE DRAWINGS AND SPECIFICATIONS ISSUED SHALL BE THE ONLY RECORD COPIES OF ALLEN & MAJOR ASSOCIATES, INC.'S WORK PRODUCT.


DRAWING TITLE: PROPOSED WATERSHED PLAN
SHEET No. PWS-1

Copyright © 2019 Allen & Major Associates, Inc. All Rights Reserved.


DIG SAFE

BEFORE YOU DIG
CALL 811 OR
1-888-DIG-SAFE
1-888-344-7233

STUDY POINT 2 OFF-SITE RUNOFF SOUTHEAST			
STORM EVENT	PEAK RATE	VOLUME	
1-INCH STORM	0.01 CFS	74 CF	
2YR STORM	0.90 CFS	8,200 CF	
10YR STORM	7.02 CFS	31,951 CF	
100YR STORM	16.18 CFS	75,786 CF	



N:\PROJECTS\1670-09A\CIVIL\DRAWINGS\CURRENT\C-1670-09A_GRADING & DRAINAGE.DWG

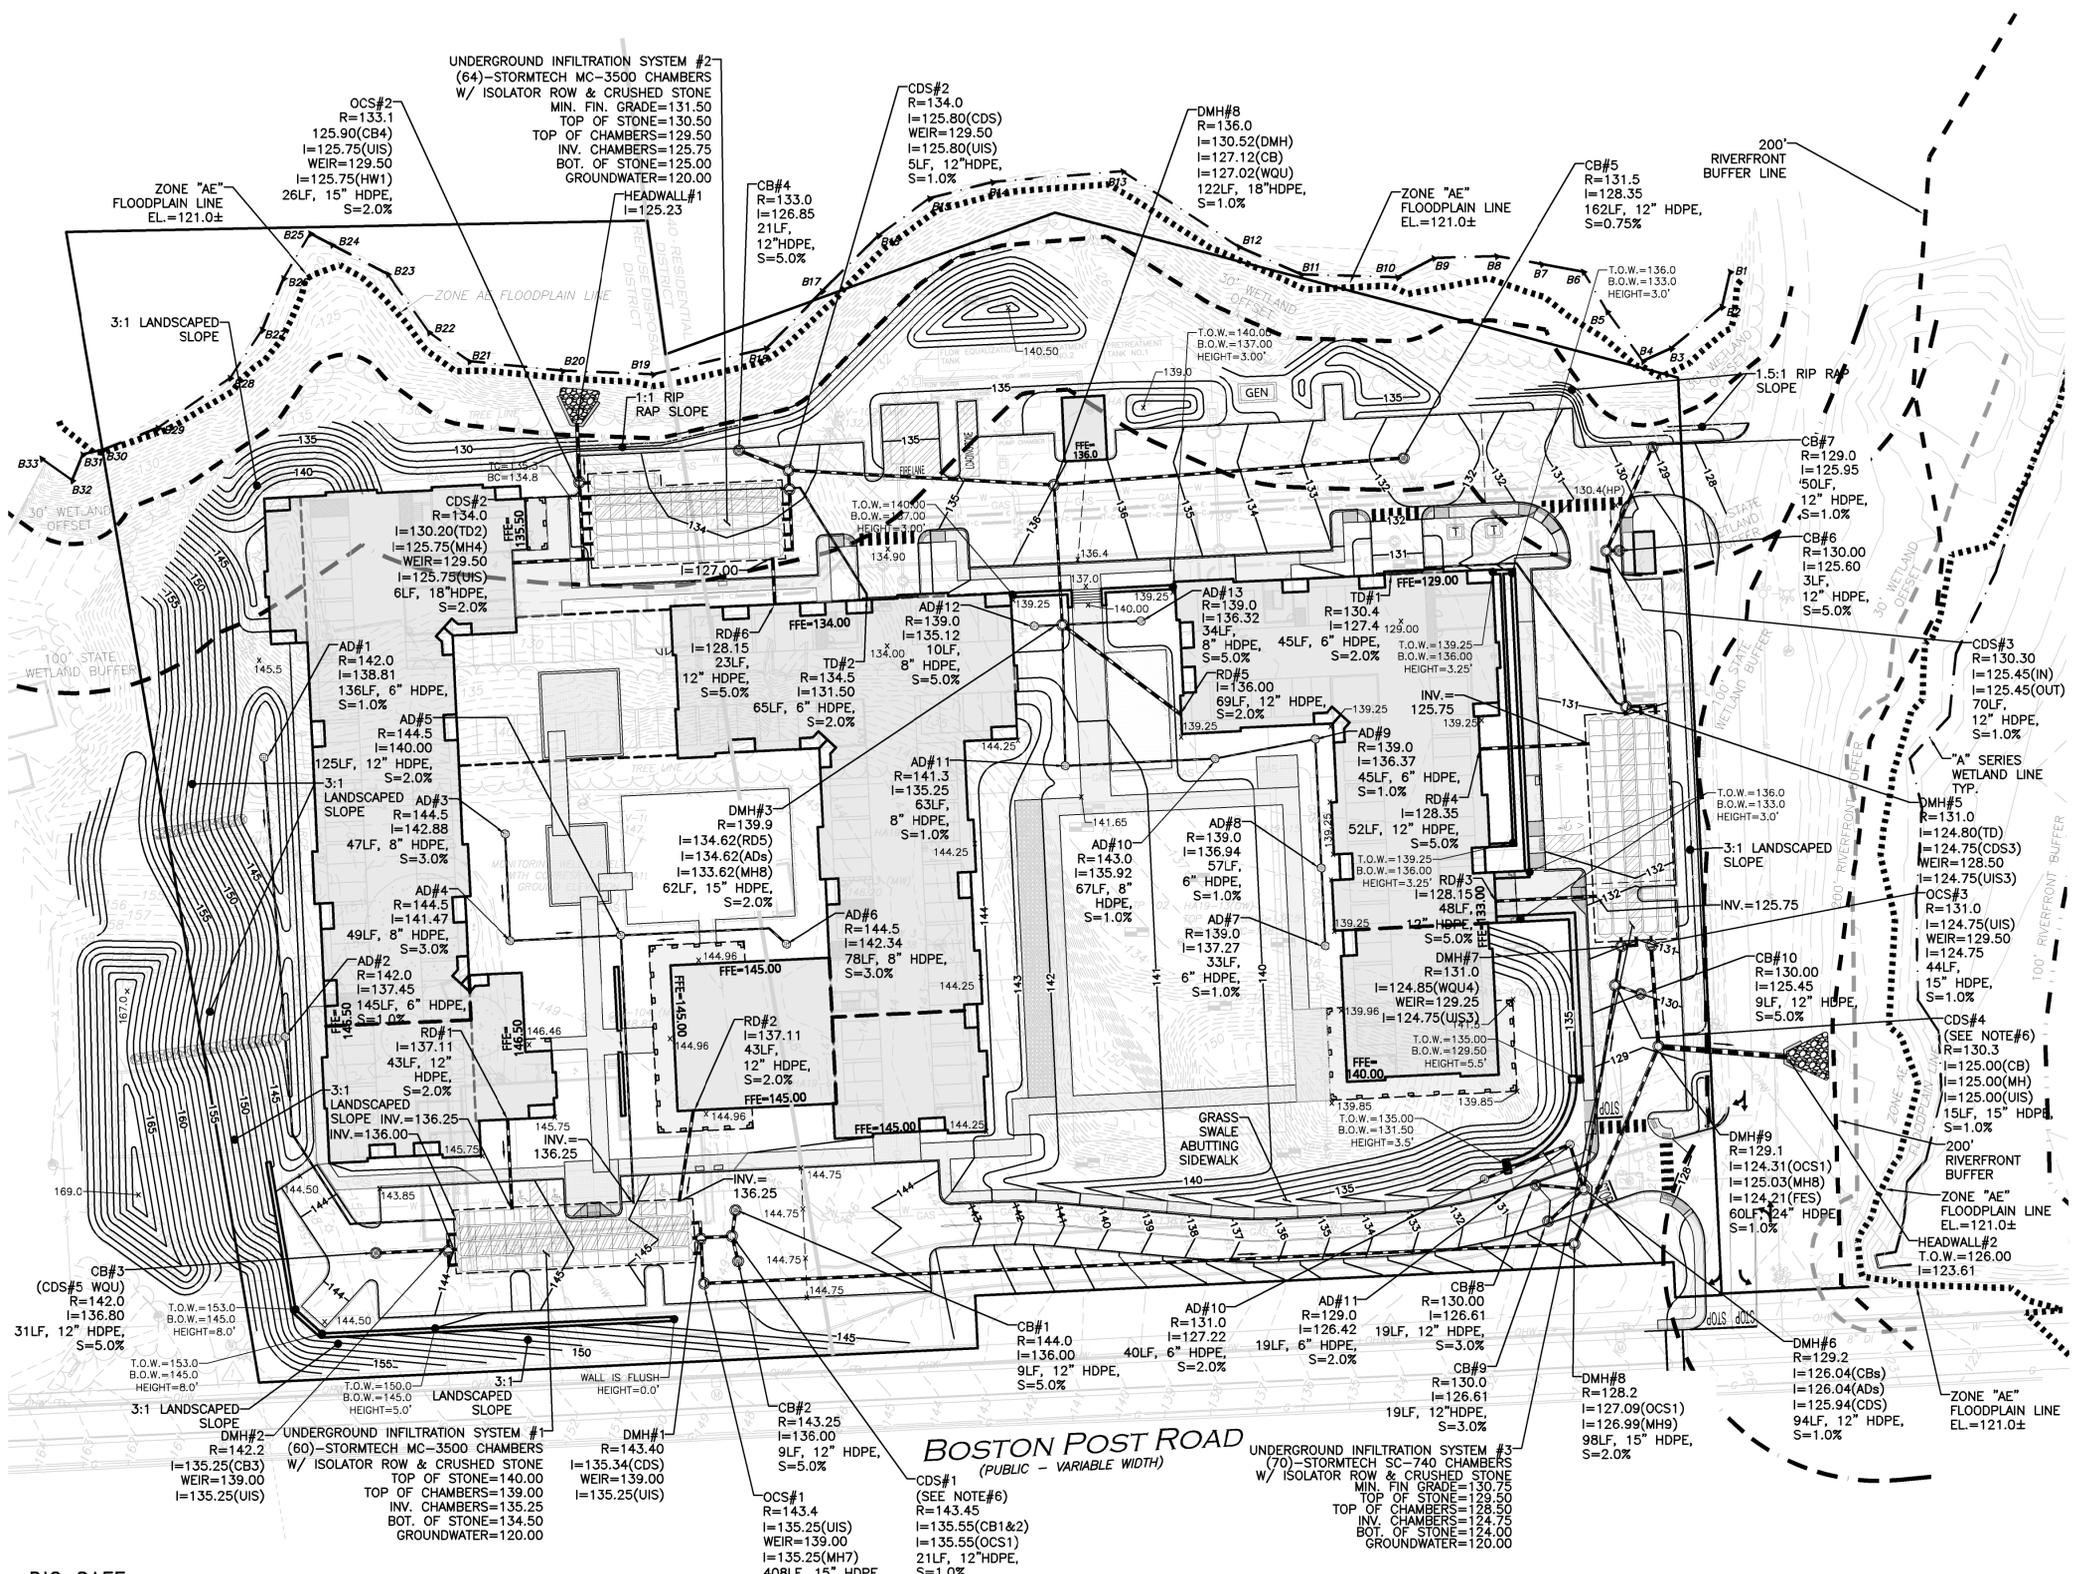

LEGEND

- DRAIN MANHOLE
- ⊙ CATCH BASIN
- ⊕ CATCH BASIN - DOUBLE GRATE
- ⊗ DRAIN MANHOLE W/ WEIR
- ⊖ AREA DRAIN
- CLEANOUT
- × SPOT GRADE (x148.00)
- DRAIN LINE
- 5' CONTOUR
- 1' CONTOUR
- ▭ INFILTRATION SYSTEM
- ▭ INFILTRATION CHAMBERS
- ▭ ISOLATOR ROW

- NOTES:**
- THE LOCATIONS OF EXISTING UNDERGROUND UTILITIES ARE SHOWN IN AN APPROXIMATE WAY ONLY AND HAVE NOT BEEN INDEPENDENTLY VERIFIED BY THE OWNER OR ITS REPRESENTATIVE. THE CONTRACTOR SHALL DETERMINE THE EXACT LOCATION OF ALL EXISTING UTILITIES BEFORE COMMENCING WORK, AND AGREES TO BE FULLY RESPONSIBLE FOR ANY AND ALL DAMAGES WHICH MIGHT BE OCCASIONED BY THE CONTRACTOR'S FAILURE TO EXACTLY LOCATE AND PRESERVE ANY AND ALL UNDERGROUND UTILITIES.
 - THE INFORMATION SHOWN ON THIS PLAN IS THE SOLE PROPERTY OF ALLEN & MAJOR ASSOCIATES, INC. IT IS INTENDED USE IS TO PROVIDE INFORMATION, ANY ALTERATION, MISUSE, OR RECALCULATION OF INFORMATION OR DATA WITHOUT THE EXPRESSED, WRITTEN CONSENT OF ALLEN & MAJOR ASSOCIATES, INC. IS STRICTLY PROHIBITED.
 - PIPE DIMENSIONS ARE MEASURED FROM THE INSIDE FACE OF THE STRUCTURE.
 - THE CONTRACTOR SHALL CONTACT "DIGSAFE" AND THE AT LEAST 72 HOURS PRIOR TO ANY EXCAVATION WORK TO REQUEST THE LOCATION OF THE EXISTING UTILITIES. DIGSAFE: 1-888-344-7233
 - ANY ROOF DRAINAGE PIPE LOCATED WITHIN 10' OF THE BUILDING FOUNDATION SHALL BE CAST IRON PIPE PER MA PLUMBING CODE.
 - ALL "CDS" STRUCTURES HAVE BEEN SIZED USING THE WATER QUALITY FLOW RATE PER MASS STORMWATER HANDBOOK AND SHALL BE CONTECH CDS2015-4-C OR APPROVED EQUIVALENT.
 - GROUNDWATER ELEVATIONS ARE ASSUMPTIONS BASED ON INFORMATION PROVIDED IN A GEOTECHNICAL REPORT DATED MAY 2019 BY HALEY ALDRICH. TEST PITS SHALL BE CONDUCTED BY A SOIL EVALUATOR LICENSED IN THE STATE OF MASSACHUSETTS TO VERIFY THE ESTIMATED SEASONAL HIGH GROUNDWATER TABLE (ESHGW) PRIOR TO THE INSTALLATION OF THE INFILTRATION FIELDS.

ISSUED FOR DRAINAGE REPORT
OCTOBER 18, 2019

PROFESSIONAL ENGINEER FOR ALLEN & MAJOR ASSOCIATES, INC.

REV	DATE	DESCRIPTION
D.	10/18/2019	REVISED PER TOWN COMMENTS
C.	10/10/2019	REVISED PER TOWN COMMENTS
B.	09/27/2019	REVISED PER TOWN COMMENTS
A.	07/03/2019	ISSUED FOR NOTICE OF INTENT

APPLICANT/OWNER:
WP EAST ACQUISITIONS, LLC.
91 HARTWELL AVENUE
LEXINGTON, MA 02421

PROJECT:
ALTA AT RIVER'S EDGE
490 BOSTON POST ROAD
WAYLAND, MA

PROJECT NO.	1670-09A	DATE:	06-20-2019
SCALE:	1"=40'	DWG. NAME:	1670-09A
DESIGNED BY:	SJL	CHECKED BY:	CMQ

PREPARED BY:

ALLEN & MAJOR ASSOCIATES, INC.
civil & structural engineering • land surveying
environmental consulting • landscape architecture
www.allenmajor.com
100 COMMERCE WAY, SUITE 5
WOBURN MA 01801
TEL: (781) 535-6889
FAX: (781) 535-2896


WOBURN, MA • LAKEVILLE, MA • MANCHESTER, NH

THIS DRAWING HAS BEEN PREPARED IN ELECTRONIC FORMAT. CLIENT/CUSTOMER'S REPRESENTATIVE OR CONSULTANT MAY BE PROVIDED COPIES OF DRAWINGS AND SPECIFICATIONS ON MAGNETIC MEDIA FOR HIS/HER INFORMATION AND USE FOR SPECIFIC APPLICATION TO THIS PROJECT. DUE TO THE POTENTIAL THAT THE MAGNETIC INFORMATION MAY BE MODIFIED UNINTENTIONALLY OR OTHERWISE, ALLEN & MAJOR ASSOCIATES, INC. MAY REMOVE ALL INDICATION OF THE DOCUMENT'S AUTHORSHIP ON THE MAGNETIC MEDIA. PRINTED REPRESENTATIONS OF THE DRAWINGS AND SPECIFICATIONS ISSUED SHALL BE THE ONLY RECORD COPIES OF ALLEN & MAJOR ASSOCIATES, INC.'S WORK PRODUCT.

DRAWING TITLE: **GRADING & DRAINAGE PLAN** SHEET No. **C-103**

DIG SAFE

BEFORE YOU DIG
CALL 811 OR
1-888-DIG-SAFE
1-888-344-7233





United States
Department of
Agriculture

NRCS

Natural
Resources
Conservation
Service

A product of the National
Cooperative Soil Survey,
a joint effort of the United
States Department of
Agriculture and other
Federal agencies, State
agencies including the
Agricultural Experiment
Stations, and local
participants


Custom Soil Resource Report for Middlesex County, Massachusetts



Custom Soil Resource Report Soil Map



Map Scale: 1:10,100 if printed on A landscape (11" x 8.5") sheet.



MAP LEGEND

Area of Interest (AOI)

 Area of Interest (AOI)

Soils

 Soil Map Unit Polygons

 Soil Map Unit Lines

 Soil Map Unit Points

Special Point Features

-  Blowout
-  Borrow Pit
-  Clay Spot
-  Closed Depression
-  Gravel Pit
-  Gravelly Spot
-  Landfill
-  Lava Flow
-  Marsh or swamp
-  Mine or Quarry
-  Miscellaneous Water
-  Perennial Water
-  Rock Outcrop
-  Saline Spot
-  Sandy Spot
-  Severely Eroded Spot
-  Sinkhole
-  Slide or Slip
-  Sodic Spot

-  Spoil Area
-  Stony Spot
-  Very Stony Spot
-  Wet Spot
-  Other
-  Special Line Features

Water Features

 Streams and Canals

Transportation

-  Rails
-  Interstate Highways
-  US Routes
-  Major Roads
-  Local Roads

Background

 Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:25,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
 Web Soil Survey URL:
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Middlesex County, Massachusetts
 Survey Area Data: Version 18, Sep 7, 2018

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Sep 12, 2014—Sep 28, 2014

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.


Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
1	Water	18.0	4.0%
4A	Rippowam fine sandy loam, 0 to 3 percent slopes	4.3	0.9%
30B	Raynham silt loam, 0 to 5 percent slopes	7.4	1.6%
32B	Wareham loamy fine sand, 0 to 5 percent slopes	4.7	1.0%
33B	Raypol silt loam, 0 to 5 percent slopes	4.9	1.1%
36A	Saco mucky silt loam, 0 to 1 percent slopes	158.7	35.0%
44A	Birdsall mucky silt loam, 0 to 1 percent slopes	9.6	2.1%
51A	Swansea muck, 0 to 1 percent slopes	42.6	9.4%
52A	Freetown muck, 0 to 1 percent slopes	24.7	5.4%
53A	Freetown muck, ponded, 0 to 1 percent slopes	2.6	0.6%
223A	Scio very fine sandy loam, 0 to 3 percent slopes	10.4	2.3%
223B	Scio very fine sandy loam, 3 to 8 percent slopes	2.4	0.5%
253D	Hinckley loamy sand, 15 to 25 percent slopes	30.1	6.6%
254B	Merrimac fine sandy loam, 3 to 8 percent slopes	13.3	2.9%
261B	Tisbury silt loam, 3 to 8 percent slopes	4.2	0.9%
415B	Narragansett silt loam, 3 to 8 percent slopes	0.0	0.0%
652	Udorthents, refuse substratum	50.9	11.2%
653	Udorthents, sandy	15.1	3.3%
656	Udorthents-Urban land complex	49.9	11.0%
Totals for Area of Interest		453.7	100.0%

Map Unit Descriptions

The map units delineated on the detailed soil maps in a soil survey represent the soils or miscellaneous areas in the survey area. The map unit descriptions, along with the maps, can be used to determine the composition and properties of a unit.

Custom Soil Resource Report
Map—Hydrologic Soil Group

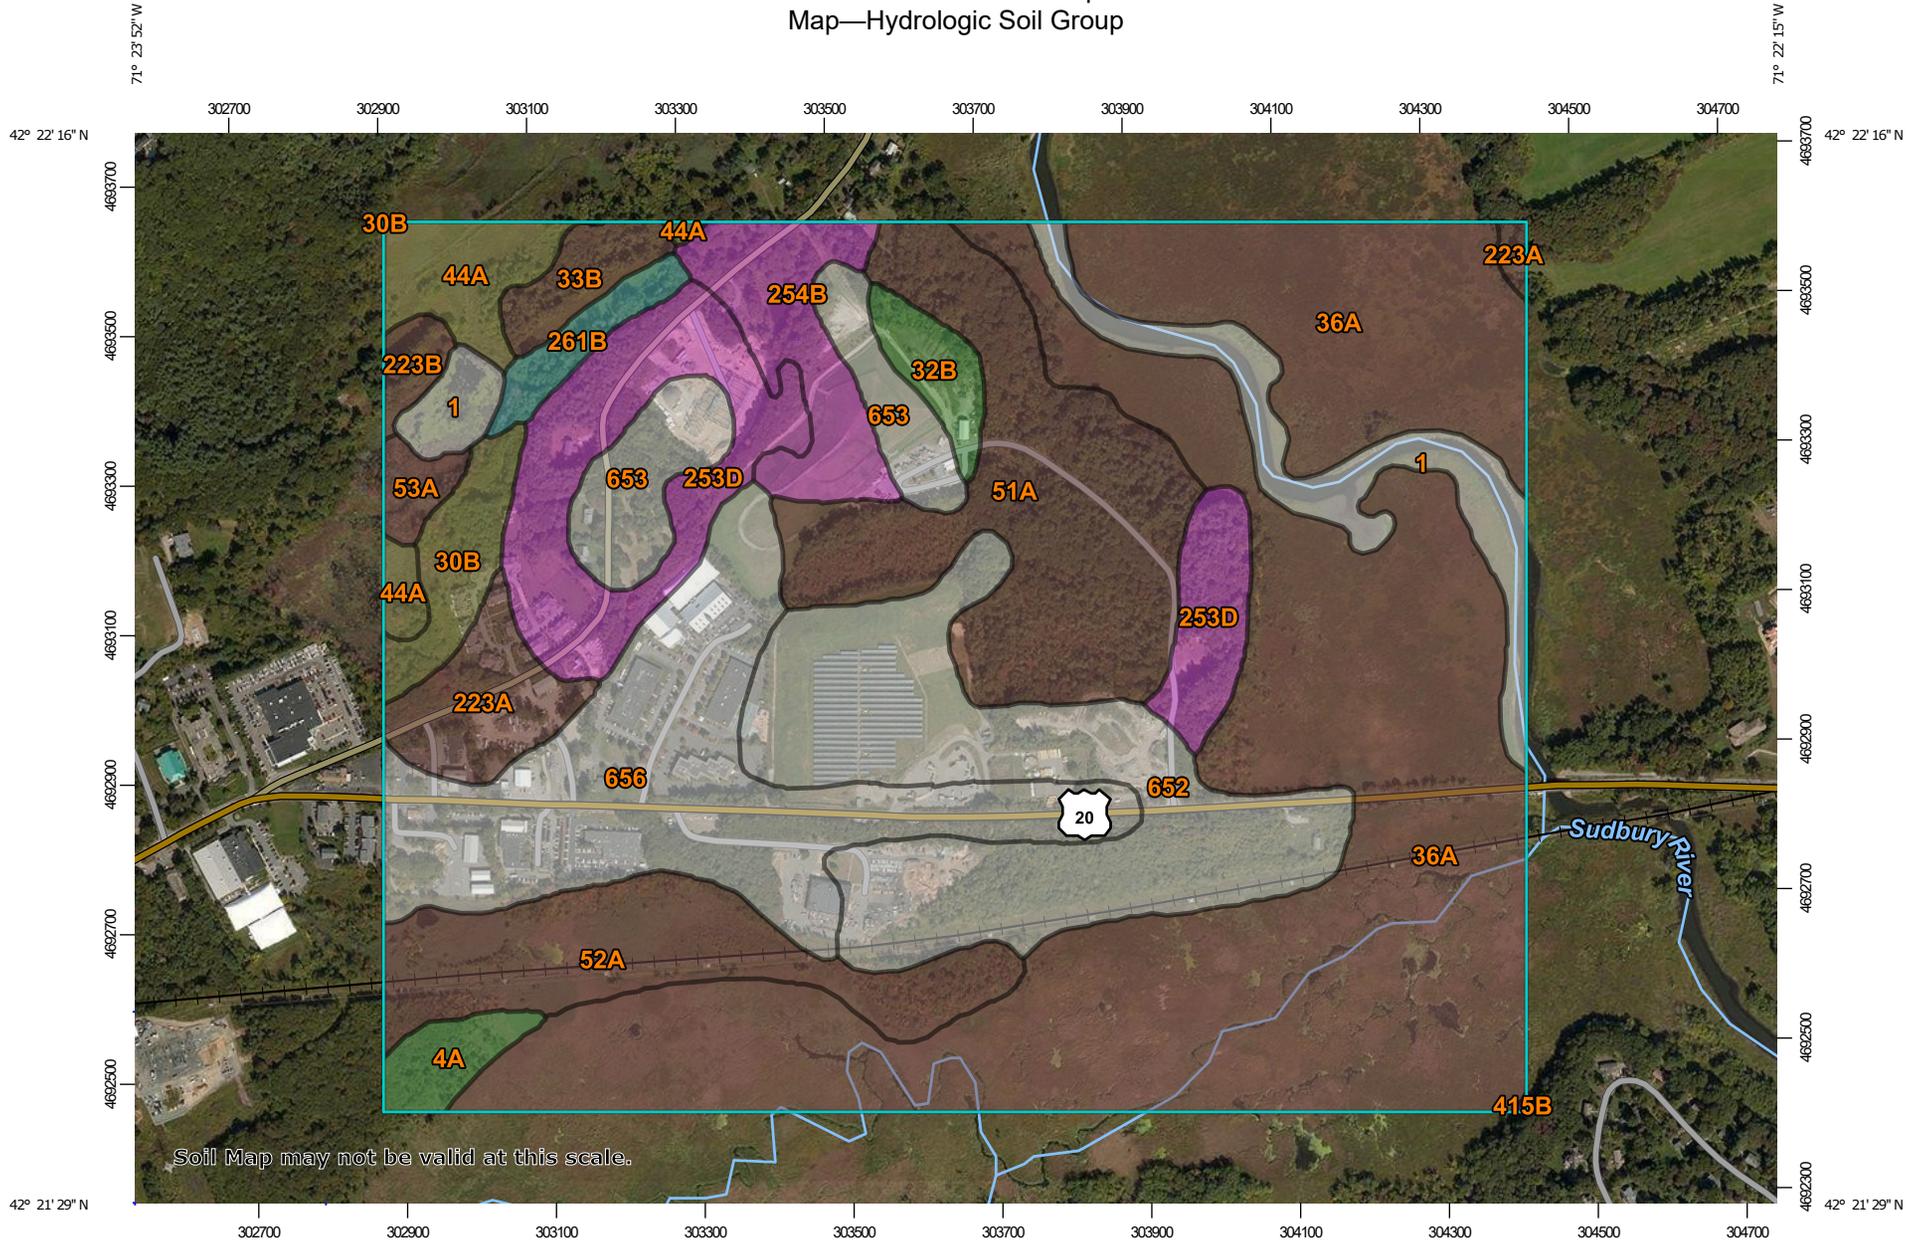

Soil Map may not be valid at this scale.

Map Scale: 1:10,100 if printed on A landscape (11" x 8.5") sheet.



Map projection: Web Mercator Corner coordinates: WGS84 Edge tics: UTM Zone 19N WGS84



MAP LEGEND

Area of Interest (AOI)

 Area of Interest (AOI)

Soils

Soil Rating Polygons

-  A
-  A/D
-  B
-  B/D
-  C
-  C/D
-  D
-  Not rated or not available

Soil Rating Lines

-  A
-  A/D
-  B
-  B/D
-  C
-  C/D
-  D
-  Not rated or not available

Soil Rating Points

-  A
-  A/D
-  B
-  B/D

-  C
-  C/D
-  D
-  Not rated or not available

Water Features

 Streams and Canals

Transportation

-  Rails
-  Interstate Highways
-  US Routes
-  Major Roads
-  Local Roads

Background

 Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:25,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
 Web Soil Survey URL:
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Middlesex County, Massachusetts
 Survey Area Data: Version 18, Sep 7, 2018

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Sep 12, 2014—Sep 28, 2014

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Custom Soil Resource Report

Table—Hydrologic Soil Group

Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
1	Water		18.0	4.0%
4A	Rippowam fine sandy loam, 0 to 3 percent slopes	A/D	4.3	0.9%
30B	Raynham silt loam, 0 to 5 percent slopes	C/D	7.4	1.6%
32B	Wareham loamy fine sand, 0 to 5 percent slopes	A/D	4.7	1.0%
33B	Raypol silt loam, 0 to 5 percent slopes	B/D	4.9	1.1%
36A	Saco mucky silt loam, 0 to 1 percent slopes	B/D	158.7	35.0%
44A	Birdsall mucky silt loam, 0 to 1 percent slopes	C/D	9.6	2.1%
51A	Swansea muck, 0 to 1 percent slopes	B/D	42.6	9.4%
52A	Freetown muck, 0 to 1 percent slopes	B/D	24.7	5.4%
53A	Freetown muck, ponded, 0 to 1 percent slopes	B/D	2.6	0.6%
223A	Scio very fine sandy loam, 0 to 3 percent slopes	B/D	10.4	2.3%
223B	Scio very fine sandy loam, 3 to 8 percent slopes	B/D	2.4	0.5%
253D	Hinckley loamy sand, 15 to 25 percent slopes	A	30.1	6.6%
254B	Merrimac fine sandy loam, 3 to 8 percent slopes	A	13.3	2.9%
261B	Tisbury silt loam, 3 to 8 percent slopes	C	4.2	0.9%
415B	Narragansett silt loam, 3 to 8 percent slopes	A	0.0	0.0%
652	Udorthents, refuse substratum		50.9	11.2%
653	Udorthents, sandy		15.1	3.3%
656	Udorthents-Urban land complex		49.9	11.0%
Totals for Area of Interest			453.7	100.0%

3. Site Subsurface Conditions

3.1 SOIL AND BEDROCK

The test borings typically indicated the following sequence of subsurface units:

Stratum/Subsurface Unit	Top of Stratum	Range in Thickness (ft)
Fill Soils	El. 125.0 to El. 154.5	1.6 to 17
Glaciofluvial Deposits	El. 120.2 to El. 149.5	>41

- Fill: Fill was encountered at each exploration location consisting of existing in-situ fill soils or stockpiled fill brought to the site by the Wayland DPW for storage. General descriptions of the materials are included below:
 - Existing Fill: Existing Fill soils are present above the natural, Glaciofluvial deposits at thicknesses ranging from 1.6 to 7 ft. The following explorations were performed outside the stockpile limits: TP-1 to 6; TP-101 to 103; and HA19-1, 6, 8 to 11, and 14. The Existing Fill was observed to consist of a loose to dense SAND or silty SAND with gravel and a few cobbles. Some debris was noted in the fill, including brick, wood, and asphalt pieces. Thin layers of topsoil were present at select locations above or intermixed within the Fill.
 - Stockpiled Fill: The Stockpiled Fill was located within a portion of the proposed Building 1 footprint and leaching field footprint ranging in thickness of 8 to 17 ft. Note that the stockpile was flattened in February 2019 as part of the environmental characterization program conducted by Vertex, which modified the limits of the stockpile and the site grading. The following explorations were performed within the stockpile limits: TP-105; and HA19-2 to 4, 12 to 13, and 15. The Fill was observed to consist of a loose to dense SAND or silty/clayey SAND with gravel and cobbles. Debris included brick, wood, roots, asphalt pieces, oversized concrete and construction debris.

Results of geotechnical laboratory testing conducted on the Stockpiled Fill soils, which are included in Appendix D, indicated a maximum dry density in the range of about 133.3 to 135.2 pounds per cubic foot with an optimum moisture content in the range of about 6.4% to 6.6%. The in-situ moisture content of the Stockpiled Fill soils generally ranged from 8.9% to 14.3%, with one result at 7.7%. The laboratory data indicate that the Stockpiled Fill soils are wet of optimum and therefore will be difficult to reuse in its current state.

- Glaciofluvial Deposits: Naturally-deposited, inorganic Glaciofluvial Deposits were encountered at each exploration with the top of the deposit observed from El. 120.2 to 149.5. The Glaciofluvial Deposits were highly variable granular deposits and ranged from medium dense to very dense poorly graded to well graded SAND or SAND with gravel or medium dense to very dense, poorly graded to well graded GRAVEL with sand.
- Bedrock: Bedrock was not encountered in explorations.

3.2 GROUNDWATER

Depth to water ranged from approximately 13.8 to 34 ft below existing grades, corresponding to about El. 110 to El. 125.2, as noted in the table below. Groundwater was not encountered in the test pit excavations, except at TP-102 where water slowly entered the excavation at a depth of 12.5 ft below ground surface, corresponding to approximately El. 117.5.

A portion of the site is within the Zone AE flood plain. The existing conditions drawings indicated that base flood elevation is El. 121.

Well ID	Ground Surface Elevation (ft, NAVD 88) ¹	Date	Groundwater	
			Depth from Ground Surface (ft) ^{2,3}	Elevation (ft, NAVD 88)
V-101	130	1-Apr-19	14.5	115.5
		2-Apr-19	13.8	116.2
		18-Apr-19	13.8	116.2
V-102	125	1-Apr-19	15.0	110.0
		2-Apr-19	14.7	110.3
		18-Apr-19	14.7	110.3
V-103	147	1-Apr-19	30.0	117.0
		2-Apr-19	29.1	117.9
		18-Apr-19	29.1	117.9
V-104	150	1-Apr-19	32.5	117.5
		2-Apr-19	31.2	118.8
		18-Apr-19	31.2	118.8
V-105	148	1-Apr-19	31.0	117.0
		2-Apr-19	29.9	118.1
		18-Apr-19	30.3	117.7
V-106	153	1-Apr-19	34.0	119.0
		2-Apr-19	27.8	125.2
		18-Apr-19	33.8	119.2
HA19-B1(OW)	132	18-Apr-19	14.9	116.6
HA19-13 (OW)	134	9-Apr-19	17.5	116.6
		18-Apr-19	18.5	115.6
HA19-14(OW)	139	18-Apr-19	21.9	117.0

Notes:

1. Ground surface elevations at Vertex's observation wells were estimated based on drawing CP-1, prepared by Allen & Major Associates, Inc., dated 13 June 2016.
2. Readings from 1 and 2 April 2019 were provided by Vertex.
3. Readings from 18 April 2019 were collected by a Haley & Aldrich Representative.

Groundwater levels can fluctuate, as they are influenced by precipitation, snow melt, leakage into or out of utility pipes, nearby construction activities and other factors. Accordingly, groundwater levels during and following construction can differ from those reported herein.

4. Geotechnical Design Recommendations

4.1 GENERAL

Recommendations presented herein are based on the proposed building layout and site development plan as understood at the time this report was prepared. As further information is developed by design team concerning these items, the design criteria should be reviewed by Haley & Aldrich for continued applicability.

4.2 BUILDING CODE AND APPLICABILITY

Building foundations should be designed and constructed in accordance with the Massachusetts State Building Code (Building Code). Recommendations provided herein are intended to be consistent with the requirements of the 9th Edition of the Building Code.

4.3 FOUNDATION DESIGN RECOMMENDATION

4.3.1 Building Foundations

The Existing Fill and Stockpiled Fill soils (in their current state) are not considered suitable bearing materials for building foundations. The naturally deposited, inorganic Glaciofluvial Deposits represent the uppermost subsurface strata suitable for building foundation support (the bearing stratum). The recommendations below assume that the Stockpiled Fill soils have been removed from the site or relocated prior to foundation preparation activities.

Therefore, based on our evaluations, the most economical foundation is a “hybrid” foundation system approach, consisting of conventional shallow foundations bearing on a combination of natural soils, Compacted Granular Fill placed above natural soils, and existing Fill soils stiffened using ground improvement.

Based on proposed finished floor elevation at El. 132 for Building 1 and El. 134 for Building 2, the bottom of foundation elevation is planned to be at approximately El. 128 and 130, respectively.

- In Building 1, the top of suitable bearing soils is encountered up to 5 feet below planned bottom of footing elevations. Building loads can be supported on conventional, reinforced concrete spread footings bearing at normal bearing depths following the excavation and replacement of the existing Fill with Compacted Granular Fill within the zone of influence of the proposed foundations. Alternately, the Existing Fill soils could be stiffened with short ground improvement elements to allow for the construction of conventional reinforced spread footing foundations without the need for over-excavation and replacement (unless obstructions are encountered). The attached Figure 2 illustrates this building as Zone A, where over-excavation and replacement Compacted Granular Fill or ground improvement are options for bearing at normal bearing depth.
- The slab elevation at the new Wastewater Treatment Building was not provided. Based on surrounding proposed grades, the slab is estimated to be finished at El. 130 and the top of

Glaciofluvial deposits to El. 120.2. The recommendations stated above for Building 1 and Zone A are also applicable to the Wastewater Treatment Building.

- Within a large portion of Building 2, illustrated as Zone B on Figure 2, suitable bearing soils are located at or above the planned bottom of footing elevation. In these areas, building loads can be supported on conventional, reinforced concrete spread footings bearing at normal bearing depths in the natural in-organic soils. Additionally, foundations for the at-grade Clubhouse at El. 145 with a planned foundation elevation at El. 141 will be within suitable natural bearing soils. Foundations for the clubhouse will need to be stepped to avoid loading the adjacent foundation walls. The proposed pool will also be constructed within suitable natural bearing soils and can be earth supported.
- Within the north portion of Building 2, illustrated as Zone A on Figure 2, site filling is required to raise grades to proposed footing elevations. The total thickness of existing and new fill up to 9 ft below planned bottom of footing elevations. We recommend that the general grading be conducted in this area with on-site Fill soils and then the placed Fill soils be stiffened with ground improvement to allow for the construction of conventional reinforced spread footing foundations at normal bearing depths. Alternately, the existing Fill can be over-excavated (approximately 2 to 4 feet of Fill will require excavation) and replaced with compacted Granular Fill and the remainder of the site filling in this area can be conducted with Compacted Granular Fill.

The proposed site development involves significant re-grading and soil management. The most economical foundation solution is interdependent on the physical and environmental quality of the Fill and the net-balance for export/import at the site. The following recommendations outline a “hybrid” foundation system approach, consisting of conventional shallow foundations bearing on a combination of natural soils, Structural Fill placed above natural soils, and existing Fill soils stiffened using ground improvement.

4.3.2 Conventional Spread Footings

Specific recommended criteria for design of spread footings are as follows:

- Design footings using the following maximum allowable bearing pressures:

Bearing Condition	Maximum allowable bearing pressure (Kips per square foot, ksf)
Inorganic, naturally deposited Glaciofluvial (Zone B)	6 ksf
Compacted Granular Fill (Zone A)	5 ksf
Ground Improvement Stiffened Fill (Zone A)	5 ksf

- Design footings to have a least lateral dimension of 18 in. or greater. The maximum allowable bearing pressure noted above should be reduced proportionally for footings with widths less than 3 ft.
- Locate bottoms of footings at least 48 in. below lowest adjacent ground surface exposed to freezing, and a minimum 18 in. below the top of the adjacent ground floor slab at heated interior locations.
- The Fill Soils are unsuitable foundation bearing strata. Should these soils be encountered within the zone of influence (ZOI) beneath foundations, they should be removed in their entirety and backfilled with Compacted Granular Fill. The ZOI is defined as the zone beneath the footings and beneath imaginary lines extending from points 1 ft laterally beyond the footing outer bottom edge, and out and down on a 1H:1V slope to the top of suitable bearing materials.
- Design footings to bear below a reference line drawn upward and outward on a 1.5 horizontal to 1 vertical (1.5H:1V) slope from the bottom of adjacent utilities or other underground structures, or future planned excavations. Where possible, footing elevations and construction sequencing should be coordinated with utility elevations to allow utilities to pass through the foundation wall (rather than through or beneath the footing). Footing bearing surfaces may locally need to be lowered or stepped to achieve this criterion. Footings should be installed at depth prior to installation of shallower utilities. If pressurized pipes are to pass beneath or within 5 ft of soil-bearing foundations, the configuration should be reviewed on a case by case basis to determine if special measures are needed to protect the foundations from undermining in the event of pipeline failure.
- Tops of individual column or wall footings should be positioned a minimum of 4 in. beneath the underside of an overlying floor slab. This space should be filled with granular soil having maximum particle size of 2 in.

Gradation and placement procedures for Compacted Granular Fill are described below in the Construction Considerations section of the report.

4.3.3 Ground Improvement

Where used to stiffen existing Fill Soils, Ground improvement should consist of semi-rigid vertical elements (e.g., Aggregate Piers or equivalent) installed through unsuitable soils to create a stiffened mass suitable for footing bearing. The detailed final design and installation of ground improvement is performed by specialty subcontractors, in accordance with performance criteria established by the Owner's Geotechnical Engineer. Proposals by perspective specialty Contractors bidding the work are typically reviewed by the Geotechnical Engineer for suitability of the proposed system and compliance with the project requirements.

For preliminary design and pricing, we recommend that the same footing design criteria as described above for conventional spread footings be used to design the spread footings bearing on ground improvement.

Other ground improvement considerations are as follows:

- Ground improvement design should consider the effects of site raises-in-grade, bottom of footing elevations, post-ground improvement utility installations, temporary construction loads, and other site and building conditions.
- Testing (modulus and/or load testing) should be performed on ground improvement elements to confirm the design assumptions.
- Other details of the ground improvement including footing pad requirements (if required) should be outlined in the project specifications and specialty contractors' proposals. Detailed design submittals should be provided for the ground improvement system, for review by Haley & Aldrich.

4.3.4 Settlements

At the recommended allowable bearing pressures, we estimate that settlement of individual footings under static loading conditions, constructed as recommended herein, will not exceed about 1 in., with differential settlements between individual footings, or within a 30-ft distance along a continuous strip footing, not exceeding about 1/2-in.

4.4 LOWEST FLOORS

The lowest level floor for each of the four proposed buildings can be designed and constructed as a conventional, soil-supported, concrete slab-on-grade in accordance with the following options. For each option, concrete slabs-on-grade should bear on an 8-in. minimum thickness of Compacted Granular Fill over a properly-prepared subgrade. The selected approach will need to be coordinated with the approach opted for footing support. The assumptions presented below assume that the existing Stockpiled Fill will be removed from the site.

- Existing– Within Zone A of Buildings 1 and 2, undocumented Existing Fill soils will be present beneath the proposed floor subgrades. In these zones, we recommend partial over-excavation and replacement of Existing Fill soils provided the risk of some slab settlement and/or cracking is tolerable or ground improvement through these fill soils (with no over-excavation and replacement) should the risk of slab settlement and/or cracking not be tolerable. The partial over-excavation and replacement option would entail removing the Existing Fill soils to a depth of 2 ft below the proposed bottom of slab elevation and recompacting the subgrade with a minimum of 6 passes of a large vibratory roller large vibratory roller imparting at least 25,000 lbs. of dynamic force. Excavated Fill soils can be used to backfill the over-excavation provided these materials are placed and compacted in accordance with the requirements for Compacted Granular Fill discussed in this report. If the quality and/or moisture content of the excavated Fill renders the material unsuitable, Compacted Granular Fill may be used as backfill. Ground improvement, if used, would consist of aggregate piers.
- Natural Glaciofluvial Deposits - In Zone B, natural Glaciofluvial soils will be present at the slab elevation and are suitable for placement of the slab on grade on the 8-in. minimum thickness of Compacted Granular Fill following re-compaction of the subgrade with a minimum of 6 passes of a large vibratory roller imparting at least 25,000 lbs. of dynamic force. If localized Fill soils are encountered at the slab subgrade elevation, we recommend they be removed and replaced with Compacted Granular Fill following compaction of the subgrade.

4.5 DESIGN GROUNDWATER LEVEL

We recommend a design groundwater level at El. 121, which is coincident with the base flood elevation, be used for calculation of hydrostatic pressures on below-grade structures.

4.6 FOUNDATION DRAINAGE AND WATERPROOFING

The lowest level floors of the proposed building are planned to be finished above proposed design groundwater level, but at or below proposed adjacent finished site grades. The following are general guidelines for foundation drainage and waterproofing. The scheme for waterproofing and drainage should be revisited after completion of the leaching field design and mounding analyses.

- Permanent underslab drainage is not required since the buildings finished floors are above the design groundwater level and above the mound level based on communications from the leaching field designer.
- Given that the mound level from the leaching field is not anticipated to reach the foundation bearing level, waterproofing is not required on foundation walls adjacent to the leaching field.
- Where finished grades are less than 2 ft above adjacent floor slabs, perimeter drainage is not required.
- We recommend that perimeter drainage consist of the following:
 - Waterstops, caulking, or other seals provided at all foundation wall and wall/footing construction joints where the exterior grading immediately adjacent to the building is higher than the interior floor slab of the building;
 - A perimeter foundation drainage system consisting of a continuous loop of 6-in. diameter perforated PVC placed adjacent to the perimeter footings, laid flat or with a slight pitch (if possible) downward toward the ejection/discharge point(s). The pipe should be surrounded by a minimum thickness of 6 in. of ¾-in. crushed stone, which in turn is surrounded by 6-oz. per sq. yd. non-woven geotextile;
 - Where perimeter foundation drainage is provided, below-grade walls should be waterproofed and geocomposite drainage board should be placed against the wall, up to 12 in. below ground surface, and hydraulically connected to the perimeter drainage pipe;
 - Inverts of perimeter drainage pipes should be positioned above the bearing elevation of adjacent footings and at least 12 inches below the adjacent finished floor elevations;
 - All points in the perimeter drainage should have redundant flow paths to the ejection/discharge point(s) to on-site recharge systems;
 - Discharge from the drainage systems should be directed to at least one reliable gravity outlet. If gravity discharge is not possible, effluent should be directed to a sump system having redundant pumps and emergency backup power.
 - The drainage system piping should be provided with cleanouts.
- Surface runoff should be directed away from the buildings. In general, the ground surface within 10 ft immediately around the buildings should be sloped downward away from the structures to divert surface runoff.



NOAA Atlas 14, Volume 10, Version 3
Location name: Wayland, Massachusetts, USA*
Latitude: 42.3631°, Longitude: -71.3881°
Elevation: 158.09 ft**
* source: ESRI Maps
** source: USGS



POINT PRECIPITATION FREQUENCY ESTIMATES

Sanja Perica, Sandra Pavlovic, Michael St. Laurent, Carl Trypaluk, Dale Unruh, Orlan Wilhite

NOAA, National Weather Service, Silver Spring, Maryland

[PF tabular](#) | [PF graphical](#) | [Maps & aerials](#)

PF tabular

PDS-based point precipitation frequency estimates with 90% confidence intervals (in inches)¹										
Duration	Average recurrence interval (years)									
	1	2	5	10	25	50	100	200	500	1000
5-min	0.319 (0.243-0.406)	0.387 (0.296-0.495)	0.499 (0.381-0.640)	0.593 (0.449-0.765)	0.722 (0.532-0.977)	0.818 (0.593-1.13)	0.920 (0.651-1.33)	1.04 (0.697-1.53)	1.22 (0.787-1.86)	1.37 (0.865-2.13)
10-min	0.451 (0.345-0.576)	0.549 (0.419-0.701)	0.709 (0.540-0.909)	0.841 (0.637-1.08)	1.02 (0.754-1.39)	1.16 (0.840-1.61)	1.30 (0.923-1.88)	1.47 (0.986-2.17)	1.72 (1.11-2.63)	1.94 (1.23-3.02)
15-min	0.531 (0.406-0.677)	0.646 (0.493-0.824)	0.834 (0.634-1.07)	0.989 (0.749-1.27)	1.20 (0.887-1.63)	1.36 (0.987-1.89)	1.53 (1.09-2.22)	1.73 (1.16-2.55)	2.03 (1.31-3.10)	2.28 (1.44-3.55)
30-min	0.724 (0.553-0.923)	0.880 (0.672-1.12)	1.14 (0.864-1.46)	1.35 (1.02-1.74)	1.64 (1.21-2.22)	1.86 (1.35-2.58)	2.09 (1.48-3.02)	2.37 (1.58-3.48)	2.77 (1.79-4.22)	3.11 (1.97-4.84)
60-min	0.916 (0.700-1.17)	1.12 (0.851-1.42)	1.44 (1.10-1.85)	1.71 (1.30-2.20)	2.08 (1.53-2.82)	2.36 (1.71-3.27)	2.65 (1.88-3.83)	3.00 (2.01-4.41)	3.51 (2.27-5.36)	3.94 (2.49-6.14)
2-hr	1.18 (0.908-1.49)	1.44 (1.11-1.82)	1.87 (1.43-2.37)	2.22 (1.70-2.84)	2.71 (2.02-3.65)	3.07 (2.25-4.24)	3.46 (2.48-5.00)	3.95 (2.65-5.76)	4.69 (3.04-7.09)	5.33 (3.38-8.22)
3-hr	1.36 (1.06-1.72)	1.67 (1.29-2.10)	2.17 (1.67-2.74)	2.58 (1.98-3.28)	3.15 (2.36-4.22)	3.57 (2.63-4.91)	4.03 (2.90-5.80)	4.60 (3.10-6.68)	5.49 (3.57-8.27)	6.27 (3.99-9.62)
6-hr	1.76 (1.37-2.19)	2.15 (1.68-2.68)	2.79 (2.17-3.49)	3.31 (2.57-4.18)	4.04 (3.05-5.37)	4.58 (3.39-6.24)	5.17 (3.75-7.37)	5.90 (3.99-8.49)	7.05 (4.60-10.5)	8.05 (5.13-12.2)
12-hr	2.23 (1.76-2.76)	2.72 (2.15-3.37)	3.53 (2.77-4.38)	4.19 (3.27-5.24)	5.11 (3.88-6.72)	5.78 (4.31-7.80)	6.52 (4.75-9.19)	7.43 (5.05-10.6)	8.83 (5.78-13.0)	10.0 (6.43-15.1)
24-hr	2.66 (2.12-3.26)	3.28 (2.60-4.02)	4.28 (3.39-5.26)	5.11 (4.03-6.33)	6.26 (4.79-8.16)	7.10 (5.33-9.50)	8.02 (5.88-11.2)	9.17 (6.26-12.9)	10.9 (7.19-16.0)	12.5 (8.01-18.6)
2-day	2.99 (2.40-3.63)	3.73 (3.00-4.54)	4.96 (3.96-6.04)	5.97 (4.74-7.32)	7.37 (5.69-9.55)	8.39 (6.36-11.2)	9.52 (7.05-13.3)	11.0 (7.52-15.3)	13.2 (8.73-19.2)	15.3 (9.83-22.5)
3-day	3.25 (2.63-3.93)	4.05 (3.27-4.90)	5.36 (4.31-6.51)	6.45 (5.15-7.87)	7.95 (6.16-10.2)	9.04 (6.88-12.0)	10.3 (7.63-14.2)	11.8 (8.12-16.4)	14.3 (9.43-20.6)	16.5 (10.6-24.2)
4-day	3.51 (2.84-4.22)	4.34 (3.51-5.22)	5.69 (4.59-6.87)	6.81 (5.46-8.28)	8.36 (6.50-10.7)	9.49 (7.24-12.5)	10.7 (8.01-14.8)	12.3 (8.51-17.1)	14.9 (9.85-21.4)	17.2 (11.1-25.1)
7-day	4.23 (3.46-5.05)	5.09 (4.16-6.09)	6.51 (5.29-7.80)	7.68 (6.20-9.26)	9.29 (7.27-11.8)	10.5 (8.03-13.7)	11.8 (8.80-16.1)	13.4 (9.29-18.4)	16.0 (10.6-22.8)	18.3 (11.8-26.5)
10-day	4.91 (4.03-5.84)	5.80 (4.75-6.90)	7.25 (5.92-8.65)	8.45 (6.86-10.2)	10.1 (7.93-12.8)	11.3 (8.71-14.7)	12.7 (9.45-17.1)	14.3 (9.94-19.5)	16.8 (11.2-23.8)	19.0 (12.3-27.5)
20-day	6.91 (5.72-8.13)	7.87 (6.51-9.27)	9.44 (7.77-11.2)	10.7 (8.79-12.8)	12.5 (9.88-15.5)	13.9 (10.7-17.6)	15.3 (11.3-20.1)	16.9 (11.8-22.8)	19.1 (12.8-26.7)	21.0 (13.6-30.0)
30-day	8.56 (7.13-10.0)	9.57 (7.96-11.2)	11.2 (9.30-13.2)	12.6 (10.4-14.9)	14.5 (11.5-17.8)	16.0 (12.3-20.0)	17.4 (12.9-22.6)	19.0 (13.3-25.4)	21.0 (14.1-29.2)	22.6 (14.7-32.1)
45-day	10.6 (8.89-12.4)	11.7 (9.78-13.6)	13.5 (11.2-15.7)	14.9 (12.3-17.6)	16.9 (13.4-20.6)	18.5 (14.3-23.0)	20.1 (14.8-25.6)	21.5 (15.2-28.6)	23.4 (15.8-32.3)	24.7 (16.1-34.9)
60-day	12.3 (10.4-14.3)	13.5 (11.3-15.6)	15.3 (12.8-17.8)	16.9 (14.0-19.7)	19.0 (15.1-23.0)	20.6 (16.0-25.4)	22.2 (16.4-28.2)	23.7 (16.8-31.3)	25.4 (17.2-34.9)	26.6 (17.4-37.4)





¹ Precipitation frequency (PF) estimates in this table are based on frequency analysis of partial duration series (PDS). Numbers in parenthesis are PF estimates at lower and upper bounds of the 90% confidence interval. The probability that precipitation frequency estimates (for a given duration and average recurrence interval) will be greater than the upper bound (or less than the lower bound) is 5%. Estimates at upper bounds are not checked against probable maximum precipitation (PMP) estimates and may be higher than currently valid PMP values. Please refer to NOAA Atlas 14 document for more information.

[Back to Top](#)

PF graphical

PDS-based depth-duration-frequency (DDF) curves


Latitude: 42.3631°, Longitude: -71.3881°

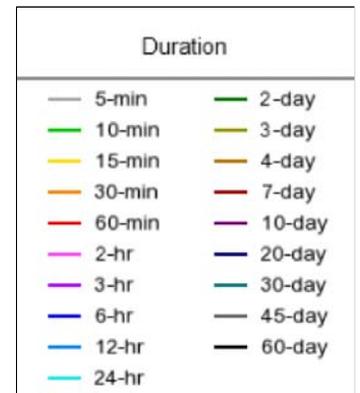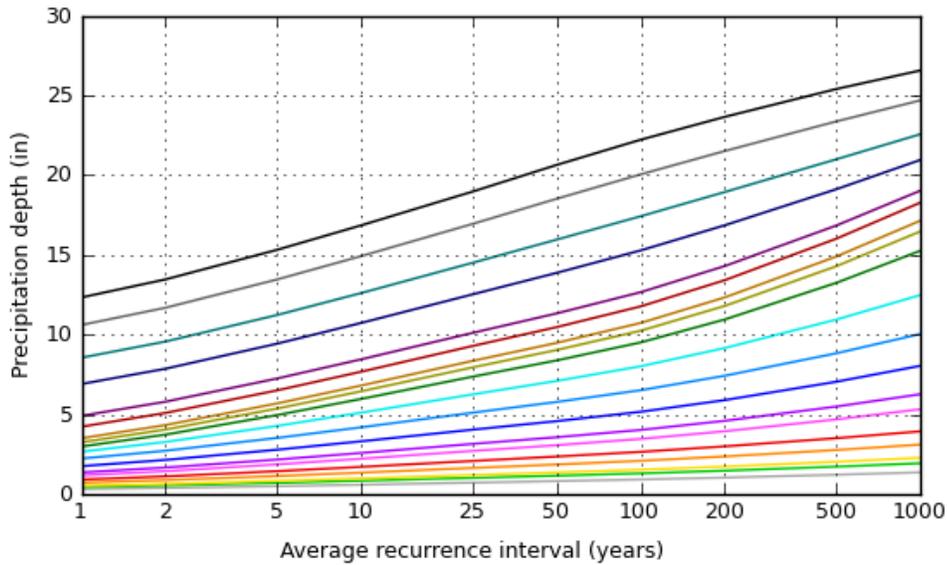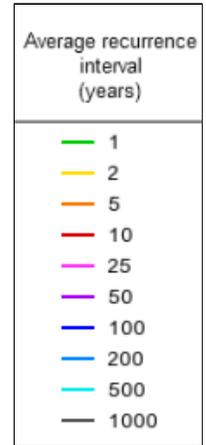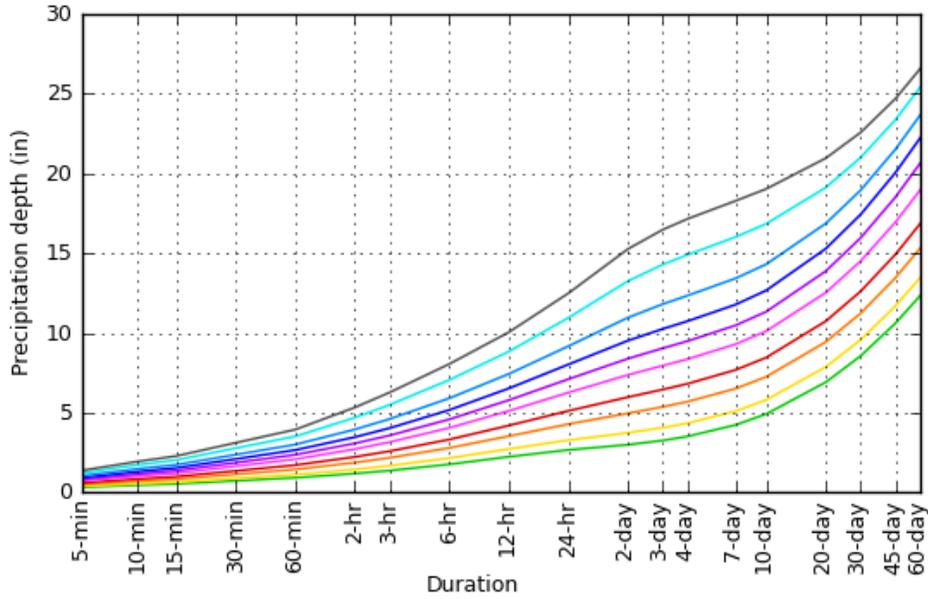


[Back to Top](#)

Maps & aerials

Small scale terrain

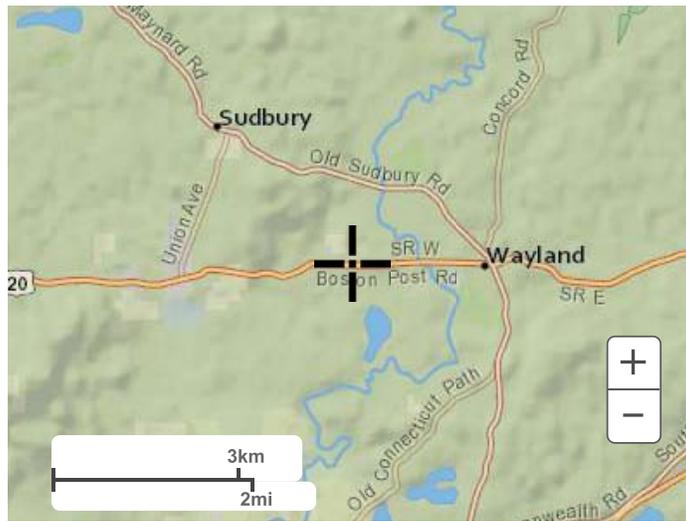


Large scale terrain

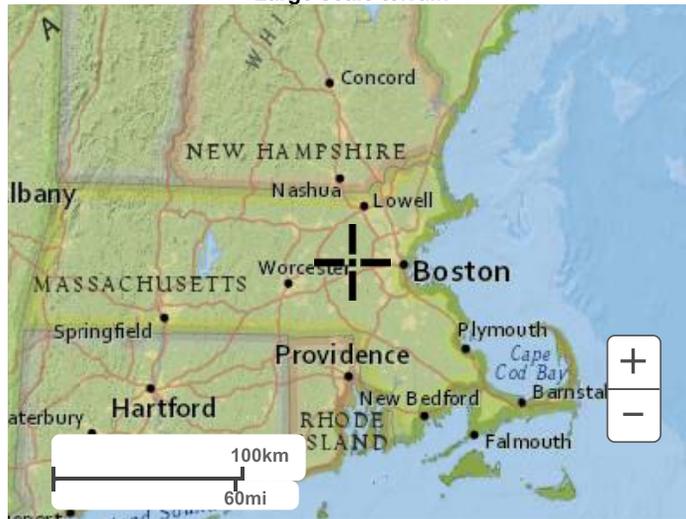

Large scale map



Large scale aerial

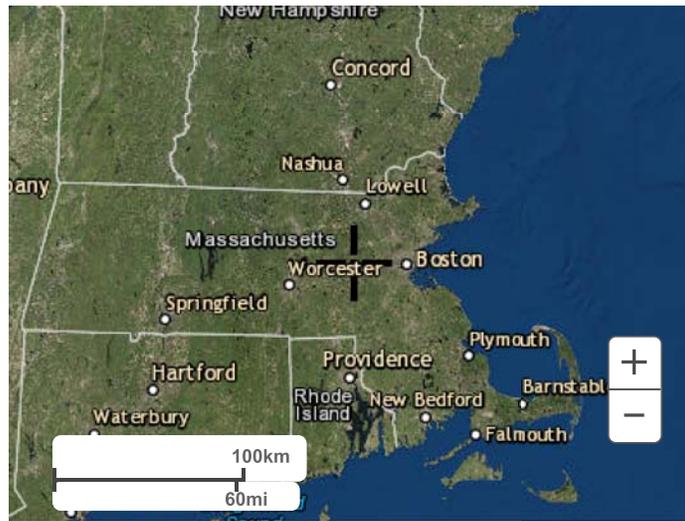

[Back to Top](#)

[US Department of Commerce](#)
[National Oceanic and Atmospheric Administration](#)
[National Weather Service](#)
[National Water Center](#)
1325 East West Highway
Silver Spring, MD 20910
Questions?: HDSC.Questions@noaa.gov

[Disclaimer](#)

Manning's Roughness Coefficients ("n")

Conduit	Manning's Coefficients
Closed Conduits	
Asbestos-Cement Pipe	0.011 to 0.015
Brick	0.013 to 0.017
Cast Iron Pipe Cement-lined and seal-coated	0.011 to 0.015
Concrete (Monolithic) Smooth forms	0.012 to 0.014
Rough forms	0.015 to 0.017
Concrete Pipe	0.011 to 0.015
Corrugated-Metal Pipe (1/2 - STUL 34470 2 1/2-inch corrgrtn.) Plain	0.022 to 0.026
Paved invert	0.018 to 0.022
Spun asphalt-lined	0.011 to 0.015
Plastic Pipe (Smooth)	0.011 to 0.015
Vitrified Clay Pipes	0.011 to 0.015
Liner channels	0.013 to 0.017
Open Channels	
Lined Channels Asphalt	0.013 to 0.017
Brick	0.012 to 0.018
Concrete	0.011 to 0.020
Rubble or riprap	0.020 to 0.035
Vegetal	0.030 to 0.040
Excavated or Dredged Earth, straight and uniform	0.020 to 0.030
Earth, winding, fairly uniform	0.025 to 0.040
Rock	0.030 to 0.045
Unmaintained	0.050 to 0.140
Natural Channels (minor streams, top width at flood state < 100 feet) Fairly regular section	0.030 to 0.070
Irregular section with pools	0.040 to 0.100

Source: Design and Construction of Sanitary and Storm Sewers, American Society of Civil Engineers and the Water Pollution Control Federation, 1969.



State of New Jersey

DEPARTMENT OF ENVIRONMENTAL PROTECTION

Bureau of Nonpoint Pollution Control

Division of Water Quality

Post Office Box 029

Trenton, New Jersey 08625-029

609-633-7021 Fax: 609-984-2147

http://www.state.nj.us/dep/dwq/bnpc_home.htm

CHRIS CHRISTIE
Governor

KIM GUADAGNO
Lt. Governor

BOB MARTIN
Acting Commissioner

Derek Berg
Regulatory Manager – Stormwater
CONTECH Engineered Solutions
200 Enterprise Drive
Scarborough, ME 04074

Re: Final Certification
Continuous Deflective Separator (CDS) by CONTECH Engineered Solutions LLC

Expiration Date: December 1, 2016

TSS Removal Rate: 50%

Dear Mr. Berg:

The Stormwater Management rules under N.J.A.C. 7:8-5.5(b) and 5.7(c) allow the use of manufactured treatment devices (MTDs) for compliance with the design and performance standards at N.J.A.C. 7:8-5 if the pollutant removal rates have been verified by the New Jersey Corporation for Advanced Technology (NJCAT) and have been certified by the New Jersey Department of Environmental Protection (NJDEP). CONTECH Engineered Solutions LLC has requested a Final Certification for the Continuous Deflective Separator (CDS) Stormwater Treatment System.

This project falls under the July 15, 2011 “Transition for Manufactured Treatment Devices,” under *C. Manufactured Treatment Devices Seeking Final Certification – In Process* which are MTDs that have commenced field testing on or before August 1, 2011.

NJDEP received the required information and signed statements by the NJCAT Technical Director and the manufacturer indicating that the requirements of the Field Testing Protocols in place at the initiation of testing have been met or exceeded. The NJCAT letter also includes a recommended certified TSS removal rate and the required maintenance plan.

The NJDEP certifies the use of the CONTECH Engineered Solutions LLC CDS Stormwater Treatment System at a TSS removal rate of 50%, subject to the following conditions:

1. The various models and associated water quality flow capacities shall be sized for the peak flow of the New Jersey Water Quality Design Storm per N.J.A.C. 7:8-5, as shown in Table 1 below.


New Jersey Treatment Rates for CDS Models Based on a Surface Area Specific Loading Rate of 25.16gpm/ft ²		
CDS Model	Manhole Diameter (ft)	Treatment Flow Rate (cfs)
CDS-4	4	0.7
CDS-5	5	1.1
CDS-6	6	1.6
CDS-8	8	2.8
CDS-10	10	4.4
CDS-12	12	6.3

2. The CDS Stormwater Treatment System can be used on-line or off-line.
3. A hydrodynamic separator, such as the CDS Stormwater Treatment System, cannot be used in series with another hydrodynamic separator to achieve an enhanced removal rate for total suspended solids (TSS) removal under N.J.A.C. 7:8-5.5.
4. The maintenance plan for the sites using this device shall incorporate at a minimum, the maintenance requirements for the CDS Stormwater Treatment System shown attached.

In addition to the attached, the detailed maintenance plan must include all of the items identified in Chapter 8: Maintenance of the New Jersey Stormwater Best Management Manual. Such items include, but are not limited to, the list of inspection and maintenance equipment and tools, specific corrective and preventative maintenance tasks, indication of problems in the system, and training of maintenance personnel.

Additional information regarding the implementation of the Stormwater Management rules N.J.A.C. 7:8 are available at www.njstormwater.org. Please contact Sandra Blick of my office at (609) 633-7021 if you have any questions.

Sincerely,

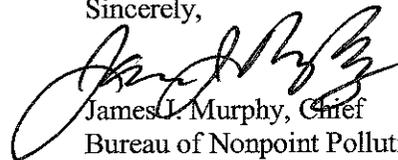

James L. Murphy, Chief
Bureau of Nonpoint Pollution Control

c: Chron File
Richard Magee, NJCAT
Mark Pedersen, DLUR
Elizabeth Dragon, BNPC

CDS Maintenance

The CDS system must be inspected at regular intervals and maintained when necessary to ensure optimum performance. The rate at which the system collects pollutants will depend more heavily on site activities than the size of the unit, e.g., unstable soils or heavy winter sanding will cause the grit chamber to fill more quickly but regular sweeping will slow accumulation.

Inspection

Inspection is the key to effective maintenance and is easily performed. Pollutant deposition and transport may vary from year to year and regular inspections will help insure that the system is cleaned out at the appropriate time. At a minimum, inspections must be performed twice per year (i.e. spring and fall) however more frequent inspections may be necessary in climates where winter sanding operations may lead to rapid pollutant accumulations, or in equipment washdown areas. Additionally, installations where excessive amounts of trash are expected should be inspected more frequently.

The visual inspection must ascertain that the system components are in working order and that there are no blockages or obstructions to the inlet and/or separation screen. The inspection must also identify accumulations of hydrocarbons, trash, and sediment in the system. Measuring pollutant accumulation can be done with a calibrated dipstick such as a stadia rod, tape measure or other measuring instrument. If sorbent material is used for enhanced removal of hydrocarbons then the level of discoloration of the sorbent material should also be identified during inspection. Sorbent material must be replaced when it is predominantly dark in color (similar to oil). It is useful and often required as part of a permit to keep a record of each inspection.

Access to the CDS unit is typically achieved through two manhole access covers. One opening allows for inspection and cleanout of the separation chamber (screen/cylinder) and isolated sump. The other allows for inspection and cleanout of sediment captured and retained behind the screen. For units possessing a sizable depth below grade (depth to pipe), a single access point allows for both sump cleanout and access behind the screen.

The CDS system must be cleaned when the level of sediment in the sump has reached a depth of 12 inches or more to avoid exceeding the maximum 24 inch sediment depth and/or when an appreciable level of hydrocarbons and trash has accumulated. If sorbent material is used, it must be replaced when significant discoloration has occurred. Performance will not be impacted until 100% of the sump capacity is exceeded however it is recommended that the system be cleaned prior to that for easier removal of sediment. The level of sediment is easily determined by measuring from finished grade down to the top of the sediment pile. To avoid underestimating the level of sediment in the chamber, the measuring device must be lowered to the top of the sediment pile carefully. Finer, silty particles at the top of the pile typically offer less resistance to the end of the rod than larger particles toward the bottom of the pile. Once this measurement is recorded, it should be compared to the as-built drawing for the unit to determine if the height of the sediment pile off the bottom of the sump floor exceeds 75% (18 inches) of the total height of isolated sump.

Cleaning

Cleaning of the CDS systems should be done during dry weather conditions when no flow is entering the system. Cleanout of the CDS with a vacuum truck is generally the most effective and convenient method of excavating pollutants from the system. Simply remove the manhole covers and insert the vacuum hose into the sump. The system should be completely drained down and the sump fully evacuated of sediment. The area outside the screen should also be pumped out if pollutant build-up exists in this area.

In installations where the risk of petroleum spills is small, liquid contaminants may not accumulate as quickly as sediment. However, an oil or gasoline spill should be cleaned out immediately. Motor oil and other hydrocarbons that accumulate on a more routine basis must be removed when an appreciable layer has been captured. To remove these pollutants, it may be preferable to use adsorbent pads since they are usually less expensive to dispose of than the oil/water emulsion that may be created by vacuuming the oily layer. Trash can be netted out if you wish to separate it from the other pollutants. The screen should be power washed to ensure it is free of trash and debris.

Manhole covers should be securely seated following cleaning activities to prevent leakage of runoff into the system from above and also to ensure proper safety precautions. Confined Space Entry procedures need to be followed.

Disposal of all material removed from the CDS system must be done in accordance with local regulations. In many locations, disposal of evacuated sediments may be handled in the same manner as disposal of sediments removed from catch basins or deep sump manholes. Check your local regulations for specific requirements on disposal.

#490 BOSTON POST ROAD, WAYLAND, MA

Allen & Major Associates, Inc.

Computation Sheet

Title:	RipRap Sizing Spreadsheet	By	DMR/SJL
Project:	#490 Boston Post Road, Wayland, MA	Chk'd	CMQ
Date:	June 20, 2019	Apprv'd	CMQ
Revised:	-----		
A&M Project Number:	1670-09A		

OUTLET	Do (ft.)	Q25 (cfs)***	Tw (ft.)	La (ft.)	Wup (ft.)	Wdn (ft.)**	d50 (ft.)*
Headwall-1	1.25	5.63	0.5	16.0	3.8	19.8	0.30
Headwall-2	1.50	10.77	0.5	21.1	4.5	25.6	0.59

Notes:

Assume 6" Tw at Outfall
Use MHD M2.02.2 Stone
Depth of Stone to be 6" or 1.5 times d50 - which ever is larger

***6" Minimum Stone Diameter**
****Apron width shall meet defined downstream channel**
****See pipe sizing spreadsheet for Q25 flows**

When Tw < 0.5Do at pipe outlet:

$La = 1.8Q/Do^{1.5} + 7Do$
 $Wup = 3Do$
 $Wdn = 3Do + La$
 $d50 = (0.02Q^{1.3})/(TwDo)$

Where:

Tw = the tailwater depth at the outlet of the pipe or channel
Do = the diameter of the pipe or the width of channel
Q = the discharge from the pipe of channel (25 year Storm)
La = the length of apron
Wup = the upstream width of apron
Wdn = the downstream width of apron
d50 = the median stone diameter

When Tw > or = 0.5Do at pipe outlet:

$La = 3Q/Do^{1.5} + 7Do$
 $Wup = 3Do$
 $Wdn = 3Do + 0.4La$
 $d50 = (0.02Q^{1.3})/(TwDo)$

Title **MA DEP Standard Calculations**
 Project 490 Boston Post Road
 Date June 20, 2019
 Revised October 18, 2019

By SJL
 Chk'd CMQ
 Apprv'd CMQ

Stormwater Recharge/Water Quality Volume Table

$R_v = F * \text{Impervious Area}$

R_v = Required Recharge Volume, expressed in ft³, cubic yards or acre-feet

F = Target Depth Factor associated with each Hydraulic Soil Group

Impervious Area = pavement & rooftop area on site

V_{wq} = Required Water Quality Treatment Volume (ft³)

D_{wq} = Water Quality Depth (in)

A_{IMP} = Impervious Area (excluding non-metal roofs)

W\SHED	Area (Sq. Ft)	Landscaped	Impervious Area by Soil HSG		Recharge Required			Water Quality Volume Required	
			HSG B (F=.35)	HSG C (F=.25)	F Avg. (Inches)	Impervious Area (Sq. Ft)	R_v (ft ³)	D_{wq} (Inch)	V_{wq}
P-1	68,972	68,972	0	0	0.000	0	0	1.0	0
P-2	36,597	6,318	30,279	0	0.350	30,279	883	1.0	2,523
P-3	26,061	8,353	17,708	0	0.350	17,708	516	1.0	1,476
P-4	16,268	16,268	0	0	0.000	0	0	1.0	0
P-5A (ROOF)	13,281	0	13,281	0	0.350	13,281	387	1.0	1,107
P-5B (ROOF)	14,024	0	14,024	0	0.350	14,024	409	1.0	1,169
P-6A (ROOF)	14,509	0	14,509	0	0.350	14,509	423	1.0	1,209
P-6B (ROOF)	14,496	0	14,496	0	0.350	14,496	423	1.0	1,208
P-7 (ROOF)	22,302	0	22,302	0	0.350	22,302	650	1.0	1,859
P-8	27,926	17,726	10,200	0	0.350	10,200	298	1.0	850
P-9A	12,432	9,358	3,074	0	0.350	3,074	90	1.0	256
P-9B	48,784	35,711	13,073	0	0.350	13,073	381	1.0	1,089
P-10	32,520	14,660	17,860	0	0.350	17,860	521	1.0	1,488
P-11	12,625	6,399	6,226	0	0.350	6,226	182	1.0	519
Total	360,797	183,765	177,032	0		177,032	5,163		14,753

Title **MA DEP Standard Calculations**
 Project 490 Boston Post Road
 Date June 20, 2019
 Revised October 18, 2019

By SJL
 Chk'd CMQ
 Apprv'd CMQ

Stormwater Recharge Summary

$R_v = F * \text{Impervious Area}$

R_v = Required Recharge Volume, expressed in ft^3 , cubic yards or acre-feet

F = Target Depth Factor associated with each Hydraulic Soil Group

	Required (cf)	Provided (cf)	
$R_v =$	1,650	4,815	Underground Infiltration System #1 (P-4, P-5B, P-6B, P-8 & P-10)
$R_v =$	1,783	5,141	Underground Infiltration System #2 (P-2, P-5A, P-6A & P-9A)
$R_v =$	1,548	5,604	Underground Infiltration System #3 (P-3, P-7, & P-9B)
$R_v =$	182	0	Untreated Flows (P-1 & P-11)
$R_v =$	5,163	15,560	

Water Quality Volume

V_{wq} = Required Water Quality Treatment Volume, expressed in ft^3

D_{wq} = Water Quality Depth

A_{imp} = Impervious Area (pavement & rooftop area excluding non-metal roofs)

	Required (cf)	Provided (cf)	
$V_{wq} =$	4,715	4,815	Underground Infiltration System #1 (P-4, P-5B, P-6B, P-8 & P-10)
$V_{wq} =$	5,095	5,141	Underground Infiltration System #2 (P-2, P-5A, P-6A & P-9A)
$V_{wq} =$	4,424	5,604	Underground Infiltration System #3 (P-3, P-7, & P-9B)
$V_{wq} =$	519	0	Untreated Flows (P-1 & P-11)
$V_{wq} =$	14,753	15,560	

Draindown Within 72 Hours

$Time_{drawdown} = (R_v) / (\text{Design Infiltration Rate in inches per hour})$ (Conversion for inches to feet) (1/bottom area in feet)

Underground Infiltration System #1 (Loamy Sand - 1/2 Rawls Rate)	
Infiltration Rate (in/Hr)=	1.205
Bottom Area (ft^2)=	4,465
Infiltration Volume (ft^3)=	4,815
$Time_{drawdown}$ (Hours)=	10.74

Underground Infiltration System #2 (Loamy Sand - 1/2 Rawls Rate)	
Infiltration Rate (in/Hr)=	1.205
Bottom Area (ft^2)=	4,465
Infiltration Volume (ft^3)=	5,141
$Time_{drawdown}$ (Hours)=	11.47

Underground Infiltration System #3 (Loamy Sand - 1/2 Rawls Rate)	
Infiltration Rate (in/Hr)=	1.205
Bottom Area (ft^2)=	3,933
Infiltration Volume (ft^3)=	5,604
$Time_{drawdown}$ (Hours)=	14.19

Title **MA DEP Standard Calculations**
 Project **490 Boston Post Road**
 Date **June 20, 2019**
 Revised **October 18, 2019**
TSS Removal Calculation Worksheet

By SJL
 Chk'd CMQ
 Apprv'd CMQ

B BMP ¹	C TSS Removal Rate ¹	D Starting TSS Load*	E Amount Removed (C*D)	F Remaining Load (D-E)	B BMP ¹	C TSS Removal Rate ¹	D Starting TSS Load*	E Amount Removed (C*D)	F Remaining Load (D-E)
Deep Sump Catch Basins	0.25	1.00	0.25	0.75	Deep Sump Catch Basins	0.25	1.00	0.25	0.75
Contech Proprietary Device	0.50	0.75	0.38	0.38	Contech Proprietary Device	0.50	0.75	0.38	0.38
Subsurface Infiltration System #2	0.80	0.38	0.30	0.08	Subsurface Infiltration System #2	0.80	0.38	0.30	0.08
Total TSS Removal =			93%		Total TSS Removal =			93%	

B BMP ¹	C TSS Removal Rate ¹	D Starting TSS Load*	E Amount Removed (C*D)	F Remaining Load (D-E)
Deep Sump Catch Basins	0.25	1.00	0.25	0.75
Contech Proprietary Device	0.50	0.75	0.38	0.38
Subsurface Infiltration System #2	0.80	0.38	0.30	0.08
Total TSS Removal =			93%	

Title **MA DEP Standard Calculations**
 Project **490 Boston Post Road**
 Date **June 20, 2019**
 Revised **October 18, 2019**
Mounding Analysis

By SJL
 Chk'd CMQ
 Apprv'd CMQ

<i>Infiltration System</i>	<i>Water Table</i>	<i>System Bottom</i>	<i>Vertical Separation</i>	<i>Attenuated System</i>	<i>Mounding Analysis Required</i>
1	120.00	134.50	14.5	Yes	No
2	120.00	125.00	5.0	Yes	No
3	120.00	124.00	4.00	Yes	No

Water Quality Flow Rate Calculations for Proprietary Stormwater Separators

Reference: **Massachusetts Department of Environmental Protection Wetlands**
Program: Standard Method to Convert Water Quality Volume to a Discharge
 Rate for Sizing Flow Based Manufactured Proprietary Stormwater Treatment

Structure Name	Total Area (Acres)	Imp. Area (Acres)	A ^{IMP} (Sq. Miles)	Tc (min.)	Tc (hrs.)	WQV (inches)	qu (csm/in)
CDS #1	0.71	0.35	0.00055	6.0	0.10	1	774
CDS #2	0.87	0.55	0.00086	6.0	0.10	1	774
CDS #3	0.68	0.48	0.00075	6.0	0.10	1	774
CDS #4	0.86	0.43	0.00067	6.0	0.10	1	774

Water Quality Flow Rate = Q1 = (qu) (A) (WQV)

Structure Name	Q1 (cfs)
CDS #1	0.42
CDS #2	0.67
CDS #3	0.58
CDS #4	0.52

Title **Pipe Sizing Table**
 Project #490 Boston Post Road, Wayland, MA
 Date June 20, 2019
 Revised October 18, 2019
 A&M Project Number: 1670-09A

Minimum Slope: 0.50%
 Minimum Pipe Size: 8
 Rainfall Intensity (in/hr): 6.00 (25 year storm)
 Manning's n: 0.012 HDPE/PVC
 Minimum Pipe Cover: 1.86

By SJL
 Chk'd CMQ
 Apprv'd CMQ

#164 Lexington Road

Line		Length (feet)	Area (acres)	wgt. C	CA	Req'd. Capac. Qd (cfs)	Pipe Size D (in)	Slope s (%)	Design Capacity		Drop (feet)	Invert Elevation		Rim Elev. Upper (ft)	Cover (ft)
From Upper	To Lower								Q _{full} (cfs)	V _{full} (fps)		Upper (ft)	Lower (ft)		
CB1	CDS1	9	0.176	0.76	0.134	0.80	12	5.00%	8.6	10.99	0.45	136.00	135.55	143.25	6.13
CB2	CDS1	9	0.166	0.64	0.106	0.64	12	5.00%	8.6	10.99	0.45	136.00	135.55	143.25	6.13
CDS1	DMH1/UIS1	21				1.44	12	1.00%	3.9	4.91	0.21	135.55	135.34	143.45	6.77
RD1	UIS1	43	0.232	0.95	0.220	1.32	12	2.00%	5.5	6.95	0.86	137.11	136.25	144.20	5.96
RD2	UIS1	43	0.287	0.95	0.273	1.64	12	2.00%	5.5	6.95	0.86	137.11	136.25	144.20	5.96
CB3	DMH2	31	0.404	0.65	0.261	1.57	12	5.00%	8.6	10.99	1.55	136.80	135.25	142.00	4.07
AD5	UIS1	125	0.641	0.35	0.224	1.35	12	3.00%	6.7	8.51	3.75	140.00	136.25	144.50	3.38
AD2	UIS1	145	0.373	0.73	0.271	1.63	12	1.00%	3.9	4.91	1.45	137.45	136.00	144.50	5.93
OCS1	DMH7	408	<i>(From HydroCAD 100-Year Storm)</i>			7.04	15	2.00%	9.9	8.06	8.16	135.25	127.09	143.40	6.78
AD11	DMH3	63	0.417	0.45	0.188	1.13	8	1.00%	1.3	3.75	0.63	135.25	134.62	143.00	6.96
AD12	DMH3	10	0.417	0.45	0.188	1.13	8	5.00%	2.9	8.39	0.50	135.12	134.62	143.00	7.09
AD13	DMH3	34	0.417	0.45	0.188	1.13	8	5.00%	2.9	8.39	1.70	136.32	134.62	143.00	5.89
RD5	DMH3	69	0.117	0.95	0.111	0.67	12	2.00%	5.5	6.95	1.38	136.00	134.62	139.25	2.13
RD6	UIS2	23	0.333	0.95	0.316	1.90	12	5.00%	8.6	10.99	1.15	128.15	127.00	134.00	4.72
DMH3	DMH8	62				5.95	12	5.00%	8.6	10.99	3.10	133.62	130.52	139.90	5.16
CB5	DMH8	162	0.326	0.83	0.270	1.62	12	0.76%	3.4	4.28	1.23	128.35	127.12	131.50	2.03
DMH8	CDS2	122				7.57	18	1.00%	11.4	6.44	1.22	127.02	125.80	136.00	7.36
CB4	CDS2	21	0.514	0.87	0.444	2.67	12	5.00%	8.6	10.99	1.05	126.85	125.80	133.00	5.03
CDS2	DMH4	5				10.24	18	1.00%	11.4	6.44	0.05	125.80	125.75	131.80	4.38
OCS2	HW1	26	<i>(From HydroCAD 100-Year Storm)</i>			7.36	15	2.00%	9.9	8.06	0.52	125.75	125.23	133.10	5.97
CB6	CDS3	14	0.430	0.71	0.304	1.82	12	5.00%	8.6	10.99	0.70	126.10	125.40	130.00	2.78
CB7	CDS3	62	0.064	0.95	0.061	0.37	12	1.00%	3.9	4.91	0.62	126.02	125.40	129.00	1.86
CDS3	DMH5	65				2.19	12	1.00%	3.9	4.91	0.65	125.40	124.75	130.30	3.78
RD3	UIS3	48	0.136	0.95	0.129	0.78	12	5.00%	8.6	10.99	2.40	128.15	125.75	133.00	3.72
RD4	UIS3	52	0.117	0.95	0.111	0.67	12	5.00%	8.6	10.99	2.60	128.35	125.75	133.00	3.53
CB8	DMH9	19	0.126	0.95	0.120	0.72	12	3.00%	6.7	8.51	0.57	126.61	126.04	130.00	2.27
CB9	DMH9	19	0.220	0.59	0.130	0.78	12	3.00%	6.7	8.51	0.57	126.61	126.04	130.00	2.27
AD11	DMH9	19	0.643	0.43	0.277	1.66	8	2.00%	1.9	5.30	0.38	126.42	126.04	129.00	1.79
DMH9	CDS4	94				3.16	12	1.00%	3.9	4.91	0.94	125.94	125.00	129.10	2.04
CB10	CDS4	9	0.104	0.71	0.074	0.44	12	5.00%	8.6	10.99	0.45	125.45	125.00	130.00	3.43
CDS4	DMH6	15				3.60	15	1.00%	7.0	5.70	0.15	125.00	124.85	130.30	3.93
OCS3	DMH7	44	<i>(From HydroCAD 100-Year Storm)</i>			6.41	18	1.00%	11.4	6.44	0.44	124.75	124.31	131.00	4.63
DMH7	HW2	60	<i>(From HydroCAD 100-Year Storm)</i>			13.45	24	1.00%	24.6	7.80	0.60	124.21	123.61	128.20	1.86

#490 BOSTON POST ROAD, WAYLAND, MA

Computation Sheet

Title: **RipRap Sizing Spreadsheet**
Project: #490 Boston Post Road, Wayland, MA
Date: June 20, 2019
Revised: September 27, 2019
A&M Project Number: 1670-09A

By	DMR/SJL
Chk'd	CMQ
Apprv'd	CMQ

OUTLET	Do (ft.)	Q25 (cfs)***	Tw (ft.)	La (ft.)	Wup (ft.)	Wdn (ft.)**	d50 (ft.)*
Headwall-1	1.25	5.28	0.5	15.6	3.8	19.3	0.28
Headwall-2	2.00	9.73	0.5	20.2	6.0	26.2	0.39

Notes:

Assume 6" Tw at Outfall
Use MHD M2.02.2 Stone
Depth of Stone to be 6" or 1.5 times d50 - which ever is larger

***6" Minimum Stone Diameter**
****Apron width shall meet defined downstream channel**
****See pipe sizing spreadsheet for Q25 flows**

When Tw < 0.5Do at pipe outlet:

$La = 1.8Q/Do^{1.5} + 7Do$
 $Wup = 3Do$
 $Wdn = 3Do + La$
 $d50 = (0.02Q^{1.3})/(TwDo)$

Where:

Tw = the tailwater depth at the outlet of the pipe or channel
Do = the diameter of the pipe or the width of channel
Q = the discharge from the pipe of channel (25 year Storm)
La = the length of apron
Wup = the upstream width of apron
Wdn = the downstream width of apron
d50 = the median stone diameter

When Tw > or = 0.5Do at pipe outlet:

$La = 3Q/Do^{1.5} + 7Do$
 $Wup = 3Do$
 $Wdn = 3Do + 0.4La$
 $d50 = (0.02Q^{1.3})/(TwDo)$

Illicit Discharge Compliance Statement

Responsibility:

The Owner is responsible for ultimate compliance with all provisions of the Massachusetts Stormwater Management Policy, the USEPA NPDES Construction General Permit and responsible for identifying and eliminating illicit discharges (as defined by the USEPA).

OWNER NAME: WP East Acquisitions, LLC.

ADDRESS: 91 Hartwell Avenue, 3rd Floor

Lexington, MA 02421

TEL. NUMBER: (781) 541-5822

Engineer's Compliance Statement:

To the best of my knowledge, the attached plans, computations and specifications meet the requirements of Standard 10 of the Massachusetts Stormwater Handbook regarding illicit discharges to the stormwater management system and that no detectable illicit discharges exist on the site. All documents and attachments were prepared under my direction and qualified personnel properly gathered and evaluated the information submitted, to the best of my knowledge.

Included with this statement are site plans, drawn to scale, that identify the location of systems for conveying stormwater on the site and show that these systems do not allow the entry of any illicit discharges into the stormwater management system. The plans also show any systems for conveying wastewater and/or groundwater on the site and show that there are no connections between the stormwater and wastewater systems.

For a redevelopment project (if applicable), all actions taken to identify and remove illicit discharges, including without limitation, visual screening, dye or smoke testing, and the removal of any sources of illicit discharges to the stormwater management system are documented and included with this statement.