

# MEMORANDUM

**TO:** Ben Keefe, Town of Wayland Public Building Director

**FROM:** Jill Getchell, Kevin MacKinnon, PG, CG, PH-GW

**DATE:** August 30, 2021

**SUBJECT:** Wayland High School Groundwater and Surface Water Perfluorinated Alkyl Acids Results

---

## Introduction

Pursuant of the Town of Wayland's request, Weston & Sampson Engineers, Inc. collected groundwater and surface water samples to provide insight on the potential source of Perfluorinated Alkyl Acids (PFAS) identified at the Happy Hollow Wellfield, the Town of Wayland's largest drinking water supply source.

The Massachusetts Department of Environmental Protection (MassDEP) has determined a maximum contaminant level (MCL) of 20 parts per trillion (ppt) for the Total PFAS (6), which includes: Perfluorooctane Sulfonic Acid (PFOS), Perfluorooctanoic Acid (PFOA), Perfluorohexane Sulfonic Acid (PFHxS), Perfluorononanoic Acid (PFNA), Perfluoroheptanoic Acid (PFHpA) and Perfluorodecanoic Acid (PFDA).

## Work Performed and Results

On August 6, 2021 Weston & Sampson mobilized to sample three monitoring wells (SH-4, MW-1S and MW-6) shown on Figure 1 and five surface water locations (SW-1, SW-2, SW-3, SW-4 and SW-5) shown on Figure 2 for PFAS. Groundwater and Surface Water samples were taken in accordance with EPA Standards. Samples for laboratory analysis were collected by a qualified technician and analyzed by a Massachusetts and EPA certified laboratory, Alpha Analytical.

The compounds detected at MW-6 were Perfluorobutanesulfonic Acid- PFBS (2.54 ng/l), Perfluorohexanoic Acid- PFHxA (7.23 ng/l), Perfluoroheptanoic Acid-PFHxA (3.28 ng/l), Perfluorohexanesulfonic Acid-PFHxS (2.12 ng/l), Perfluorooctanoic Acid-PFOA (11.9 ng/l), and Perfluorooctanesulfonic Acid- PFOS (9.73 ng/l). The Total PFAS6 concentration is reported to be 27 ng/l, which is above the MCL.

The compounds detected at MW-1S were Perfluorobutanesulfonic Acid- PFBS (9.26 ng/l), Perfluorohexanoic Acid- PFHxA (25.9 ng/l), Perfluoroheptanoic Acid-PFHxA (14 ng/l), Perfluorohexanesulfonic Acid-PFHxS (4.8 ng/l), Perfluorooctanoic Acid-PFOA (49.6 ng/l), and Perfluorooctanesulfonic Acid- PFOS (7.97 ng/l). The Total PFAS6 concentration is reported to be 76.4 ng/l, which is above the MCL.

The compounds detected at SH-4 were Perfluorobutanesulfonic Acid- PFBS (2.65 ng/l), Perfluorohexanoic Acid- PFHxA (82.5 ng/l), Perfluoroheptanoic Acid-PFH<sub>p</sub>A (27.6 ng/l), Perfluorohexanesulfonic Acid-PFHxS (5.79 ng/l), Perfluorooctanoic Acid-PFOA (84 ng/l), Perfluorononanoic Acid- PFNA (1.85 ng/l) and Perfluorooctanesulfonic Acid- PFOS (2.3 ng/l). The Total PFAS6 concentration is reported to be 76.4 ng/l, which is above the MCL.

The PFAS compounds detected in the groundwater samples collected in 2021 are summarized in Table 1 below as well as on Figure 1 attached.

Table 1: 2021 Wayland High School Perfluorinated Alkyl Acids Groundwater Results

	10/30/2019	10/15/2019		3/30/2021		4/19/2021			8/6/2021		
	SH-4	MW-1	MW-6	SH-4	MW-6	SH-4	MW-1	MW-6	SH-4	MW-1	MW-6
Perfluoroheptanoic Acid (PFHpA)	3.47	ND	4.36	14.4	1.98	9.4	2.16	3.66	27.6	14	3.3
Perfluorohexanesulfonic Acid (PFHxS)	ND	ND	2.94	3.15	2.12	2.43	4.22	3.44	5.79	4.8	2.1
Perfluorooctanoic Acid (PFOA)	6.85	ND	13	40.1	11.4	27.8	9.36	12.2	84	49.6	11.9
Perfluorononanoic Acid (PFNA)	ND	ND	ND	ND	ND	ND	ND	ND	1.85	ND	ND
Perfluorooctanesulfonic Acid (PFOS)	2.47	ND	9.5	ND	9.79	ND	4.99	10.8	2.3	7.97	9.7
Perfluorodecanoic Acid (PFDA)	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Perfluorobutanoic Acid (PFBA)	NS	NS	NS	10.6	NS	NS	NS	NS	NS	NS	NS
Perfluoropentanoic Acid (PFPeA)	NS	NS	NS	36	NS	NS	NS	NS	NS	NS	NS
Perfluorobutanesulfonic Acid (PFBS)	ND	ND	2.64	1.99	2.54	ND	6.78	3.27	2.65	9.26	2.5
1H,1H,2H,2H-Perfluorohexanesulfonic Acid (4:2FTS)	NS	NS	NS	ND	NS	NS	NS	NS	NS	NS	NS
Perfluorohexanoic Acid (PFHxA)	27.3	ND	10.1	40.9	7.49	30.4	2.84	7.89	82.5	25.9	7.2
Perfluoropentanesulfonic Acid (PFPeS)	ND	ND	ND	ND	NS	NS	NS	NS	NS	NS	NS
1H,1H,2H,2H-Perfluorooctanesulfonic Acid (6:2FTS)	ND	ND	ND	ND	NS	NS	NS	NS	NS	NS	NS
Perfluoroheptanesulfonic Acid (PFHpS)	ND	ND	ND	ND	NS	NS	NS	NS	NS	NS	NS
1H,1H,2H,2H-Perfluorodecanesulfonic Acid (8:2FTS)	ND	ND	ND	ND	NS	NS	NS	NS	NS	NS	NS
Perfluorononanesulfonic Acid (PFNS)	ND	ND	ND	ND	NS	NS	NS	NS	NS	NS	NS
N-Methyl Perfluorooctanesulfonamidoacetic Acid (NMeFOSAA)	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Perfluoroundecanoic Acid (PFUnA)	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Perfluorodecanesulfonic Acid (PFDS)	ND	ND	ND	ND	NS	NS	NS	NS	NS	NS	NS
Perfluorooctanesulfonamide (FOSA)	ND	ND	ND	ND	NS	NS	NS	NS	NS	NS	NS
N-Ethyl Perfluorooctanesulfonamidoacetic Acid (NEtFOSAA)	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Perfluorododecanoic Acid (PFDoA)	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Perfluorotridecanoic Acid (PFTrDA)	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Perfluorotetradecanoic Acid (PFTA)	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
<b>PFAS, Total (6)</b>	<b>12.8</b>	ND	<b>29.8</b>	<b>57.65</b>	<b>25.29</b>	<b>39.63</b>	<b>20.73</b>	<b>30.1</b>	<b>121.54</b>	<b>76.37</b>	<b>27</b>

The compounds detected at SW-1 were Perfluorobutanoic Acid- PFBA (1.93 ng/l), Perfluoropentanoic Acid- PFPeA (5.18 ng/l), Perfluorobutanesulfonic Acid- PFBS (2.32 ng/l), Perfluorohexanoic Acid-PFHxA (5.2 ng/l), Perfluoroheptanoic Acid-PFHxA (3.07 ng/l), Perfluorohexanesulfonic Acid-PFHxS (1.84 ng/l), Perfluoroctanoic Acid-PFOA (8.39 ng/l), Perfluoroctanesulfonic Acid- PFOS (8.24 ng/l). The Total PFAS6 concentration is 21.54 ng/l, which is above the MCL.

The compounds detected at SW-2 were Perfluorobutanoic Acid- PFBA (1.91 ng/l), Perfluoropentanoic Acid- PFPeA (4.98 ng/l), Perfluorobutanesulfonic Acid- PFBS (2.37 ng/l), Perfluorohexanoic Acid-PFHxA (5 ng/l), Perfluoroheptanoic Acid-PFHxA (3.15 ng/l), Perfluorohexanesulfonic Acid-PFHxS (2.31 ng/l), Perfluoroctanoic Acid-PFOA (8.31 ng/l), Perfluoroctanesulfonic Acid- PFOS (11.6 ng/l). The Total PFAS6 concentration is 25.37 ng/l, which is above the MCL

The compounds detected at SW-2 were Perfluorobutanoic Acid- PFBA (1.91 ng/l), Perfluoropentanoic Acid- PFPeA (4.98 ng/l), Perfluorobutanesulfonic Acid- PFBS (2.37 ng/l), Perfluorohexanoic Acid-PFHxA (5 ng/l), Perfluoroheptanoic Acid-PFHxA (3.15 ng/l), Perfluorohexanesulfonic Acid-PFHxS (2.31 ng/l), Perfluoroctanoic Acid-PFOA (8.31 ng/l), Perfluoroctanesulfonic Acid- PFOS (11.6 ng/l). The Total PFAS6 concentration is 25.37 ng/l, which is above the MCL

The compounds detected at SW-3 were Perfluorobutanoic Acid- PFBA (2.04 ng/l), Perfluoropentanoic Acid- PFPeA (5.48 ng/l), Perfluorobutanesulfonic Acid- PFBS (3.17 ng/l), Perfluorohexanoic Acid-PFHxA (5.58 ng/l), Perfluoroheptanoic Acid-PFHxA (2.86 ng/l), Perfluorohexanesulfonic Acid-PFHxS (3.16 ng/l), Perfluoroctanoic Acid-PFOA (8.06 ng/l), Perfluoroctanesulfonic Acid- PFOS (11.5 ng/l). The Total PFAS6 concentration is 25.58 ng/l, which is above the MCL

The compounds detected at SW-4 were Perfluorobutanoic Acid- PFBA (2.08 ng/l), Perfluoropentanoic Acid- PFPeA (5.32 ng/l), Perfluorobutanesulfonic Acid- PFBS (3.21 ng/l), Perfluorohexanoic Acid-PFHxA (5.59 ng/l), Perfluoroheptanoic Acid-PFHxA (2.76 ng/l), Perfluorohexanesulfonic Acid-PFHxS (3.4 ng/l), Perfluoroctanoic Acid-PFOA (7.18 ng/l), Perfluoroctanesulfonic Acid- PFOS (20.7 ng/l). The Total PFAS6 concentration is 34.04 ng/l, which is above the MCL

The compounds detected at SW-5 were Perfluorobutanoic Acid- PFBA (3.77 ng/l), Perfluoropentanoic Acid- PFPeA (5.45 ng/l), Perfluorobutanesulfonic Acid- PFBS (2.43 ng/l), Perfluorohexanoic Acid-PFHxA (4.49 ng/l), Perfluoroheptanoic Acid-PFHxA (2.8 ng/l), Perfluorohexanesulfonic Acid-PFHxS (1.95 ng/l), Perfluoroctanoic Acid-PFOA (6.67 ng/l), Perfluoroctanesulfonic Acid- PFOS (9.63 ng/l). The Total PFAS6 concentration is 21.05 ng/l, which is above the MCL

The PFAS compounds detected in the surface water samples collected on August 6, 2021 are summarized in Table 2 below as well as on Figure 2 attached.

Table 2: Wayland High School Perfluorinated Alkyl Acids Surface Water Results

	8/6/2021				
	SW-1	SW-2	SW-3	SW-4	SW-5
<b>Perfluoroheptanoic Acid (PFHpA)</b>	3.07	3.15	2.86	2.76	2.8
<b>Perfluorohexanesulfonic Acid (PFHxS)</b>	1.84	2.31	3.16	3.4	1.95
<b>Perfluorooctanoic Acid (PFOA)</b>	8.39	8.31	8.06	7.18	6.67
<b>Perfluorononanoic Acid (PFNA)</b>	ND	ND	ND	ND	ND
<b>Perfluorooctanesulfonic Acid (PFOS)</b>	8.24	11.6	11.5	20.7	9.63
<b>Perfluorodecanoic Acid (PFDA)</b>	ND	ND	ND	ND	ND
Perfluorobutanoic Acid (PFBA)	1.93	1.91	2.04	2.08	3.77
Perfluoropentanoic Acid (PFPeA)	5.18	4.98	5.48	5.32	5.45
Perfluorobutanesulfonic Acid (PFBS)	2.32	2.37	3.17	3.21	2.43
1H,1H,2H,2H-Perfluorohexanesulfonic Acid (4:2FTS)	ND	ND	ND	ND	ND
Perfluorohexanoic Acid (PFHxA)	5.2	5	5.58	5.59	4.49
Perfluoropentanesulfonic Acid (PFPeS)	ND	ND	ND	ND	ND
1H,1H,2H,2H-Perfluorooctanesulfonic Acid (6:2FTS)	ND	ND	ND	ND	ND
Perfluoroheptanesulfonic Acid (PFHpS)	ND	ND	ND	ND	ND
1H,1H,2H,2H-Perfluorodecanesulfonic Acid (8:2FTS)	ND	ND	ND	ND	ND
Perfluorononanesulfonic Acid (PFNS)	ND	ND	ND	ND	ND
N-Methyl Perfluorooctanesulfonamidoacetic Acid (NMeFOSAA)	ND	ND	ND	ND	ND
Perfluoroundecanoic Acid (PFUnA)	ND	ND	ND	ND	ND
Perfluorodecanesulfonic Acid (PFDS)	ND	ND	ND	ND	ND
Perfluorooctanesulfonamide (FOSA)	ND	ND	ND	ND	ND
N-Ethyl Perfluorooctanesulfonamidoacetic Acid (NEtFOSAA)	ND	ND	ND	ND	ND
Perfluorododecanoic Acid (PFDoA)	ND	ND	ND	ND	ND
Perfluorotridecanoic Acid (PFTrDA)	ND	ND	ND	ND	ND
Perfluorotetradecanoic Acid (PFTA)	ND	ND	ND	ND	ND
<b>PFAS, Total (6)</b>	<b>21.54</b>	<b>25.37</b>	<b>25.58</b>	<b>34.04</b>	<b>21.05</b>

### Summary and Recommendations

Figure 1 provides a visual representation of all the groundwater sampling locations atop an aerial photograph and previously constructed groundwater elevation contours that were developed by AECOM in 2010. The groundwater contours are presented to help the reader understand the general direction of groundwater flow under pumping conditions. It should be noted that groundwater elevations from the individual monitoring wells across the site may be different today with 1) the addition of a third pumping well within the wellfield, 2) the abandonment of the septic system, and 3) differing precipitation/recharge effects in 2021 compared with 2010. As a result, the groundwater elevation contours that would be drawn today may look

somewhat different. The generalized figure does however provide a worthwhile backdrop for the following observations:


- All surface water and groundwater sample results for the August 6, 2021 sampling event are above the current Massachusetts Department of Environmental Protection (MassDEP) drinking water standard Maximum Contaminant Level (MCL) for the sum of six per- and polyfluoroalkyl substances (PFAS).
- All surface water sample results for the August 6, 2021 sampling event are within the same subbasin and have concentrations between 21 – 34 ng/L (Figure 2).
- The MW-6 groundwater sample results show a relatively stable concentration range between 25 to 30 ng/L, indicating that concentrations are 1) not rising or falling and 2) within the same range as the surface water samples.
- Both MW-1 and SH-4 groundwater samples show an increasing trend over the four sample events from 2019 – present. Concentrations in both MW-1 and SH-4 are significantly greater than all of the surface water samples as well as the groundwater sample from MW-6.


In summary,

- The background concentration within the subbasin appears to be consistently between 20-30 ng/L. This may be a result of residential septic systems in the subbasin.
- Two wells (MW-1 and SH-4) located hydraulically downgradient of the high school's former septic system appear to 1) exhibit higher than background concentrations for PFAS, and 2) are increasing in concentration. This observation indicates that the former septic system may be a point source. The upward trend in concentration may be a result of anomalously high precipitation in summer 2021, thereby raising the groundwater elevations across the area and perhaps 'flushing' PFAS-laden biomatter remaining in the soil absorption system of the former wastewater discharge location.

Further work is recommended to verify these observations, including:

- Complete a potential contamination source inventory in the subbasin.
- Collect a round of groundwater levels in all available groundwater monitoring wells to update the groundwater elevation contours across the site. This could also be completed by using pressure transducer/data loggers to evaluate how changes in pumping rate at the Happy Hollow wellfield impact both groundwater elevations as well as the groundwater flow directions.
- Collect another round of groundwater samples from the three wells (MW-1, MW-6, and SH-4) previously sampled as other viable groundwater monitoring wells still in good condition across the property. Submit samples for analysis of PFAS.
- Install additional groundwater monitoring wells to better understand the three-dimensional flow characteristics of the aquifer under pumping and non-pumping conditions. These additional monitoring wells could also be used to sample additional locations for PFAS.

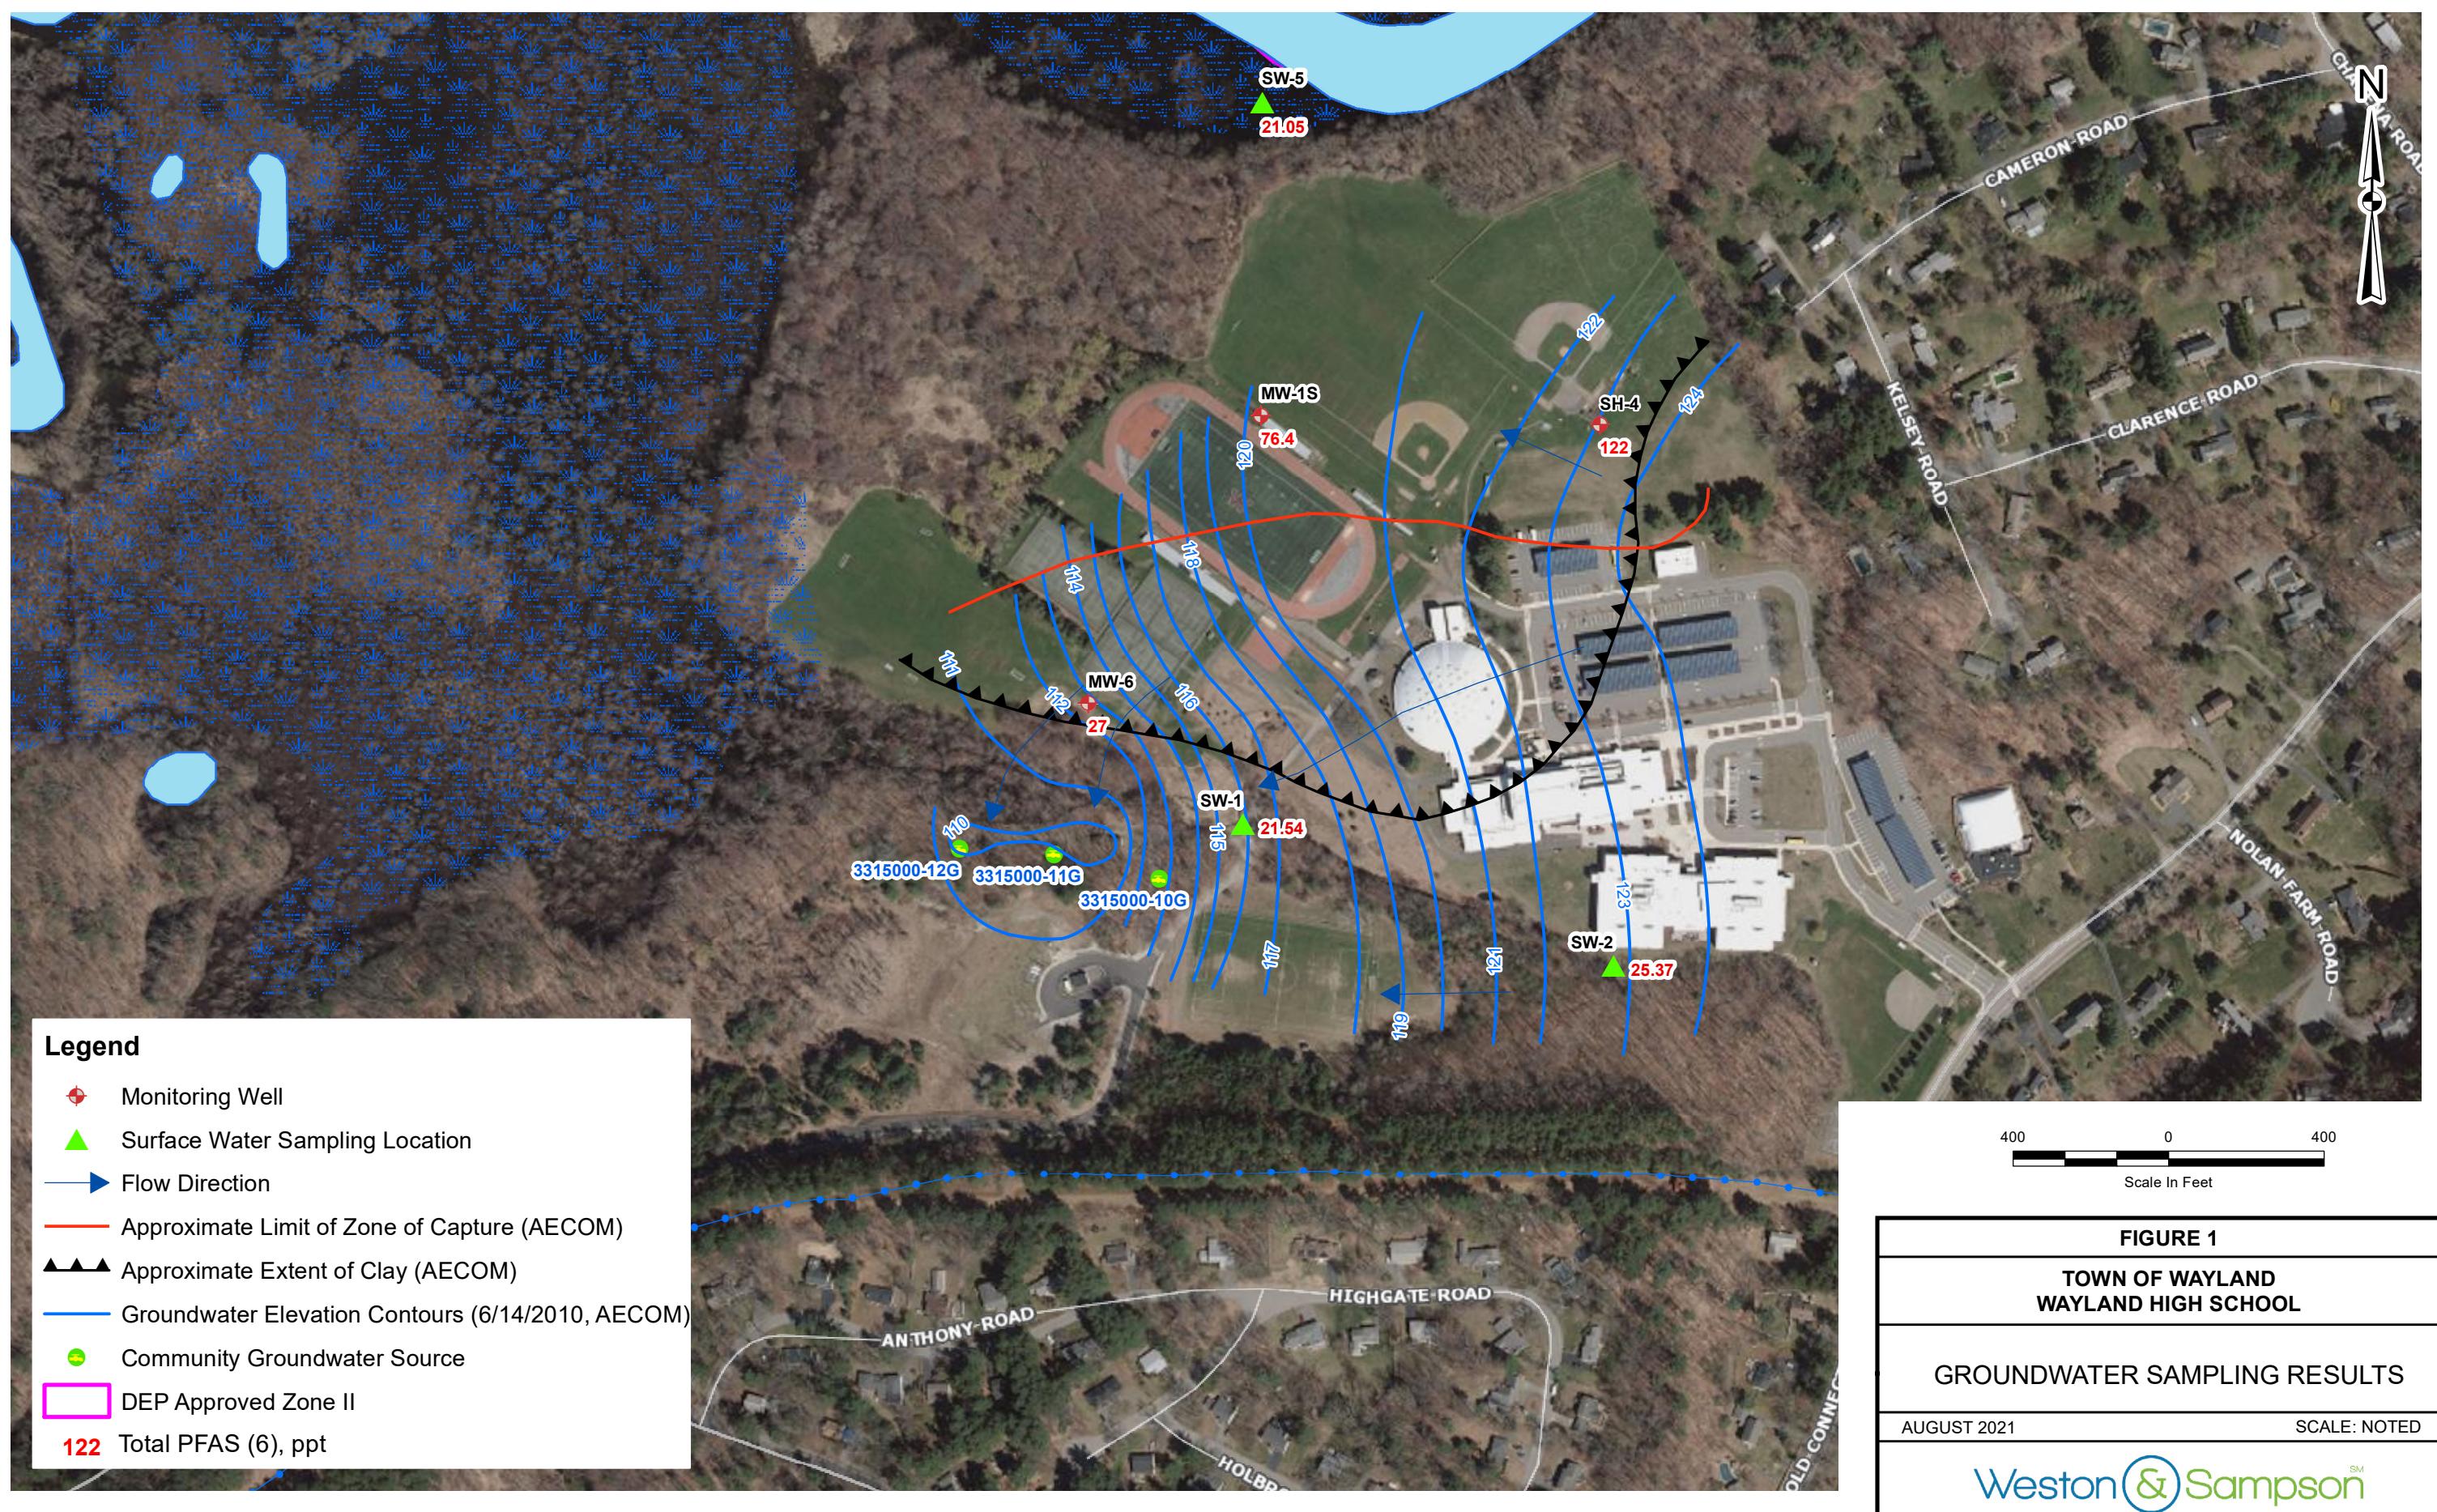

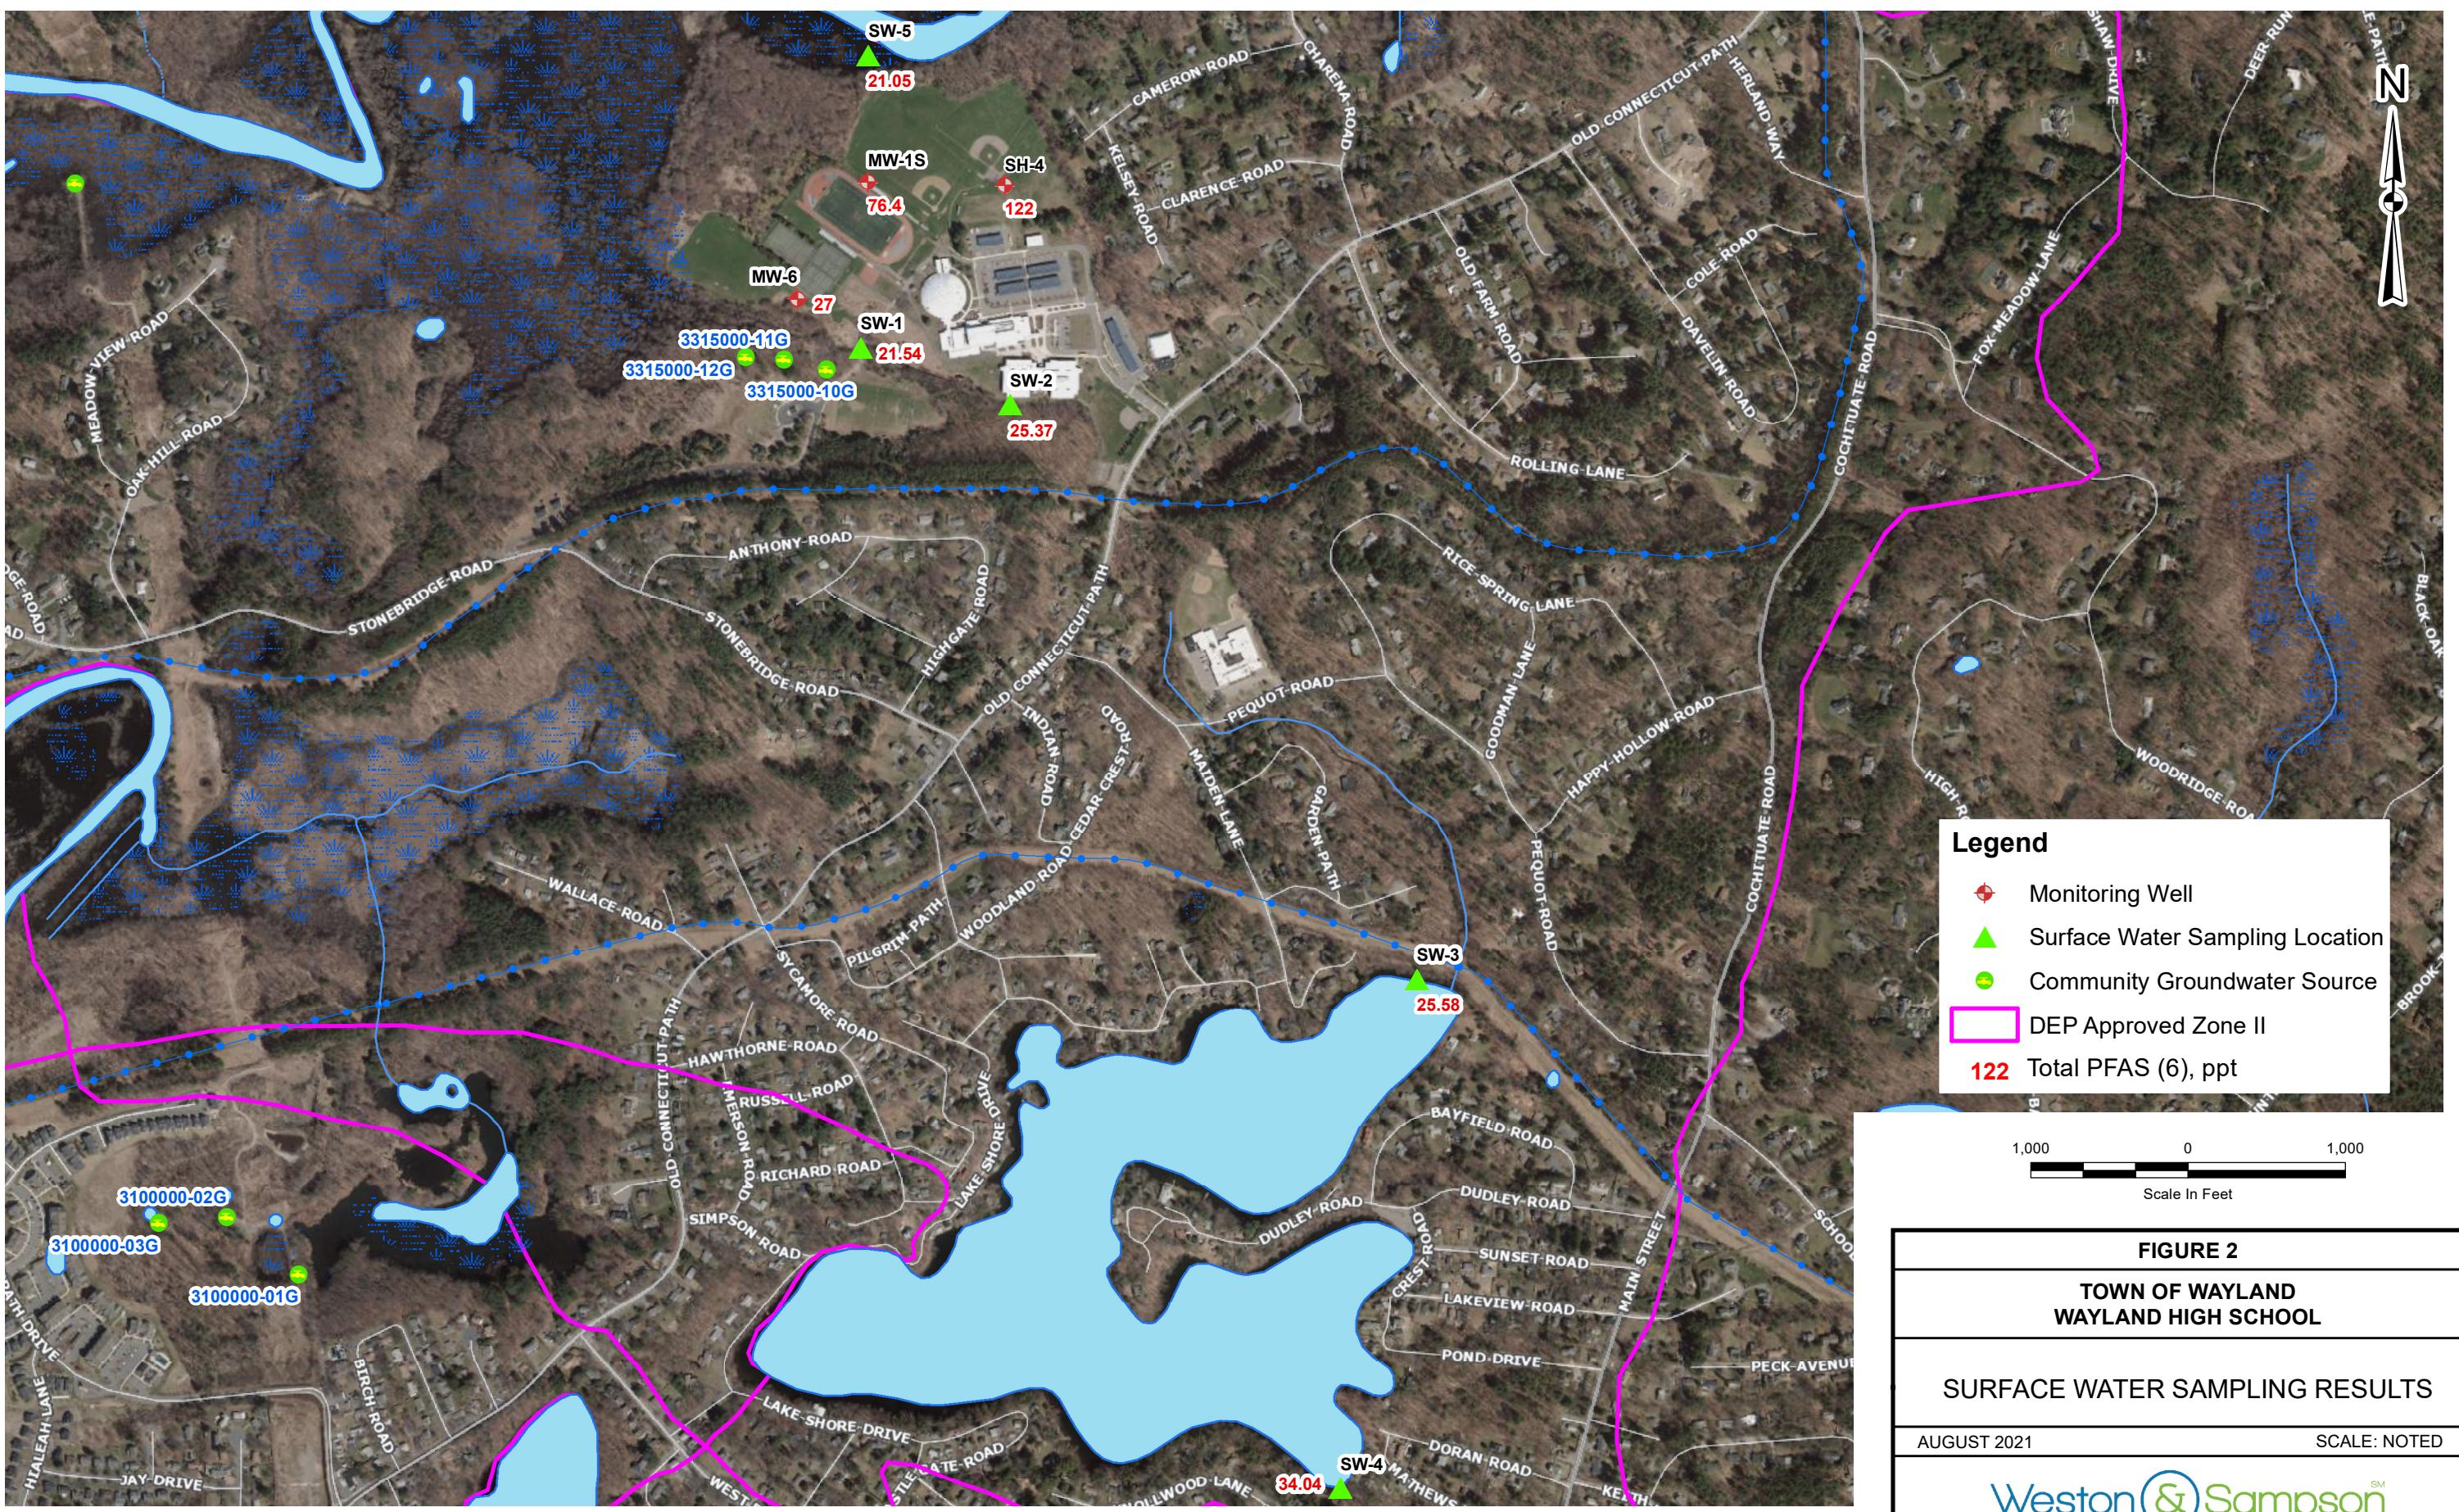



## ANALYTICAL REPORT

Lab Number:	L2142404
Client:	Weston & Sampson 55 Walkers Brook Drive Suite 100 Reading, MA 01867
ATTN:	Kevin MacKinnon
Phone:	(978) 532-1900
Project Name:	WAYLAND HS
Project Number:	ENG20-0296
Report Date:	08/17/21

The original project report/data package is held by Alpha Analytical. This report/data package is paginated and should be reproduced only in its entirety. Alpha Analytical holds no responsibility for results and/or data that are not consistent with the original.

Certifications & Approvals: MA (M-MA086), NH NELAP (2064), CT (PH-0574), IL (200077), ME (MA00086), MD (348), NJ (MA935), NY (11148), NC (25700/666), PA (68-03671), RI (LAO00065), TX (T104704476), VT (VT-0935), VA (460195), USDA (Permit #P330-17-00196).

---

Eight Walkup Drive, Westborough, MA 01581-1019  
508-898-9220 (Fax) 508-898-9193 800-624-9220 - [www.alphalab.com](http://www.alphalab.com)



**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

Alpha Sample ID	Client ID	Matrix	Sample Location	Collection Date/Time	Receive Date
L2142404-01	MW-6	DW	WAYLAND, MA	08/06/21 08:55	08/06/21
L2142404-02	SW-1	WATER	WAYLAND, MA	08/06/21 09:15	08/06/21
L2142404-03	MW-1	DW	WAYLAND, MA	08/06/21 09:45	08/06/21
L2142404-04	SW-5	WATER	WAYLAND, MA	08/06/21 10:10	08/06/21
L2142404-05	SH-4	DW	WAYLAND, MA	08/06/21 11:10	08/06/21
L2142404-06	SW-2	WATER	WAYLAND, MA	08/06/21 12:00	08/06/21
L2142404-07	SW-3	WATER	WAYLAND, MA	08/06/21 12:15	08/06/21
L2142404-08	SW-4	WATER	WAYLAND, MA	08/06/21 12:30	08/06/21
L2142404-09	FB-01	DW	WAYLAND, MA	08/06/21 12:55	08/06/21

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

### Case Narrative

The samples were received in accordance with the Chain of Custody and no significant deviations were encountered during the preparation or analysis unless otherwise noted. Sample Receipt, Container Information, and the Chain of Custody are located at the back of the report.

Results contained within this report relate only to the samples submitted under this Alpha Lab Number and meet NELAP requirements for all NELAP accredited parameters unless otherwise noted in the following narrative. The data presented in this report is organized by parameter (i.e. VOC, SVOC, etc.). Sample specific Quality Control data (i.e. Surrogate Spike Recovery) is reported at the end of the target analyte list for each individual sample, followed by the Laboratory Batch Quality Control at the end of each parameter. Tentatively Identified Compounds (TICs), if requested, are reported for compounds identified to be present and are not part of the method/program Target Compound List, even if only a subset of the TCL are being reported. If a sample was re-analyzed or re-extracted due to a required quality control corrective action and if both sets of data are reported, the Laboratory ID of the re-analysis or re-extraction is designated with an "R" or "RE", respectively.

When multiple Batch Quality Control elements are reported (e.g. more than one LCS), the associated samples for each element are noted in the grey shaded header line of each data table. Any Laboratory Batch, Sample Specific % recovery or RPD value that is outside the listed Acceptance Criteria is bolded in the report. In reference to questions H (CAM) or 4 (RCP) when "NO" is checked, the performance criteria for CAM and RCP methods allow for some quality control failures to occur and still be within method compliance. In these instances, the specific failure is not narrated but noted in the associated QC Outlier Summary Report, located directly after the Case Narrative. QC information is also incorporated in the Data Usability Assessment table (Format 11) of our Data Merger tool, where it can be reviewed in conjunction with the sample result, associated regulatory criteria and any associated data usability implications.

Soil/sediments, solids and tissues are reported on a dry weight basis unless otherwise noted. Definitions of all data qualifiers and acronyms used in this report are provided in the Glossary located at the back of the report.

**HOLD POLICY** - For samples submitted on hold, Alpha's policy is to hold samples (with the exception of Air canisters) free of charge for 21 calendar days from the date the project is completed. After 21 calendar days, we will dispose of all samples submitted including those put on hold unless you have contacted your Alpha Project Manager and made arrangements for Alpha to continue to hold the samples. Air canisters will be disposed after 3 business days from the date the project is completed.

Please contact Project Management at 800-624-9220 with any questions.

---

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

### Case Narrative (continued)

#### Perfluorinated Alkyl Acids by Isotope Dilution

L2142404-04, -07, and -08: Extracted Internal Standard recoveries were outside the acceptance criteria for individual analytes. Please refer to the surrogate section of the report for details.

L2142404-04, -07, and -08: The sample was centrifuged and decanted prior to extraction due to sample matrix.

The WG1533682-4 Laboratory Duplicate RPD for perfluorooctanesulfonic acid (pfos) (51%), performed on L2142404-06, is outside the acceptance criteria. The elevated RPD has been attributed to the non-homogeneous nature of the native sample.

#### Perfluorinated Alkyl Acids

The surrogate recovery for the WG1535052-2 LCS, associated with L2142404-01, -03, -05, and -09, is above the acceptance criteria for n-deuteroethylperfluoro-1-octanesulfonamidoacetic acid (d5-netfosaa) (136%). The associated LCS spike compounds are within overall acceptance criteria, therefore, no further action was taken.

The WG1535052-2 LCS recoveries, associated with L2142404-01, -03, -05, and -09, are above the acceptance criteria for 4,8-dioxa-3h-perfluorononanoic acid (adona) (134%), n-ethyl perfluorooctanesulfonamidoacetic acid (netfosaa) (137%), perfluorododecanoic acid (pfdoa) (136%) and perfluorotridecanoic acid (pftrda) (133%); however, the associated samples are non-detect to the RL for these target analytes. The results of the original analysis are reported.

I, the undersigned, attest under the pains and penalties of perjury that, to the best of my knowledge and belief and based upon my personal inquiry of those responsible for providing the information contained in this analytical report, such information is accurate and complete. This certificate of analysis is not complete unless this page accompanies any and all pages of this report.

Authorized Signature:

*Susan E O'Neil* Susan O' Neil

Title: Technical Director/Representative

Date: 08/17/21

# ORGANICS



# **SEMIVOLATILES**



**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

**SAMPLE RESULTS**

Lab ID: L2142404-01  
Client ID: MW-6  
Sample Location: WAYLAND, MA

Date Collected: 08/06/21 08:55  
Date Received: 08/06/21  
Field Prep: Not Specified

Sample Depth:

Matrix: Dw  
Analytical Method: 133,537.1  
Analytical Date: 08/14/21 19:36  
Analyst: SL

Extraction Method: EPA 537.1  
Extraction Date: 08/14/21 05:00

Parameter	Result	Qualifier	Units	RL	MDL	Dilution Factor
<b>Perfluorinated Alkyl Acids by EPA 537.1 - Mansfield Lab</b>						
Perfluorobutanesulfonic Acid (PFBS)	2.54		ng/l	1.76	--	1
Perfluorohexanoic Acid (PFHxA)	7.23		ng/l	1.76	--	1
Hexafluoropropylene Oxide Dimer Acid (HFPO-DA)	ND		ng/l	1.76	--	1
Perfluoroheptanoic Acid (PFHpA)	3.28		ng/l	1.76	--	1
Perfluorohexanesulfonic Acid (PFHxS)	2.12		ng/l	1.76	--	1
4,8-Dioxa-3h-Perfluorononanoic Acid (ADONA)	ND		ng/l	1.76	--	1
Perfluoroctanoic Acid (PFOA)	11.9		ng/l	1.76	--	1
Perfluorononanoic Acid (PFNA)	ND		ng/l	1.76	--	1
Perfluorooctanesulfonic Acid (PFOS)	9.73		ng/l	1.76	--	1
Perfluorodecanoic Acid (PFDA)	ND		ng/l	1.76	--	1
9-Chlorohexadecafluoro-3-Oxanone-1-Sulfonic Acid (9Cl-PF3ONS)	ND		ng/l	1.76	--	1
N-Methyl Perfluorooctanesulfonamidoacetic Acid (NMeFOSAA)	ND		ng/l	1.76	--	1
Perfluoroundecanoic Acid (PFUnA)	ND		ng/l	1.76	--	1
N-Ethyl Perfluorooctanesulfonamidoacetic Acid (NEtFOSAA)	ND		ng/l	1.76	--	1
Perfluorododecanoic Acid (PFDoA)	ND		ng/l	1.76	--	1
11-Chloroeicosfluoro-3-Oxaundecane-1-Sulfonic Acid (11Cl-PF3OUDS)	ND		ng/l	1.76	--	1
Perfluorotridecanoic Acid (PFTrDA)	ND		ng/l	1.76	--	1
Perfluorotetradecanoic Acid (PFTA)	ND		ng/l	1.76	--	1
PFAS, Total (6)	27.0		ng/l	1.76	--	1

Surrogate	% Recovery	Qualifier	Acceptance Criteria
Perfluoro-n-[1,2-13C2]hexanoic Acid (13C-PFHxA)	97		70-130
Tetrafluoro-2-heptafluoropropoxy-[13C3]-propanoic acid (13C3-HFPO-DA)	86		70-130
Perfluoro-n-[1,2-13C2]decanoic Acid (13C-PFDA)	112		70-130
N-Deuterioethylperfluoro-1-octanesulfonamidoacetic Acid (d5-NEtFOSAA)	119		70-130

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

**SAMPLE RESULTS**

Lab ID: L2142404-02  
Client ID: SW-1  
Sample Location: WAYLAND, MA

Date Collected: 08/06/21 09:15  
Date Received: 08/06/21  
Field Prep: Not Specified

Sample Depth:

Matrix: Water  
Analytical Method: 134,LCMSMS-ID  
Analytical Date: 08/11/21 20:24  
Analyst: SG

Extraction Method: ALPHA 23528  
Extraction Date: 08/11/21 05:20

Parameter	Result	Qualifier	Units	RL	MDL	Dilution Factor
<b>Perfluorinated Alkyl Acids by Isotope Dilution - Mansfield Lab</b>						
Perfluorobutanoic Acid (PFBA)	1.93	ng/l	1.76	--	--	1
Perfluoropentanoic Acid (PFPeA)	5.18	ng/l	1.76	--	--	1
Perfluorobutanesulfonic Acid (PFBS)	2.32	ng/l	1.76	--	--	1
1H,1H,2H,2H-Perfluorohexanesulfonic Acid (4:2FTS)	ND	ng/l	1.76	--	--	1
Perfluorohexanoic Acid (PFHxA)	5.20	ng/l	1.76	--	--	1
Perfluoropentanesulfonic Acid (PFPeS)	ND	ng/l	1.76	--	--	1
Perfluoroheptanoic Acid (PFHpA)	3.07	ng/l	1.76	--	--	1
Perfluorohexanesulfonic Acid (PFHxS)	1.84	ng/l	1.76	--	--	1
Perfluoroctanoic Acid (PFOA)	8.39	ng/l	1.76	--	--	1
1H,1H,2H,2H-Perfluorooctanesulfonic Acid (6:2FTS)	ND	ng/l	1.76	--	--	1
Perfluoroheptanesulfonic Acid (PFHpS)	ND	ng/l	1.76	--	--	1
Perfluorononanoic Acid (PFNA)	ND	ng/l	1.76	--	--	1
Perfluorooctanesulfonic Acid (PFOS)	8.24	ng/l	1.76	--	--	1
Perfluorodecanoic Acid (PFDA)	ND	ng/l	1.76	--	--	1
1H,1H,2H,2H-Perfluorodecanesulfonic Acid (8:2FTS)	ND	ng/l	1.76	--	--	1
Perfluorononanesulfonic Acid (PFNS)	ND	ng/l	1.76	--	--	1
N-Methyl Perfluorooctanesulfonamidoacetic Acid (NMeFOSAA)	ND	ng/l	1.76	--	--	1
Perfluoroundecanoic Acid (PFUnA)	ND	ng/l	1.76	--	--	1
Perfluorodecanesulfonic Acid (PFDS)	ND	ng/l	1.76	--	--	1
Perfluorooctanesulfonamide (FOSA)	ND	ng/l	1.76	--	--	1
N-Ethyl Perfluorooctanesulfonamidoacetic Acid (NEtFOSAA)	ND	ng/l	1.76	--	--	1
Perfluorododecanoic Acid (PFDoA)	ND	ng/l	1.76	--	--	1
Perfluorotridecanoic Acid (PFTrDA)	ND	ng/l	1.76	--	--	1
Perfluorotetradecanoic Acid (PFTA)	ND	ng/l	1.76	--	--	1

Project Name: WAYLAND HS

Lab Number: L2142404

Project Number: ENG20-0296

Report Date: 08/17/21

**SAMPLE RESULTS**

Lab ID: L2142404-02  
 Client ID: SW-1  
 Sample Location: WAYLAND, MA

Date Collected: 08/06/21 09:15  
 Date Received: 08/06/21  
 Field Prep: Not Specified

Sample Depth:

Parameter	Result	Qualifier	Units	RL	MDL	Dilution Factor
Perfluorinated Alkyl Acids by Isotope Dilution - Mansfield Lab						
Surrogate (Extracted Internal Standard)			% Recovery	Qualifier	Acceptance Criteria	
Perfluoro[13C4]Butanoic Acid (MPFBA)			83		58-132	
Perfluoro[13C5]Pentanoic Acid (M5PFPEA)			94		62-163	
Perfluoro[2,3,4-13C3]Butanesulfonic Acid (M3PFBS)			109		70-131	
1H,1H,2H,2H-Perfluoro[1,2-13C2]Hexanesulfonic Acid (M2-4:2FTS)			132		12-142	
Perfluoro[1,2,3,4,6-13C5]Hexanoic Acid (M5PFHxA)			85		57-129	
Perfluoro[1,2,3,4-13C4]Heptanoic Acid (M4PFHpA)			74		60-129	
Perfluoro[1,2,3-13C3]Hexanesulfonic Acid (M3PFHxS)			106		71-134	
Perfluoro[13C8]Octanoic Acid (M8PFOA)			78		62-129	
1H,1H,2H,2H-Perfluoro[1,2-13C2]Octanesulfonic Acid (M2-6:2FTS)			121		14-147	
Perfluoro[13C9]Nonanoic Acid (M9PFNA)			94		59-139	
Perfluoro[13C8]Octanesulfonic Acid (M8PFOS)			108		69-131	
Perfluoro[1,2,3,4,5,6-13C6]Decanoic Acid (M6PFDA)			84		62-124	
1H,1H,2H,2H-Perfluoro[1,2-13C2]Decanesulfonic Acid (M2-8:2FTS)			109		10-162	
N-Deuteriomethylperfluoro-1-octanesulfonamidoacetic Acid (d3-NMeFOSAA)			58		24-116	
Perfluoro[1,2,3,4,5,6,7-13C7]Undecanoic Acid (M7-PFUDA)			90		55-137	
Perfluoro[13C8]Octanesulfonamide (M8FOSA)			27		10-112	
N-Deuteroethylperfluoro-1-octanesulfonamidoacetic Acid (d5-NEtFOSAA)			56		27-126	
Perfluoro[1,2-13C2]Dodecanoic Acid (MPFDCA)			84		48-131	
Perfluoro[1,2-13C2]Tetradecanoic Acid (M2PFTEDA)			104		22-136	

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

**SAMPLE RESULTS**

Lab ID: L2142404-03  
Client ID: MW-1  
Sample Location: WAYLAND, MA

Date Collected: 08/06/21 09:45  
Date Received: 08/06/21  
Field Prep: Not Specified

Sample Depth:

Matrix: Dw  
Analytical Method: 133,537.1  
Analytical Date: 08/14/21 19:44  
Analyst: SL

Extraction Method: EPA 537.1  
Extraction Date: 08/14/21 05:00

Parameter	Result	Qualifier	Units	RL	MDL	Dilution Factor
<b>Perfluorinated Alkyl Acids by EPA 537.1 - Mansfield Lab</b>						
Perfluorobutanesulfonic Acid (PFBS)	9.26		ng/l	1.74	--	1
Perfluorohexanoic Acid (PFHxA)	25.9		ng/l	1.74	--	1
Hexafluoropropylene Oxide Dimer Acid (HFPO-DA)	ND		ng/l	1.74	--	1
Perfluoroheptanoic Acid (PFHpA)	14.0		ng/l	1.74	--	1
Perfluorohexanesulfonic Acid (PFHxS)	4.80		ng/l	1.74	--	1
4,8-Dioxa-3h-Perfluorononanoic Acid (ADONA)	ND		ng/l	1.74	--	1
Perfluoroctanoic Acid (PFOA)	49.6		ng/l	1.74	--	1
Perfluorononanoic Acid (PFNA)	ND		ng/l	1.74	--	1
Perfluorooctanesulfonic Acid (PFOS)	7.97		ng/l	1.74	--	1
Perfluorodecanoic Acid (PFDA)	ND		ng/l	1.74	--	1
9-Chlorohexadecafluoro-3-Oxanone-1-Sulfonic Acid (9Cl-PF3ONS)	ND		ng/l	1.74	--	1
N-Methyl Perfluorooctanesulfonamidoacetic Acid (NMeFOSAA)	ND		ng/l	1.74	--	1
Perfluoroundecanoic Acid (PFUnA)	ND		ng/l	1.74	--	1
N-Ethyl Perfluorooctanesulfonamidoacetic Acid (NEtFOSAA)	ND		ng/l	1.74	--	1
Perfluorododecanoic Acid (PFDoA)	ND		ng/l	1.74	--	1
11-Chloroeicosfluoro-3-Oxaundecane-1-Sulfonic Acid (11Cl-PF3OUDS)	ND		ng/l	1.74	--	1
Perfluorotridecanoic Acid (PFTrDA)	ND		ng/l	1.74	--	1
Perfluorotetradecanoic Acid (PFTA)	ND		ng/l	1.74	--	1
PFAS, Total (6)	76.4		ng/l	1.74	--	1

Surrogate	% Recovery	Qualifier	Acceptance Criteria
Perfluoro-n-[1,2-13C2]hexanoic Acid (13C-PFHxA)	92		70-130
Tetrafluoro-2-heptafluoropropoxy-[13C3]-propanoic acid (13C3-HFPO-DA)	79		70-130
Perfluoro-n-[1,2-13C2]decanoic Acid (13C-PFDA)	125		70-130
N-Deuterioethylperfluoro-1-octanesulfonamidoacetic Acid (d5-NEtFOSAA)	113		70-130

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

**SAMPLE RESULTS**

Lab ID: L2142404-04  
Client ID: SW-5  
Sample Location: WAYLAND, MA

Date Collected: 08/06/21 10:10  
Date Received: 08/06/21  
Field Prep: Not Specified

Sample Depth:

Matrix: Water  
Analytical Method: 134,LCMSMS-ID  
Analytical Date: 08/11/21 20:58  
Analyst: SG

Extraction Method: ALPHA 23528  
Extraction Date: 08/11/21 05:20

Parameter	Result	Qualifier	Units	RL	MDL	Dilution Factor
<b>Perfluorinated Alkyl Acids by Isotope Dilution - Mansfield Lab</b>						
Perfluorobutanoic Acid (PFBA)	3.77	ng/l	1.78	--	--	1
Perfluoropentanoic Acid (PFPeA)	5.45	ng/l	1.78	--	--	1
Perfluorobutanesulfonic Acid (PFBS)	2.43	ng/l	1.78	--	--	1
1H,1H,2H,2H-Perfluorohexanesulfonic Acid (4:2FTS)	ND	ng/l	1.78	--	--	1
Perfluorohexanoic Acid (PFHxA)	4.49	ng/l	1.78	--	--	1
Perfluoropentanesulfonic Acid (PFPeS)	ND	ng/l	1.78	--	--	1
Perfluoroheptanoic Acid (PFHpA)	2.80	ng/l	1.78	--	--	1
Perfluorohexanesulfonic Acid (PFHxS)	1.95	ng/l	1.78	--	--	1
Perfluoroctanoic Acid (PFOA)	6.67	ng/l	1.78	--	--	1
1H,1H,2H,2H-Perfluorooctanesulfonic Acid (6:2FTS)	ND	ng/l	1.78	--	--	1
Perfluoroheptanesulfonic Acid (PFHpS)	ND	ng/l	1.78	--	--	1
Perfluorononanoic Acid (PFNA)	ND	ng/l	1.78	--	--	1
Perfluorooctanesulfonic Acid (PFOS)	9.63	ng/l	1.78	--	--	1
Perfluorodecanoic Acid (PFDA)	ND	ng/l	1.78	--	--	1
1H,1H,2H,2H-Perfluorodecanesulfonic Acid (8:2FTS)	ND	ng/l	1.78	--	--	1
Perfluorononanesulfonic Acid (PFNS)	ND	ng/l	1.78	--	--	1
N-Methyl Perfluorooctanesulfonamidoacetic Acid (NMeFOSAA)	ND	ng/l	1.78	--	--	1
Perfluoroundecanoic Acid (PFUnA)	ND	ng/l	1.78	--	--	1
Perfluorodecanesulfonic Acid (PFDS)	ND	ng/l	1.78	--	--	1
Perfluorooctanesulfonamide (FOSA)	ND	ng/l	1.78	--	--	1
N-Ethyl Perfluorooctanesulfonamidoacetic Acid (NEtFOSAA)	ND	ng/l	1.78	--	--	1
Perfluorododecanoic Acid (PFDoA)	ND	ng/l	1.78	--	--	1
Perfluorotridecanoic Acid (PFTrDA)	ND	ng/l	1.78	--	--	1
Perfluorotetradecanoic Acid (PFTA)	ND	ng/l	1.78	--	--	1

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

**SAMPLE RESULTS**

Lab ID: L2142404-04  
Client ID: SW-5  
Sample Location: WAYLAND, MA

Date Collected: 08/06/21 10:10  
Date Received: 08/06/21  
Field Prep: Not Specified

Sample Depth:

Parameter	Result	Qualifier	Units	RL	MDL	Dilution Factor
Perfluorinated Alkyl Acids by Isotope Dilution - Mansfield Lab						
Surrogate (Extracted Internal Standard)			% Recovery	Qualifier	Acceptance Criteria	
Perfluoro[13C4]Butanoic Acid (MPFBA)			106		58-132	
Perfluoro[13C5]Pentanoic Acid (M5PFPEA)			118		62-163	
Perfluoro[2,3,4-13C3]Butanesulfonic Acid (M3PFBS)			106		70-131	
1H,1H,2H,2H-Perfluoro[1,2-13C2]Hexanesulfonic Acid (M2-4:2FTS)	183	Q			12-142	
Perfluoro[1,2,3,4,6-13C5]Hexanoic Acid (M5PFHxA)			107		57-129	
Perfluoro[1,2,3,4-13C4]Heptanoic Acid (M4PFHpA)			102		60-129	
Perfluoro[1,2,3-13C3]Hexanesulfonic Acid (M3PFHxS)			110		71-134	
Perfluoro[13C8]Octanoic Acid (M8PFOA)			98		62-129	
1H,1H,2H,2H-Perfluoro[1,2-13C2]Octanesulfonic Acid (M2-6:2FTS)	138				14-147	
Perfluoro[13C9]Nonanoic Acid (M9PFNA)			113		59-139	
Perfluoro[13C8]Octanesulfonic Acid (M8PFOS)			106		69-131	
Perfluoro[1,2,3,4,5,6-13C6]Decanoic Acid (M6PFDA)			94		62-124	
1H,1H,2H,2H-Perfluoro[1,2-13C2]Decanesulfonic Acid (M2-8:2FTS)	124				10-162	
N-Deuteriomethylperfluoro-1-octanesulfonamidoacetic Acid (d3-NMeFOSAA)	70				24-116	
Perfluoro[1,2,3,4,5,6,7-13C7]Undecanoic Acid (M7-PFUDA)	93				55-137	
Perfluoro[13C8]Octanesulfonamide (M8FOSA)			18		10-112	
N-Deuteroethylperfluoro-1-octanesulfonamidoacetic Acid (d5-NEtFOSAA)	67				27-126	
Perfluoro[1,2-13C2]Dodecanoic Acid (MPFDODA)	89				48-131	
Perfluoro[1,2-13C2]Tetradecanoic Acid (M2PFTEDA)	98				22-136	

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

**SAMPLE RESULTS**

Lab ID: L2142404-05  
Client ID: SH-4  
Sample Location: WAYLAND, MA

Date Collected: 08/06/21 11:10  
Date Received: 08/06/21  
Field Prep: Not Specified

Sample Depth:

Matrix: Dw  
Analytical Method: 133,537.1  
Analytical Date: 08/14/21 20:10  
Analyst: SL

Extraction Method: EPA 537.1  
Extraction Date: 08/14/21 05:00

Parameter	Result	Qualifier	Units	RL	MDL	Dilution Factor
<b>Perfluorinated Alkyl Acids by EPA 537.1 - Mansfield Lab</b>						
Perfluorobutanesulfonic Acid (PFBS)	2.65		ng/l	1.74	--	1
Perfluorohexanoic Acid (PFHxA)	82.5		ng/l	1.74	--	1
Hexafluoropropylene Oxide Dimer Acid (HFPO-DA)	ND		ng/l	1.74	--	1
Perfluoroheptanoic Acid (PFHpA)	27.6		ng/l	1.74	--	1
Perfluorohexanesulfonic Acid (PFHxS)	5.79		ng/l	1.74	--	1
4,8-Dioxa-3h-Perfluorononanoic Acid (ADONA)	ND		ng/l	1.74	--	1
Perfluoroctanoic Acid (PFOA)	84.0		ng/l	1.74	--	1
Perfluorononanoic Acid (PFNA)	1.85		ng/l	1.74	--	1
Perfluoroctanesulfonic Acid (PFOS)	2.30		ng/l	1.74	--	1
Perfluorodecanoic Acid (PFDA)	ND		ng/l	1.74	--	1
9-Chlorohexadecafluoro-3-Oxanone-1-Sulfonic Acid (9Cl-PF3ONS)	ND		ng/l	1.74	--	1
N-Methyl Perfluoroctanesulfonamidoacetic Acid (NMeFOSAA)	ND		ng/l	1.74	--	1
Perfluoroundecanoic Acid (PFUnA)	ND		ng/l	1.74	--	1
N-Ethyl Perfluoroctanesulfonamidoacetic Acid (NEtFOSAA)	ND		ng/l	1.74	--	1
Perfluorododecanoic Acid (PFDoA)	ND		ng/l	1.74	--	1
11-Chloroeicosfluoro-3-Oxaundecane-1-Sulfonic Acid (11Cl-PF3OUDS)	ND		ng/l	1.74	--	1
Perfluorotridecanoic Acid (PFTrDA)	ND		ng/l	1.74	--	1
Perfluorotetradecanoic Acid (PFTA)	ND		ng/l	1.74	--	1
PFAS, Total (6)	122		ng/l	1.74	--	1

Surrogate	% Recovery	Qualifier	Acceptance Criteria
Perfluoro-n-[1,2-13C2]hexanoic Acid (13C-PFHxA)	110		70-130
Tetrafluoro-2-heptafluoropropoxy-[13C3]-propanoic acid (13C3-HFPO-DA)	97		70-130
Perfluoro-n-[1,2-13C2]decanoic Acid (13C-PFDA)	130		70-130
N-Deuterioethylperfluoro-1-octanesulfonamidoacetic Acid (d5-NEtFOSAA)	125		70-130

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

**SAMPLE RESULTS**

Lab ID: L2142404-06  
Client ID: SW-2  
Sample Location: WAYLAND, MA

Date Collected: 08/06/21 12:00  
Date Received: 08/06/21  
Field Prep: Not Specified

Sample Depth:

Matrix: Water  
Analytical Method: 134,LCMSMS-ID  
Analytical Date: 08/11/21 21:14  
Analyst: SG

Extraction Method: ALPHA 23528  
Extraction Date: 08/11/21 05:20

Parameter	Result	Qualifier	Units	RL	MDL	Dilution Factor
<b>Perfluorinated Alkyl Acids by Isotope Dilution - Mansfield Lab</b>						
Perfluorobutanoic Acid (PFBA)	1.91	ng/l	1.80	--	--	1
Perfluoropentanoic Acid (PFPeA)	4.98	ng/l	1.80	--	--	1
Perfluorobutanesulfonic Acid (PFBS)	2.37	ng/l	1.80	--	--	1
1H,1H,2H,2H-Perfluorohexanesulfonic Acid (4:2FTS)	ND	ng/l	1.80	--	--	1
Perfluorohexanoic Acid (PFHxA)	5.00	ng/l	1.80	--	--	1
Perfluoropentanesulfonic Acid (PFPeS)	ND	ng/l	1.80	--	--	1
Perfluoroheptanoic Acid (PFHpA)	3.15	ng/l	1.80	--	--	1
Perfluorohexanesulfonic Acid (PFHxS)	2.31	ng/l	1.80	--	--	1
Perfluoroctanoic Acid (PFOA)	8.31	ng/l	1.80	--	--	1
1H,1H,2H,2H-Perfluorooctanesulfonic Acid (6:2FTS)	ND	ng/l	1.80	--	--	1
Perfluoroheptanesulfonic Acid (PFHpS)	ND	ng/l	1.80	--	--	1
Perfluorononanoic Acid (PFNA)	ND	ng/l	1.80	--	--	1
Perfluorooctanesulfonic Acid (PFOS)	11.6	ng/l	1.80	--	--	1
Perfluorodecanoic Acid (PFDA)	ND	ng/l	1.80	--	--	1
1H,1H,2H,2H-Perfluorodecanesulfonic Acid (8:2FTS)	ND	ng/l	1.80	--	--	1
Perfluorononanesulfonic Acid (PFNS)	ND	ng/l	1.80	--	--	1
N-Methyl Perfluorooctanesulfonamidoacetic Acid (NMeFOSAA)	ND	ng/l	1.80	--	--	1
Perfluoroundecanoic Acid (PFUnA)	ND	ng/l	1.80	--	--	1
Perfluorodecanesulfonic Acid (PFDS)	ND	ng/l	1.80	--	--	1
Perfluorooctanesulfonamide (FOSA)	ND	ng/l	1.80	--	--	1
N-Ethyl Perfluorooctanesulfonamidoacetic Acid (NEtFOSAA)	ND	ng/l	1.80	--	--	1
Perfluorododecanoic Acid (PFDoA)	ND	ng/l	1.80	--	--	1
Perfluorotridecanoic Acid (PFTrDA)	ND	ng/l	1.80	--	--	1
Perfluorotetradecanoic Acid (PFTA)	ND	ng/l	1.80	--	--	1

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

**SAMPLE RESULTS**

Lab ID: L2142404-06  
Client ID: SW-2  
Sample Location: WAYLAND, MA

Date Collected: 08/06/21 12:00  
Date Received: 08/06/21  
Field Prep: Not Specified

Sample Depth:

Parameter	Result	Qualifier	Units	RL	MDL	Dilution Factor
Perfluorinated Alkyl Acids by Isotope Dilution - Mansfield Lab						
Surrogate (Extracted Internal Standard)			% Recovery	Qualifier	Acceptance Criteria	
Perfluoro[13C4]Butanoic Acid (MPFBA)			79		58-132	
Perfluoro[13C5]Pentanoic Acid (M5PFPEA)			91		62-163	
Perfluoro[2,3,4-13C3]Butanesulfonic Acid (M3PFBS)			113		70-131	
1H,1H,2H,2H-Perfluoro[1,2-13C2]Hexanesulfonic Acid (M2-4:2FTS)			132		12-142	
Perfluoro[1,2,3,4,6-13C5]Hexanoic Acid (M5PFHxA)			83		57-129	
Perfluoro[1,2,3,4-13C4]Heptanoic Acid (M4PFHpA)			74		60-129	
Perfluoro[1,2,3-13C3]Hexanesulfonic Acid (M3PFHxS)			110		71-134	
Perfluoro[13C8]Octanoic Acid (M8PFOA)			77		62-129	
1H,1H,2H,2H-Perfluoro[1,2-13C2]Octanesulfonic Acid (M2-6:2FTS)			116		14-147	
Perfluoro[13C9]Nonanoic Acid (M9PFNA)			91		59-139	
Perfluoro[13C8]Octanesulfonic Acid (M8PFOS)			101		69-131	
Perfluoro[1,2,3,4,5,6-13C6]Decanoic Acid (M6PFDA)			79		62-124	
1H,1H,2H,2H-Perfluoro[1,2-13C2]Decanesulfonic Acid (M2-8:2FTS)			112		10-162	
N-Deuteriomethylperfluoro-1-octanesulfonamidoacetic Acid (d3-NMeFOSAA)			55		24-116	
Perfluoro[1,2,3,4,5,6,7-13C7]Undecanoic Acid (M7-PFUDA)			80		55-137	
Perfluoro[13C8]Octanesulfonamide (M8FOSA)			22		10-112	
N-Deuteroethylperfluoro-1-octanesulfonamidoacetic Acid (d5-NEtFOSAA)			48		27-126	
Perfluoro[1,2-13C2]Dodecanoic Acid (MPFDODA)			78		48-131	
Perfluoro[1,2-13C2]Tetradecanoic Acid (M2PFTEDA)			87		22-136	

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

**SAMPLE RESULTS**

Lab ID: L2142404-07  
Client ID: SW-3  
Sample Location: WAYLAND, MA

Date Collected: 08/06/21 12:15  
Date Received: 08/06/21  
Field Prep: Not Specified

Sample Depth:

Matrix: Water  
Analytical Method: 134,LCMSMS-ID  
Analytical Date: 08/11/21 21:47  
Analyst: SG

Extraction Method: ALPHA 23528  
Extraction Date: 08/11/21 05:20

Parameter	Result	Qualifier	Units	RL	MDL	Dilution Factor
<b>Perfluorinated Alkyl Acids by Isotope Dilution - Mansfield Lab</b>						
Perfluorobutanoic Acid (PFBA)	2.04	ng/l	1.78	--	--	1
Perfluoropentanoic Acid (PFPeA)	5.48	ng/l	1.78	--	--	1
Perfluorobutanesulfonic Acid (PFBS)	3.17	ng/l	1.78	--	--	1
1H,1H,2H,2H-Perfluorohexanesulfonic Acid (4:2FTS)	ND	ng/l	1.78	--	--	1
Perfluorohexanoic Acid (PFHxA)	5.58	ng/l	1.78	--	--	1
Perfluoropentanesulfonic Acid (PFPeS)	ND	ng/l	1.78	--	--	1
Perfluoroheptanoic Acid (PFHpA)	2.86	ng/l	1.78	--	--	1
Perfluorohexanesulfonic Acid (PFHxS)	3.16	ng/l	1.78	--	--	1
Perfluoroctanoic Acid (PFOA)	8.06	ng/l	1.78	--	--	1
1H,1H,2H,2H-Perfluorooctanesulfonic Acid (6:2FTS)	ND	ng/l	1.78	--	--	1
Perfluoroheptanesulfonic Acid (PFHpS)	ND	ng/l	1.78	--	--	1
Perfluorononanoic Acid (PFNA)	ND	ng/l	1.78	--	--	1
Perfluorooctanesulfonic Acid (PFOS)	11.5	ng/l	1.78	--	--	1
Perfluorodecanoic Acid (PFDA)	ND	ng/l	1.78	--	--	1
1H,1H,2H,2H-Perfluorodecanesulfonic Acid (8:2FTS)	ND	ng/l	1.78	--	--	1
Perfluorononanesulfonic Acid (PFNS)	ND	ng/l	1.78	--	--	1
N-Methyl Perfluorooctanesulfonamidoacetic Acid (NMeFOSAA)	ND	ng/l	1.78	--	--	1
Perfluoroundecanoic Acid (PFUnA)	ND	ng/l	1.78	--	--	1
Perfluorodecanesulfonic Acid (PFDS)	ND	ng/l	1.78	--	--	1
Perfluorooctanesulfonamide (FOSA)	ND	ng/l	1.78	--	--	1
N-Ethyl Perfluorooctanesulfonamidoacetic Acid (NEtFOSAA)	ND	ng/l	1.78	--	--	1
Perfluorododecanoic Acid (PFDoA)	ND	ng/l	1.78	--	--	1
Perfluorotridecanoic Acid (PFTrDA)	ND	ng/l	1.78	--	--	1
Perfluorotetradecanoic Acid (PFTA)	ND	ng/l	1.78	--	--	1

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

**SAMPLE RESULTS**

Lab ID: L2142404-07  
Client ID: SW-3  
Sample Location: WAYLAND, MA

Date Collected: 08/06/21 12:15  
Date Received: 08/06/21  
Field Prep: Not Specified

Sample Depth:

Parameter	Result	Qualifier	Units	RL	MDL	Dilution Factor
Perfluorinated Alkyl Acids by Isotope Dilution - Mansfield Lab						
Surrogate (Extracted Internal Standard)			% Recovery	Qualifier	Acceptance Criteria	
Perfluoro[13C4]Butanoic Acid (MPFBA)			97		58-132	
Perfluoro[13C5]Pentanoic Acid (M5PFPEA)			111		62-163	
Perfluoro[2,3,4-13C3]Butanesulfonic Acid (M3PFBS)			114		70-131	
1H,1H,2H,2H-Perfluoro[1,2-13C2]Hexanesulfonic Acid (M2-4:2FTS)	159	Q			12-142	
Perfluoro[1,2,3,4,6-13C5]Hexanoic Acid (M5PFHxA)			102		57-129	
Perfluoro[1,2,3,4-13C4]Heptanoic Acid (M4PFHpA)			89		60-129	
Perfluoro[1,2,3-13C3]Hexanesulfonic Acid (M3PFHxS)			112		71-134	
Perfluoro[13C8]Octanoic Acid (M8PFOA)			94		62-129	
1H,1H,2H,2H-Perfluoro[1,2-13C2]Octanesulfonic Acid (M2-6:2FTS)			135		14-147	
Perfluoro[13C9]Nonanoic Acid (M9PFNA)			108		59-139	
Perfluoro[13C8]Octanesulfonic Acid (M8PFOS)			111		69-131	
Perfluoro[1,2,3,4,5,6-13C6]Decanoic Acid (M6PFDA)			98		62-124	
1H,1H,2H,2H-Perfluoro[1,2-13C2]Decanesulfonic Acid (M2-8:2FTS)			131		10-162	
N-Deuteriomethylperfluoro-1-octanesulfonamidoacetic Acid (d3-NMeFOSAA)			68		24-116	
Perfluoro[1,2,3,4,5,6,7-13C7]Undecanoic Acid (M7-PFUDA)			96		55-137	
Perfluoro[13C8]Octanesulfonamide (M8FOSA)			23		10-112	
N-Deuteroethylperfluoro-1-octanesulfonamidoacetic Acid (d5-NEtFOSAA)			69		27-126	
Perfluoro[1,2-13C2]Dodecanoic Acid (MPFDCA)			93		48-131	
Perfluoro[1,2-13C2]Tetradecanoic Acid (M2PFTEDA)			100		22-136	

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

**SAMPLE RESULTS**

Lab ID: L2142404-08  
Client ID: SW-4  
Sample Location: WAYLAND, MA

Date Collected: 08/06/21 12:30  
Date Received: 08/06/21  
Field Prep: Not Specified

Sample Depth:

Matrix: Water  
Analytical Method: 134,LCMSMS-ID  
Analytical Date: 08/11/21 22:04  
Analyst: SG

Extraction Method: ALPHA 23528  
Extraction Date: 08/11/21 05:20

Parameter	Result	Qualifier	Units	RL	MDL	Dilution Factor
<b>Perfluorinated Alkyl Acids by Isotope Dilution - Mansfield Lab</b>						
Perfluorobutanoic Acid (PFBA)	2.08	ng/l	1.79	--	--	1
Perfluoropentanoic Acid (PFPeA)	5.32	ng/l	1.79	--	--	1
Perfluorobutanesulfonic Acid (PFBS)	3.21	ng/l	1.79	--	--	1
1H,1H,2H,2H-Perfluorohexanesulfonic Acid (4:2FTS)	ND	ng/l	1.79	--	--	1
Perfluorohexanoic Acid (PFHxA)	5.59	ng/l	1.79	--	--	1
Perfluoropentanesulfonic Acid (PFPeS)	ND	ng/l	1.79	--	--	1
Perfluoroheptanoic Acid (PFHpA)	2.76	ng/l	1.79	--	--	1
Perfluorohexanesulfonic Acid (PFHxS)	3.40	ng/l	1.79	--	--	1
Perfluoroctanoic Acid (PFOA)	7.18	ng/l	1.79	--	--	1
1H,1H,2H,2H-Perfluorooctanesulfonic Acid (6:2FTS)	ND	ng/l	1.79	--	--	1
Perfluoroheptanesulfonic Acid (PFHpS)	ND	ng/l	1.79	--	--	1
Perfluorononanoic Acid (PFNA)	ND	ng/l	1.79	--	--	1
Perfluorooctanesulfonic Acid (PFOS)	20.7	ng/l	1.79	--	--	1
Perfluorodecanoic Acid (PFDA)	ND	ng/l	1.79	--	--	1
1H,1H,2H,2H-Perfluorodecanesulfonic Acid (8:2FTS)	ND	ng/l	1.79	--	--	1
Perfluorononanesulfonic Acid (PFNS)	ND	ng/l	1.79	--	--	1
N-Methyl Perfluorooctanesulfonamidoacetic Acid (NMeFOSAA)	ND	ng/l	1.79	--	--	1
Perfluoroundecanoic Acid (PFUnA)	ND	ng/l	1.79	--	--	1
Perfluorodecanesulfonic Acid (PFDS)	ND	ng/l	1.79	--	--	1
Perfluorooctanesulfonamide (FOSA)	ND	ng/l	1.79	--	--	1
N-Ethyl Perfluorooctanesulfonamidoacetic Acid (NEtFOSAA)	ND	ng/l	1.79	--	--	1
Perfluorododecanoic Acid (PFDoA)	ND	ng/l	1.79	--	--	1
Perfluorotridecanoic Acid (PFTrDA)	ND	ng/l	1.79	--	--	1
Perfluorotetradecanoic Acid (PFTA)	ND	ng/l	1.79	--	--	1

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

**SAMPLE RESULTS**

Lab ID: L2142404-08  
Client ID: SW-4  
Sample Location: WAYLAND, MA

Date Collected: 08/06/21 12:30  
Date Received: 08/06/21  
Field Prep: Not Specified

Sample Depth:

Parameter	Result	Qualifier	Units	RL	MDL	Dilution Factor
Perfluorinated Alkyl Acids by Isotope Dilution - Mansfield Lab						
Surrogate (Extracted Internal Standard)			% Recovery	Qualifier	Acceptance Criteria	
Perfluoro[13C4]Butanoic Acid (MPFBA)			100		58-132	
Perfluoro[13C5]Pentanoic Acid (M5PFPEA)			114		62-163	
Perfluoro[2,3,4-13C3]Butanesulfonic Acid (M3PFBS)			112		70-131	
1H,1H,2H,2H-Perfluoro[1,2-13C2]Hexanesulfonic Acid (M2-4:2FTS)	155	Q			12-142	
Perfluoro[1,2,3,4,6-13C5]Hexanoic Acid (M5PFHxA)			105		57-129	
Perfluoro[1,2,3,4-13C4]Heptanoic Acid (M4PFHpA)			91		60-129	
Perfluoro[1,2,3-13C3]Hexanesulfonic Acid (M3PFHxS)			110		71-134	
Perfluoro[13C8]Octanoic Acid (M8PFOA)			94		62-129	
1H,1H,2H,2H-Perfluoro[1,2-13C2]Octanesulfonic Acid (M2-6:2FTS)			129		14-147	
Perfluoro[13C9]Nonanoic Acid (M9PFNA)			108		59-139	
Perfluoro[13C8]Octanesulfonic Acid (M8PFOS)			108		69-131	
Perfluoro[1,2,3,4,5,6-13C6]Decanoic Acid (M6PFDA)			95		62-124	
1H,1H,2H,2H-Perfluoro[1,2-13C2]Decanesulfonic Acid (M2-8:2FTS)			116		10-162	
N-Deuteriomethylperfluoro-1-octanesulfonamidoacetic Acid (d3-NMeFOSAA)			62		24-116	
Perfluoro[1,2,3,4,5,6,7-13C7]Undecanoic Acid (M7-PFUDA)			90		55-137	
Perfluoro[13C8]Octanesulfonamide (M8FOSA)			21		10-112	
N-Deuteroethylperfluoro-1-octanesulfonamidoacetic Acid (d5-NEtFOSAA)			66		27-126	
Perfluoro[1,2-13C2]Dodecanoic Acid (MPFDODA)			87		48-131	
Perfluoro[1,2-13C2]Tetradecanoic Acid (M2PFTEDA)			90		22-136	

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

**SAMPLE RESULTS**

Lab ID: L2142404-09  
Client ID: FB-01  
Sample Location: WAYLAND, MA

Date Collected: 08/06/21 12:55  
Date Received: 08/06/21  
Field Prep: Not Specified

Sample Depth:

Matrix: Dw  
Analytical Method: 133,537.1  
Analytical Date: 08/14/21 20:19  
Analyst: SL

Extraction Method: EPA 537.1  
Extraction Date: 08/14/21 05:00

Parameter	Result	Qualifier	Units	RL	MDL	Dilution Factor
<b>Perfluorinated Alkyl Acids by EPA 537.1 - Mansfield Lab</b>						
Perfluorobutanesulfonic Acid (PFBS)	ND		ng/l	1.77	--	1
Perfluorohexanoic Acid (PFHxA)	ND		ng/l	1.77	--	1
Hexafluoropropylene Oxide Dimer Acid (HFPO-DA)	ND		ng/l	1.77	--	1
Perfluoroheptanoic Acid (PFHpA)	ND		ng/l	1.77	--	1
Perfluorohexanesulfonic Acid (PFHxS)	ND		ng/l	1.77	--	1
4,8-Dioxa-3h-Perfluorononanoic Acid (ADONA)	ND		ng/l	1.77	--	1
Perfluoroctanoic Acid (PFOA)	ND		ng/l	1.77	--	1
Perfluorononanoic Acid (PFNA)	ND		ng/l	1.77	--	1
Perfluorooctanesulfonic Acid (PFOS)	ND		ng/l	1.77	--	1
Perfluorodecanoic Acid (PFDA)	ND		ng/l	1.77	--	1
9-Chlorohexadecafluoro-3-Oxanone-1-Sulfonic Acid (9Cl-PF3ONS)	ND		ng/l	1.77	--	1
N-Methyl Perfluorooctanesulfonamidoacetic Acid (NMeFOSAA)	ND		ng/l	1.77	--	1
Perfluoroundecanoic Acid (PFUnA)	ND		ng/l	1.77	--	1
N-Ethyl Perfluorooctanesulfonamidoacetic Acid (NEtFOSAA)	ND		ng/l	1.77	--	1
Perfluorododecanoic Acid (PFDoA)	ND		ng/l	1.77	--	1
11-Chloroeicosfluoro-3-Oxaundecane-1-Sulfonic Acid (11Cl-PF3OUDS)	ND		ng/l	1.77	--	1
Perfluorotridecanoic Acid (PFTrDA)	ND		ng/l	1.77	--	1
Perfluorotetradecanoic Acid (PFTA)	ND		ng/l	1.77	--	1
PFAS, Total (6)	ND		ng/l	1.77	--	1

Surrogate	% Recovery	Qualifier	Acceptance Criteria
Perfluoro-n-[1,2-13C2]hexanoic Acid (13C-PFHxA)	101		70-130
Tetrafluoro-2-heptafluoropropoxy-[13C3]-propanoic acid (13C3-HFPO-DA)	95		70-130
Perfluoro-n-[1,2-13C2]decanoic Acid (13C-PFDA)	116		70-130
N-Deuterioethylperfluoro-1-octanesulfonamidoacetic Acid (d5-NEtFOSAA)	110		70-130

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

### Method Blank Analysis Batch Quality Control

Analytical Method: 134,LCMSMS-ID  
Analytical Date: 08/11/21 19:51  
Analyst: SG

Extraction Method: ALPHA 23528  
Extraction Date: 08/11/21 05:20

Parameter	Result	Qualifier	Units	RL	MDL
Perfluorinated Alkyl Acids by Isotope Dilution - Mansfield Lab for sample(s): 02,04,06-08 Batch: WG1533682-1					
Perfluorobutanoic Acid (PFBA)	ND	ng/l	2.00	--	
Perfluoropentanoic Acid (PFPeA)	ND	ng/l	2.00	--	
Perfluorobutanesulfonic Acid (PFBS)	ND	ng/l	2.00	--	
1H,1H,2H,2H-Perfluorohexanesulfonic Acid (4:2FTS)	ND	ng/l	2.00	--	
Perfluorohexanoic Acid (PFHxA)	ND	ng/l	2.00	--	
Perfluoropentanesulfonic Acid (PFPeS)	ND	ng/l	2.00	--	
Perfluoroheptanoic Acid (PFHpA)	ND	ng/l	2.00	--	
Perfluorohexanesulfonic Acid (PFHxS)	ND	ng/l	2.00	--	
Perfluoroctanoic Acid (PFOA)	ND	ng/l	2.00	--	
1H,1H,2H,2H-Perfluorooctanesulfonic Acid (6:2FTS)	ND	ng/l	2.00	--	
Perfluoroheptanesulfonic Acid (PFHpS)	ND	ng/l	2.00	--	
Perfluorononanoic Acid (PFNA)	ND	ng/l	2.00	--	
Perfluorooctanesulfonic Acid (PFOS)	ND	ng/l	2.00	--	
Perfluorodecanoic Acid (PFDA)	ND	ng/l	2.00	--	
1H,1H,2H,2H-Perfluorodecanesulfonic Acid (8:2FTS)	ND	ng/l	2.00	--	
Perfluoronananesulfonic Acid (PFNS)	ND	ng/l	2.00	--	
N-Methyl Perfluorooctanesulfonamidoacetic Acid (NMeFOSAA)	ND	ng/l	2.00	--	
Perfluoroundecanoic Acid (PFUnA)	ND	ng/l	2.00	--	
Perfluorodecanesulfonic Acid (PFDS)	ND	ng/l	2.00	--	
Perfluorooctanesulfonamide (FOSA)	ND	ng/l	2.00	--	
N-Ethyl Perfluorooctanesulfonamidoacetic Acid (NEtFOSAA)	ND	ng/l	2.00	--	
Perfluorododecanoic Acid (PFDoA)	ND	ng/l	2.00	--	
Perfluorotridecanoic Acid (PFTrDA)	ND	ng/l	2.00	--	
Perfluorotetradecanoic Acid (PFTA)	ND	ng/l	2.00	--	



**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

### Method Blank Analysis Batch Quality Control

Analytical Method: 134,LCMSMS-ID  
Analytical Date: 08/11/21 19:51  
Analyst: SG

Extraction Method: ALPHA 23528  
Extraction Date: 08/11/21 05:20

Parameter	Result	Qualifier	Units	RL	MDL
Perfluorinated Alkyl Acids by Isotope Dilution - Mansfield Lab for sample(s): 02,04,06-08 Batch: WG1533682-1					

Surrogate (Extracted Internal Standard)	%Recovery	Qualifier	Acceptance Criteria
Perfluoro[13C4]Butanoic Acid (MPFBA)	109		58-132
Perfluoro[13C5]Pentanoic Acid (M5PFPEA)	121		62-163
Perfluoro[2,3,4-13C3]Butanesulfonic Acid (M3PFBS)	122		70-131
1H,1H,2H,2H-Perfluoro[1,2-13C2]Hexanesulfonic Acid (M2-4:2FTS)	114		12-142
Perfluoro[1,2,3,4,6-13C5]Hexanoic Acid (M5PFHxA)	109		57-129
Perfluoro[1,2,3,4-13C4]Heptanoic Acid (M4PFHpA)	99		60-129
Perfluoro[1,2,3-13C3]Hexanesulfonic Acid (M3PFHxS)	117		71-134
Perfluoro[13C8]Octanoic Acid (M8PFOA)	101		62-129
1H,1H,2H,2H-Perfluoro[1,2-13C2]Octanesulfonic Acid (M2-6:2FTS)	106		14-147
Perfluoro[13C9]Nonanoic Acid (M9PFNA)	122		59-139
Perfluoro[13C8]Octanesulfonic Acid (M8PFOS)	117		69-131
Perfluoro[1,2,3,4,5,6-13C6]Decanoic Acid (M6PFDA)	107		62-124
1H,1H,2H,2H-Perfluoro[1,2-13C2]Decanesulfonic Acid (M2-8:2FTS)	115		10-162
N-Deuteriomethylperfluoro-1-octanesulfonamidoacetic Acid (d3-NMeFOSAA)	102		24-116
Perfluoro[1,2,3,4,5,6,7-13C7]Undecanoic Acid (M7-PFUDA)	107		55-137
Perfluoro[13C8]Octanesulfonamide (M8FOSA)	68		10-112
N-Deuteroethylperfluoro-1-octanesulfonamidoacetic Acid (d5-NEtFOSAA)	88		27-126
Perfluoro[1,2-13C2]Dodecanoic Acid (MPFDOA)	105		48-131
Perfluoro[1,2-13C2]Tetradecanoic Acid (M2PFTEDA)	115		22-136

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

**Method Blank Analysis**  
**Batch Quality Control**

Analytical Method: 133,537.1  
Analytical Date: 08/14/21 18:09  
Analyst: SL

Extraction Method: EPA 537.1  
Extraction Date: 08/14/21 05:00

Parameter	Result	Qualifier	Units	RL	MDL
Perfluorinated Alkyl Acids by EPA 537.1 - Mansfield Lab for sample(s):	01,03,05,09			Batch:	WG1535052-1
Perfluorobutanesulfonic Acid (PFBS)	ND		ng/l	2.00	--
Perfluorohexanoic Acid (PFHxA)	ND		ng/l	2.00	--
Hexafluoropropylene Oxide Dimer Acid (HFPO-DA)	ND		ng/l	2.00	--
Perfluoroheptanoic Acid (PFHpA)	ND		ng/l	2.00	--
Perfluorohexanesulfonic Acid (PFHxS)	ND		ng/l	2.00	--
4,8-Dioxa-3h-Perfluorononanoic Acid (ADONA)	ND		ng/l	2.00	--
Perfluoroctanoic Acid (PFOA)	ND		ng/l	2.00	--
Perfluorononanoic Acid (PFNA)	ND		ng/l	2.00	--
Perfluorooctanesulfonic Acid (PFOS)	ND		ng/l	2.00	--
Perfluorodecanoic Acid (PFDA)	ND		ng/l	2.00	--
9-Chlorohexadecafluoro-3-Oxanone-1-Sulfonic Acid (9Cl-PF3ONS)	ND		ng/l	2.00	--
N-Methyl Perfluorooctanesulfonamidoacetic Acid (NMeFOSAA)	ND		ng/l	2.00	--
Perfluoroundecanoic Acid (PFUnA)	ND		ng/l	2.00	--
N-Ethyl Perfluorooctanesulfonamidoacetic Acid (NEtFOSAA)	ND		ng/l	2.00	--
Perfluorododecanoic Acid (PFDoA)	ND		ng/l	2.00	--
11-Chloroeicosfluoro-3-Oxaundecane-1-Sulfonic Acid (11Cl-PF3OUdS)	ND		ng/l	2.00	--
Perfluorotridecanoic Acid (PFTrDA)	ND		ng/l	2.00	--
Perfluorotetradecanoic Acid (PFTA)	ND		ng/l	2.00	--
PFAS, Total (6)	ND		ng/l	2.00	--

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

**Method Blank Analysis**  
**Batch Quality Control**

Analytical Method: 133,537.1  
Analytical Date: 08/14/21 18:09  
Analyst: SL

Extraction Method: EPA 537.1  
Extraction Date: 08/14/21 05:00

Parameter	Result	Qualifier	Units	RL	MDL
Perfluorinated Alkyl Acids by EPA 537.1 - Mansfield Lab for sample(s):	01,03,05,09		Batch:	WG1535052-1	

Surrogate	%Recovery	Qualifier	Acceptance Criteria
Perfluoro-n-[1,2-13C2]hexanoic Acid (13C-PFHxA)	108		70-130
Tetrafluoro-2-heptafluoropropoxy-[13C3]-propanoic acid (13C3-HFPO-DA)	102		70-130
Perfluoro-n-[1,2-13C2]decanoic Acid (13C-PFDA)	129		70-130
N-Deuteroethylperfluoro-1-octanesulfonamidoacetic Acid (d5-NEtFOSAA)	130		70-130

# Lab Control Sample Analysis

## Batch Quality Control

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

Parameter	LCS %Recovery	Qual	LCSD %Recovery	Qual	%Recovery Limits	RPD	Qual	RPD Limits
Perfluorinated Alkyl Acids by Isotope Dilution - Mansfield Lab Associated sample(s): 02,04,06-08 Batch: WG1533682-2								
Perfluorobutanoic Acid (PFBA)	103		-		67-148	-		30
Perfluoropentanoic Acid (PFPeA)	101		-		63-161	-		30
Perfluorobutanesulfonic Acid (PFBS)	102		-		65-157	-		30
1H,1H,2H,2H-Perfluorohexanesulfonic Acid (4:2FTS)	111		-		37-219	-		30
Perfluorohexanoic Acid (PFHxA)	106		-		69-168	-		30
Perfluoropentanesulfonic Acid (PFPeS)	111		-		52-156	-		30
Perfluoroheptanoic Acid (PFHpA)	104		-		58-159	-		30
Perfluorohexanesulfonic Acid (PFHxS)	98		-		69-177	-		30
Perfluorooctanoic Acid (PFOA)	102		-		63-159	-		30
1H,1H,2H,2H-Perfluorooctanesulfonic Acid (6:2FTS)	112		-		49-187	-		30
Perfluoroheptanesulfonic Acid (PFHpS)	98		-		61-179	-		30
Perfluorononanoic Acid (PFNA)	88		-		68-171	-		30
Perfluorooctanesulfonic Acid (PFOS)	112		-		52-151	-		30
Perfluorodecanoic Acid (PFDA)	102		-		63-171	-		30
1H,1H,2H,2H-Perfluorodecanesulfonic Acid (8:2FTS)	114		-		56-173	-		30
Perfluorononanesulfonic Acid (PFNS)	98		-		48-150	-		30
N-Methyl Perfluorooctanesulfonamidoacetic Acid (NMeFOSAA)	99		-		60-166	-		30
Perfluoroundecanoic Acid (PFUnA)	105		-		60-153	-		30
Perfluorodecanesulfonic Acid (PFDS)	106		-		38-156	-		30
Perfluorooctanesulfonamide (FOSA)	93		-		46-170	-		30
N-Ethyl Perfluorooctanesulfonamidoacetic Acid (NEtFOSAA)	103		-		45-170	-		30
Perfluorododecanoic Acid (PFDoA)	103		-		67-153	-		30

# Lab Control Sample Analysis

## Batch Quality Control

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

Parameter	LCS %Recovery	Qual	LCSD %Recovery	Qual	%Recovery Limits	RPD	Qual	RPD Limits
Perfluorinated Alkyl Acids by Isotope Dilution - Mansfield Lab Associated sample(s): 02,04,06-08 Batch: WG1533682-2								
Perfluorotridecanoic Acid (PFTrDA)	130	-	-	-	48-158	-	-	30
Perfluorotetradecanoic Acid (PFTA)	109	-	-	-	59-182	-	-	30

Surrogate (Extracted Internal Standard)	LCS %Recovery	Qual	LCSD %Recovery	Qual	Acceptance Criteria
Perfluoro[13C4]Butanoic Acid (MPFBA)	106	-	-	-	58-132
Perfluoro[13C5]Pentanoic Acid (M5PFPEA)	123	-	-	-	62-163
Perfluoro[2,3,4-13C3]Butanesulfonic Acid (M3PFBS)	119	-	-	-	70-131
1H,1H,2H,2H-Perfluoro[1,2-13C2]Hexanesulfonic Acid (M2-4:2FTS)	118	-	-	-	12-142
Perfluoro[1,2,3,4,6-13C5]Hexanoic Acid (M5PFHxA)	109	-	-	-	57-129
Perfluoro[1,2,3,4-13C4]Heptanoic Acid (M4PFHpa)	99	-	-	-	60-129
Perfluoro[1,2,3-13C3]Hexanesulfonic Acid (M3PFHxS)	115	-	-	-	71-134
Perfluoro[13C8]Octanoic Acid (M8PFOA)	104	-	-	-	62-129
1H,1H,2H,2H-Perfluoro[1,2-13C2]Octanesulfonic Acid (M2-6:2FTS)	113	-	-	-	14-147
Perfluoro[13C9]Nonanoic Acid (M9PFNA)	126	-	-	-	59-139
Perfluoro[13C8]Octanesulfonic Acid (M8PFOS)	115	-	-	-	69-131
Perfluoro[1,2,3,4,5,6-13C6]Decanoic Acid (M6PFDA)	105	-	-	-	62-124
1H,1H,2H,2H-Perfluoro[1,2-13C2]Decanesulfonic Acid (M2-8:2FTS)	120	-	-	-	10-162
N-Deuteriomethylperfluoro-1-octanesulfonamidoacetic Acid (d3-NMeFOSAA)	90	-	-	-	24-116
Perfluoro[1,2,3,4,5,6,7-13C7]Undecanoic Acid (M7-PFUDA)	102	-	-	-	55-137
Perfluoro[13C8]Octanesulfonamide (M8FOSA)	65	-	-	-	10-112
N-Deuterioethylperfluoro-1-octanesulfonamidoacetic Acid (d5-NEtFOSAA)	93	-	-	-	27-126
Perfluoro[1,2-13C2]Dodecanoic Acid (MPFDOA)	100	-	-	-	48-131
Perfluoro[1,2-13C2]Tetradecanoic Acid (M2PFTEDA)	107	-	-	-	22-136

# Lab Control Sample Analysis

## Batch Quality Control

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

Parameter	LCS %Recovery	Qual	LCSD %Recovery	Qual	%Recovery Limits	RPD	Qual	RPD Limits
Perfluorinated Alkyl Acids by EPA 537.1 - Mansfield Lab Associated sample(s): 01,03,05,09 Batch: WG1535052-2								
Perfluorobutanesulfonic Acid (PFBS)	109		-		70-130	-		30
Perfluorohexanoic Acid (PFHxA)	110		-		70-130	-		30
Hexafluoropropylene Oxide Dimer Acid (HFPO-DA)	102		-		70-130	-		30
Perfluoroheptanoic Acid (PFHpA)	126		-		70-130	-		30
Perfluorohexanesulfonic Acid (PFHxS)	111		-		70-130	-		30
4,8-Dioxa-3h-Perfluorononanoic Acid (ADONA)	134	Q	-		70-130	-		30
Perfluorooctanoic Acid (PFOA)	126		-		70-130	-		30
Perfluorononanoic Acid (PFNA)	124		-		70-130	-		30
Perfluorooctanesulfonic Acid (PFOS)	108		-		70-130	-		30
Perfluorodecanoic Acid (PFDA)	126		-		70-130	-		30
9-Chlorohexadecafluoro-3-Oxanone-1-Sulfonic Acid (9Cl-PF3ONS)	111		-		70-130	-		30
N-Methyl Perfluorooctanesulfonamidoacetic Acid (NMeFOSAA)	110		-		70-130	-		30
Perfluoroundecanoic Acid (PFUnA)	130		-		70-130	-		30
N-Ethyl Perfluorooctanesulfonamidoacetic Acid (NEtFOSAA)	137	Q	-		70-130	-		30
Perfluorododecanoic Acid (PFDoA)	136	Q	-		70-130	-		30
11-Chloroeicosfluoro-3-Oxaundecane-1-Sulfonic Acid (11Cl-PF3OUdS)	108		-		70-130	-		30
Perfluorotridecanoic Acid (PFTrDA)	133	Q	-		70-130	-		30
Perfluorotetradecanoic Acid (PFTA)	119		-		70-130	-		30

**Lab Control Sample Analysis**  
**Batch Quality Control**

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

Parameter	LCS %Recovery	Qual	LCSD %Recovery	Qual	%Recovery Limits	RPD	Qual	RPD Limits
Perfluorinated Alkyl Acids by EPA 537.1 - Mansfield Lab Associated sample(s): 01,03,05,09 Batch: WG1535052-2								
Surrogate	LCS %Recovery	Qual	LCSD %Recovery	Qual	Acceptance Criteria			
Perfluoro-n-[1,2-13C2]hexanoic Acid (13C-PFHxA)	108				70-130			
Tetrafluoro-2-heptafluoropropoxy-[13C3]-propanoic acid (13C3-HFPO-DA)	100				70-130			
Perfluoro-n-[1,2-13C2]decanoic Acid (13C-PFDA)	128				70-130			
N-Deuteroethylperfluoro-1-octanesulfonamidoacetic Acid (d5-NEtFOSAA)	136	Q			70-130			

# Matrix Spike Analysis

## Batch Quality Control

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

Parameter	Native Sample	MS Added	MS Found	MS %Recovery	Qual	MSD Found	MSD %Recovery	Qual	Recovery Limits	RPD	Qual	RPD
Perfluorinated Alkyl Acids by Isotope Dilution - Mansfield Lab Associated sample(s): 02,04,06-08 QC Batch ID: WG1533682-3 QC Sample: L2142404-02 Client ID: SW-1												
Perfluorobutanoic Acid (PFBA)	1.93	35.9	38.6	102		-	-	-	67-148	-	-	30
Perfluoropentanoic Acid (PFPeA)	5.18	35.9	42.2	103		-	-	-	63-161	-	-	30
Perfluorobutanesulfonic Acid (PFBS)	2.32	31.9	35.8	105		-	-	-	65-157	-	-	30
1H,1H,2H,2H-Perfluorohexanesulfonic Acid (4:2FTS)	ND	33.6	39.5	117		-	-	-	37-219	-	-	30
Perfluorohexanoic Acid (PFHxA)	5.20	35.9	43.4	106		-	-	-	69-168	-	-	30
Perfluoropentanesulfonic Acid (PFPeS)	ND	33.8	39.3	116		-	-	-	52-156	-	-	30
Perfluoroheptanoic Acid (PFHpA)	3.07	35.9	41.4	107		-	-	-	58-159	-	-	30
Perfluorohexanesulfonic Acid (PFHxS)	1.84	32.8	37.2	108		-	-	-	69-177	-	-	30
Perfluorooctanoic Acid (PFOA)	8.39	35.9	46.9	107		-	-	-	63-159	-	-	30
1H,1H,2H,2H-Perfluorooctanesulfonic Acid (6:2FTS)	ND	34.2	39.8	116		-	-	-	49-187	-	-	30
Perfluoroheptanesulfonic Acid (PFHps)	ND	34.2	37.0	108		-	-	-	61-179	-	-	30
Perfluorononanoic Acid (PFNA)	ND	35.9	33.8	92		-	-	-	68-171	-	-	30
Perfluorooctanesulfonic Acid (PFOS)	8.24	33.3	45.6	112		-	-	-	52-151	-	-	30
Perfluorodecanoic Acid (PFDA)	ND	35.9	36.8	102		-	-	-	63-171	-	-	30
1H,1H,2H,2H-Perfluorodecanesulfonic Acid (8:2FTS)	ND	34.5	38.0	110		-	-	-	56-173	-	-	30
Perfluorononanesulfonic Acid (PFNS)	ND	34.6	34.1	99		-	-	-	48-150	-	-	30
N-Methyl Perfluorooctanesulfonamidoacetic Acid (NMeFOSAA)	ND	35.9	38.2	106		-	-	-	60-166	-	-	30
Perfluoroundecanoic Acid (PFUnA)	ND	35.9	37.2	104		-	-	-	60-153	-	-	30
Perfluorodecanesulfonic Acid (PFDS)	ND	34.6	33.5	97		-	-	-	38-156	-	-	30
Perfluorooctanesulfonamide (FOSA)	ND	35.9	34.3	96		-	-	-	46-170	-	-	30
N-Ethyl Perfluorooctanesulfonamidoacetic Acid (NEtFOSAA)	ND	35.9	40.8	114		-	-	-	45-170	-	-	30
Perfluorododecanoic Acid (PFDoA)	ND	35.9	36.9	103		-	-	-	67-153	-	-	30

# Matrix Spike Analysis

## Batch Quality Control

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

Parameter	Native Sample	MS Added	MS Found	MS %Recovery	Qual	MSD Found	MSD %Recovery	Qual	Recovery Limits	RPD	Qual	RPD
Perfluorinated Alkyl Acids by Isotope Dilution - Mansfield Lab				Associated sample(s): 02,04,06-08		QC Batch ID: WG1533682-3		QC Sample: L2142404-02	Client ID: SW-1			
Perfluorotridecanoic Acid (PFTrDA)	ND	35.9	50.0	139		-	-	-	48-158	-	-	30
Perfluorotetradecanoic Acid (PFTA)	ND	35.9	38.7	108		-	-	-	59-182	-	-	30

Surrogate (Extracted Internal Standard)	MS	MSD		Acceptance Criteria
	% Recovery	Qualifier	% Recovery	Qualifier
1H,1H,2H,2H-Perfluoro[1,2-13C2]Decanesulfonic Acid (M2-8:2FTS)	118			10-162
1H,1H,2H,2H-Perfluoro[1,2-13C2]Hexanesulfonic Acid (M2-4:2FTS)	131			12-142
1H,1H,2H,2H-Perfluoro[1,2-13C2]Octanesulfonic Acid (M2-6:2FTS)	118			14-147
N-Deuteroethylperfluoro-1-octanesulfonamidoacetic Acid (d5-NEtFOSAA)	58			27-126
N-Deuteriomethylperfluoro-1-octanesulfonamidoacetic Acid (d3-NMeFOSAA)	60			24-116
Perfluoro[1,2,3,4,5,6,7-13C7]Undecanoic Acid (M7-PFUDA)	83			55-137
Perfluoro[1,2,3,4,5,6-13C6]Decanoic Acid (M6PFDA)	83			62-124
Perfluoro[1,2,3,4,6-13C5]Hexanoic Acid (M5PFHxA)	85			57-129
Perfluoro[1,2,3,4-13C4]Heptanoic Acid (M4PFHpA)	75			60-129
Perfluoro[1,2,3-13C3]Hexanesulfonic Acid (M3PFHxS)	105			71-134
Perfluoro[1,2-13C2]Dodecanoic Acid (MPFDOA)	81			48-131
Perfluoro[1,2-13C2]Tetradecanoic Acid (M2PFTEDA)	85			22-136
Perfluoro[13C4]Butanoic Acid (MPFBBA)	81			58-132
Perfluoro[13C5]Pentanoic Acid (M5PFPEA)	90			62-163
Perfluoro[13C8]Octanesulfonamide (M8FOSA)	29			10-112
Perfluoro[13C8]Octanesulfonic Acid (M8PFOS)	106			69-131
Perfluoro[13C8]Octanoic Acid (M8PFOA)	78			62-129
Perfluoro[13C9]Nonanoic Acid (M9PFNA)	95			59-139
Perfluoro[2,3,4-13C3]Butanesulfonic Acid (M3PFBS)	109			70-131

# Matrix Spike Analysis

## Batch Quality Control

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

Parameter	Native Sample	MS Added	MS Found	MS %Recovery	Qual	MSD Found	MSD %Recovery	Qual	Recovery Limits	RPD	Qual	RPD Limits
Perfluorinated Alkyl Acids by EPA 537.1 - Mansfield Lab Associated sample(s): 01,03,05,09 QC Batch ID: WG1535052-3 QC Sample: L2142220-01 Client ID: MS Sample												
Perfluorobutanesulfonic Acid (PFBS)	ND	33.6	37.4	111		-	-	-	70-130	-	-	30
Perfluorohexanoic Acid (PFHxA)	ND	37.9	41.3	109		-	-	-	70-130	-	-	30
2,3,3,3-Tetrafluoro-2-[1,1,2,2,3,3,3-Heptafluoropropoxy]-Propanoic Acid (HFPO-DA)	ND	37.9	35.4	93		-	-	-	70-130	-	-	30
Perfluoroheptanoic Acid (PFHpA)	ND	37.9	50.2	132	Q	-	-	-	70-130	-	-	30
Perfluorohexanesulfonic Acid (PFHxS)	ND	34.6	38.4	111		-	-	-	70-130	-	-	30
4,8-Dioxa-3h-Perflurononanoic Acid (ADONA)	ND	35.8	47.3	132	Q	-	-	-	70-130	-	-	30
Perfluorooctanoic Acid (PFOA)	2.67	37.9	51.7	129		-	-	-	70-130	-	-	30
Perfluorononanoic Acid (PFNA)	ND	37.9	53.4	141	Q	-	-	-	70-130	-	-	30
Perfluorooctanesulfonic Acid (PFOS)	4.59	35.2	45.2	115		-	-	-	70-130	-	-	30
Perfluorodecanoic Acid (PFDA)	ND	37.9	54.3	143	Q	-	-	-	70-130	-	-	30
9-Chlorohexadecafluoro-3-Oxanone-1-Sulfonic Acid (9Cl-PF3ONS)	ND	35.3	37.0	105		-	-	-	70-130	-	-	30
N-Methyl Perfluorooctanesulfonamidoacetic Acid (NMeFOSAA)	ND	37.9	41.0	108		-	-	-	70-130	-	-	30
Perfluoroundecanoic Acid (PFUnA)	ND	37.9	48.3	127		-	-	-	70-130	-	-	30
N-Ethyl Perfluorooctanesulfonamidoacetic Acid (NEtFOSAA)	ND	37.9	48.0	127		-	-	-	70-130	-	-	30
Perfluorododecanoic Acid (PFDoA)	ND	37.9	49.5	131	Q	-	-	-	70-130	-	-	30
11-Chloroeicosfluoro-3-Oxaundecane-1-Sulfonic Acid (11Cl-PF3OUds)	ND	35.8	36.1	101		-	-	-	70-130	-	-	30
Perfluorotridecanoic Acid (PFTrDA)	ND	37.9	47.3	125		-	-	-	70-130	-	-	30
Perfluorotetradecanoic Acid (PFTA)	ND	37.9	41.8	110		-	-	-	70-130	-	-	30

# **Matrix Spike Analysis**

## *Batch Quality Control*

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

Parameter	Native Sample	MS Added	MS Found	MS %Recovery	Qual	MSD Found	MSD %Recovery	Qual	Recovery Limits	RPD	Qual	RPD Limits
Perfluorinated Alkyl Acids by EPA 537.1 - Mansfield Lab	Associated sample(s): 01,03,05,09	QC Batch ID: WG1535052-3	QC Sample: L2142220-01	Client ID: MS Sample								
<b>Surrogate</b>												
2,3,3,3-Tetrafluoro-2-[1,1,2,2,3,3,3-Heptafluoropropoxy]-13C3-Propanoic Acid (M3HFPO-DA)	90								70-130			
N-Deuteroethylperfluoro-1-octanesulfonamidoacetic Acid (d5-NEtFOSAA)	119								70-130			
Perfluoro-n-[1,2-13C2]decanoic Acid (13C-PFDA)	125								70-130			
Perfluoro-n-[1,2-13C2]hexanoic Acid (13C-PFHxA)	107								70-130			

**Lab Duplicate Analysis**  
Batch Quality Control

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

Parameter	Native Sample	Duplicate Sample	Units	RPD	Qual	RPD Limits
Perfluorinated Alkyl Acids by Isotope Dilution - Mansfield Lab Client ID: SW-2	Associated sample(s): 02,04,06-08	QC Batch ID: WG1533682-4	QC Sample: L2142404-06			
Perfluorobutanoic Acid (PFBA)	1.91	1.97	ng/l	3		30
Perfluoropentanoic Acid (PFPeA)	4.98	4.82	ng/l	3		30
Perfluorobutanesulfonic Acid (PFBS)	2.37	2.40	ng/l	1		30
1H,1H,2H,2H-Perfluorohexanesulfonic Acid (4:2FTS)	ND	ND	ng/l	NC		30
Perfluorohexanoic Acid (PFHxA)	5.00	4.87	ng/l	3		30
Perfluoropentanesulfonic Acid (PFPeS)	ND	ND	ng/l	NC		30
Perfluoroheptanoic Acid (PFHpA)	3.15	3.12	ng/l	1		30
Perfluorohexanesulfonic Acid (PFHxS)	2.31	1.77	ng/l	26		30
Perfluorooctanoic Acid (PFOA)	8.31	8.15	ng/l	2		30
1H,1H,2H,2H-Perfluorooctanesulfonic Acid (6:2FTS)	ND	ND	ng/l	NC		30
Perfluoroheptanesulfonic Acid (PFHpS)	ND	ND	ng/l	NC		30
Perfluorononanoic Acid (PFNA)	ND	ND	ng/l	NC		30
Perfluorooctanesulfonic Acid (PFOS)	11.6	6.91	ng/l	51	Q	30
Perfluorodecanoic Acid (PFDA)	ND	ND	ng/l	NC		30
1H,1H,2H,2H-Perfluorodecanesulfonic Acid (8:2FTS)	ND	ND	ng/l	NC		30
Perfluoronananesulfonic Acid (PFNS)	ND	ND	ng/l	NC		30
N-Methyl Perfluorooctanesulfonamidoacetic Acid (NMeFOSAA)	ND	ND	ng/l	NC		30
Perfluoroundecanoic Acid (PFUnA)	ND	ND	ng/l	NC		30
Perfluorodecanesulfonic Acid (PFDS)	ND	ND	ng/l	NC		30
Perfluorooctanesulfonamide (FOSA)	ND	ND	ng/l	NC		30

# Lab Duplicate Analysis

## Batch Quality Control

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

Parameter	Native Sample	Duplicate Sample	Units	RPD	Qual	RPD Limits
Perfluorinated Alkyl Acids by Isotope Dilution - Mansfield Lab Associated sample(s): 02,04,06-08 QC Batch ID: WG1533682-4 QC Sample: L2142404-06						
Client ID: SW-2						
N-Ethyl Perfluoroctanesulfonamidoacetic Acid (NEtFOSAA)	ND	ND	ng/l	NC		30
Perfluorododecanoic Acid (PFDoA)	ND	ND	ng/l	NC		30
Perfluorotridecanoic Acid (PFTrDA)	ND	ND	ng/l	NC		30
Perfluorotetradecanoic Acid (PFTA)	ND	ND	ng/l	NC		30

Surrogate (Extracted Internal Standard)	%Recovery	Qualifier	%Recovery	Qualifier	Acceptance Criteria
Perfluoro[13C4]Butanoic Acid (MPFBA)	79	80			58-132
Perfluoro[13C5]Pentanoic Acid (M5PFPEA)	91	89			62-163
Perfluoro[2,3,4-13C3]Butanesulfonic Acid (M3PFBS)	113	110			70-131
1H,1H,2H,2H-Perfluoro[1,2-13C2]Hexanesulfonic Acid (M2-4:2FTS)	132	121			12-142
Perfluoro[1,2,3,4,6-13C5]Hexanoic Acid (M5PFHxA)	83	84			57-129
Perfluoro[1,2,3,4-13C4]Heptanoic Acid (M4PFHpA)	74	75			60-129
Perfluoro[1,2,3-13C3]Hexanesulfonic Acid (M3PFHxS)	110	109			71-134
Perfluoro[13C8]Octanoic Acid (M8PFOA)	77	78			62-129
1H,1H,2H,2H-Perfluoro[1,2-13C2]Octanesulfonic Acid (M2-6:2FTS)	116	116			14-147
Perfluoro[13C9]Nonanoic Acid (M9PFNA)	91	95			59-139
Perfluoro[13C8]Octanesulfonic Acid (M8PFOS)	101	107			69-131
Perfluoro[1,2,3,4,5,6-13C6]Decanoic Acid (M6PFDA)	79	87			62-124
1H,1H,2H,2H-Perfluoro[1,2-13C2]Decanesulfonic Acid (M2-8:2FTS)	112	118			10-162
N-Deuteriomethylperfluoro-1-octanesulfonamidoacetic Acid (d3-NMeFOSAA)	55	55			24-116
Perfluoro[1,2,3,4,5,6,7-13C7]Undecanoic Acid (M7-PFUDA)	80	86			55-137
Perfluoro[13C8]Octanesulfonamide (M8FOSA)	22	18			10-112
N-Deuteroethylperfluoro-1-octanesulfonamidoacetic Acid (d5-NEtFOSAA)	48	57			27-126
Perfluoro[1,2-13C2]Dodecanoic Acid (MPFDCA)	78	84			48-131

Project Name: WAYLAND HS  
 Project Number: ENG20-0296

**Lab Duplicate Analysis**  
**Batch Quality Control**

Lab Number: L2142404  
 Report Date: 08/17/21

Parameter	Native Sample	Duplicate Sample	Units	RPD	Qual	RPD Limits
Perfluorinated Alkyl Acids by Isotope Dilution - Mansfield Lab Associated sample(s): 02,04,06-08 QC Batch ID: WG1533682-4 QC Sample: L2142404-06 Client ID: SW-2						
Surrogate (Extracted Internal Standard)		%Recovery	Qualifier	%Recovery	Qualifier	Acceptance Criteria
Perfluoro[1,2-13C2]Tetradecanoic Acid (M2PFTEDA)		87		95		22-136

# Lab Duplicate Analysis

## Batch Quality Control

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

Parameter	Native Sample	Duplicate Sample	Units	RPD	Qual	RPD Limits
Perfluorinated Alkyl Acids by EPA 537.1 - Mansfield Lab Associated sample(s): 01,03,05,09 QC Batch ID: WG1535052-4 QC Sample: L2142221-01 Client ID: DUP Sample						
Perfluorobutanesulfonic Acid (PFBS)	ND	ND	ng/l	NC		30
Perfluorohexanoic Acid (PFHxA)	ND	ND	ng/l	NC		30
2,3,3,3-Tetrafluoro-2-[1,1,2,2,3,3,3-Heptafluoropropoxy]-Propanoic Acid (HFPO-DA)	ND	ND	ng/l	NC		30
Perfluoroheptanoic Acid (PFHpA)	ND	ND	ng/l	NC		30
Perfluorohexanesulfonic Acid (PFHxS)	ND	ND	ng/l	NC		30
4,8-Dioxa-3h-Perfluorononanoic Acid (ADONA)	ND	ND	ng/l	NC		30
Perfluorooctanoic Acid (PFOA)	ND	ND	ng/l	NC		30
Perfluorononanoic Acid (PFNA)	ND	ND	ng/l	NC		30
Perfluorooctanesulfonic Acid (PFOS)	ND	ND	ng/l	NC		30
Perfluorodecanoic Acid (PFDA)	ND	ND	ng/l	NC		30
9-Chlorohexadecafluoro-3-Oxanone-1-Sulfonic Acid (9CI-PF3ONS)	ND	ND	ng/l	NC		30
N-Methyl Perfluorooctanesulfonamidoacetic Acid (NMeFOSAA)	ND	ND	ng/l	NC		30
Perfluoroundecanoic Acid (PFUnA)	ND	ND	ng/l	NC		30
N-Ethyl Perfluorooctanesulfonamidoacetic Acid (NEtFOSAA)	ND	ND	ng/l	NC		30
Perfluorododecanoic Acid (PFDoA)	ND	ND	ng/l	NC		30
11-Chloroeicosfluoro-3-Oxaundecane-1-Sulfonic Acid (11CI-PF3OUdS)	ND	ND	ng/l	NC		30
Perfluorotridecanoic Acid (PFTrDA)	ND	ND	ng/l	NC		30
Perfluorotetradecanoic Acid (PFTA)	ND	ND	ng/l	NC		30
PFOA/PFOS, Total	ND	ND	ng/l	NC		30
PFAS, Total (5)	ND	ND	ng/l	NC		30

**Lab Duplicate Analysis**  
Batch Quality Control

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

Parameter	Native Sample	Duplicate Sample	Units	RPD	Qual	RPD Limits
Perfluorinated Alkyl Acids by EPA 537.1 - Mansfield Lab Associated sample(s): 01,03,05,09 QC Batch ID: WG1535052-4 QC Sample: L2142221-01 Client ID: DUP Sample						
PFAS, Total (6)	ND	ND	ng/l	NC		30

Surrogate	%Recovery	Qualifier	%Recovery	Qualifier	Acceptance Criteria
Perfluoro-n-[1,2-13C2]hexanoic Acid (13C-PFHxA)	108		115		70-130
2,3,3,3-Tetrafluoro-2-[1,1,2,2,3,3,3-Heptafluoropropoxy]-13C3-Propanoic Acid (M3HFPO-DA)	107		114		70-130
Perfluoro-n-[1,2-13C2]decanoic Acid (13C-PFDA)	129		141	Q	70-130
N-Deuteroethylperfluoro-1-octanesulfonamidoacetic Acid (d5-NEtFOSAA)	122		139	Q	70-130

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

Serial\_No:08172114:22  
**Lab Number:** L2142404  
**Report Date:** 08/17/21

### **Sample Receipt and Container Information**

Were project specific reporting limits specified? YES

#### **Cooler Information**

<b>Cooler</b>	<b>Custody Seal</b>
A	Absent

#### **Container Information**

<b>Container ID</b>	<b>Container Type</b>	<b>Cooler</b>	<b>Initial pH</b>	<b>Final pH</b>	<b>Temp deg C</b>	<b>Pres</b>	<b>Seal</b>	<b>Frozen Date/Time</b>	<b>Analysis(*)</b>
L2142404-01A	Plastic 250ml Trizma preserved	A	NA		4.8	Y	Absent		A2-MA-537.1(14)
L2142404-01B	Plastic 250ml Trizma preserved	A	NA		4.8	Y	Absent		A2-MA-537.1(14)
L2142404-02A	Plastic 250ml unpreserved	A	NA		4.8	Y	Absent		A2-537-ISOTOPE(14)
L2142404-02B	Plastic 250ml unpreserved	A	NA		4.8	Y	Absent		A2-537-ISOTOPE(14)
L2142404-03A	Plastic 250ml Trizma preserved	A	NA		4.8	Y	Absent		A2-MA-537.1(14)
L2142404-03B	Plastic 250ml Trizma preserved	A	NA		4.8	Y	Absent		A2-MA-537.1(14)
L2142404-04A	Plastic 250ml unpreserved	A	NA		4.8	Y	Absent		A2-537-ISOTOPE(14)
L2142404-04B	Plastic 250ml unpreserved	A	NA		4.8	Y	Absent		A2-537-ISOTOPE(14)
L2142404-05A	Plastic 250ml Trizma preserved	A	NA		4.8	Y	Absent		A2-MA-537.1(14)
L2142404-05B	Plastic 250ml Trizma preserved	A	NA		4.8	Y	Absent		A2-MA-537.1(14)
L2142404-06A	Plastic 250ml unpreserved	A	NA		4.8	Y	Absent		A2-537-ISOTOPE(14)
L2142404-06B	Plastic 250ml unpreserved	A	NA		4.8	Y	Absent		A2-537-ISOTOPE(14)
L2142404-07A	Plastic 250ml unpreserved	A	NA		4.8	Y	Absent		A2-537-ISOTOPE(14)
L2142404-07B	Plastic 250ml unpreserved	A	NA		4.8	Y	Absent		A2-537-ISOTOPE(14)
L2142404-08A	Plastic 250ml unpreserved	A	NA		4.8	Y	Absent		A2-537-ISOTOPE(14)
L2142404-08B	Plastic 250ml unpreserved	A	NA		4.8	Y	Absent		A2-537-ISOTOPE(14)
L2142404-09A	Plastic 250ml Trizma preserved	A	NA		4.8	Y	Absent		A2-MA-537.1(14)

\*Values in parentheses indicate holding time in days

### PFAS PARAMETER SUMMARY

Parameter	Acronym	CAS Number
<b>PERFLUOROALKYL CARBOXYLIC ACIDS (PFCAs)</b>		
Perfluorooctadecanoic Acid	PFODA	16517-11-6
Perfluorohexadecanoic Acid	PFHxDA	67905-19-5
Perfluorotetradecanoic Acid	PFTA	376-06-7
Perfluorotridecanoic Acid	PFTrDA	72629-94-8
Perfluorododecanoic Acid	PFDoA	307-55-1
Perfluoroundecanoic Acid	PFUnA	2058-94-8
Perfluorodecanoic Acid	PFDA	335-76-2
Perfluorononanoic Acid	PFNA	375-95-1
Perfluoroctanoic Acid	PFOA	335-67-1
Perfluoroheptanoic Acid	PFHpA	375-85-9
Perfluorohexanoic Acid	PFHxA	307-24-4
Perfluoropentanoic Acid	PPPeA	2706-90-3
Perfluorobutanoic Acid	PFBA	375-22-4
<b>PERFLUOROALKYL SULFONIC ACIDS (PFSAs)</b>		
Perfluorododecanesulfonic Acid	PFDoDS	79780-39-5
Perfluorodecanesulfonic Acid	PFDS	335-77-3
Perfluorononanesulfonic Acid	PFNS	68259-12-1
Perfluoroctanesulfonic Acid	PFOS	1763-23-1
Perfluoroheptanesulfonic Acid	PFHpS	375-92-8
Perfluorohexanesulfonic Acid	PFHxS	355-46-4
Perfluoropentanesulfonic Acid	PPPeS	2706-91-4
Perfluorobutanesulfonic Acid	PFBS	375-73-5
<b>FLUOROTELOMERS</b>		
1H,1H,2H,2H-Perfluorododecanesulfonic Acid	10:2FTS	120226-60-0
1H,1H,2H,2H-Perfluorodecanesulfonic Acid	8:2FTS	39108-34-4
1H,1H,2H,2H-Perfluoroctanesulfonic Acid	6:2FTS	27619-97-2
1H,1H,2H,2H-Perfluorohexanesulfonic Acid	4:2FTS	757124-72-4
<b>PERFLUOROALKANE SULFONAMIDES (FASAs)</b>		
Perfluoroctanesulfonamide	FOSA	754-91-6
N-Ethyl Perfluoroctane Sulfonamide	NEtFOSA	4151-50-2
N-Methyl Perfluoroctane Sulfonamide	NMeFOSA	31506-32-8
<b>PERFLUOROALKANE SULFONYL SUBSTANCES</b>		
N-Ethyl Perfluoroctanesulfonamido Ethanol	NEtFOSE	1691-99-2
N-Methyl Perfluoroctanesulfonamido Ethanol	NMeFOSE	24448-09-7
N-Ethyl Perfluoroctanesulfonamidoacetic Acid	NEtFOSAA	2991-50-6
N-Methyl Perfluoroctanesulfonamidoacetic Acid	NMeFOSAA	2355-31-9
<b>PER- and POLYFLUOROALKYL ETHER CARBOXYLIC ACIDS</b>		
2,3,3,3-Tetrafluoro-2-[1,1,2,2,3,3,3-Heptafluoropropoxy]-Propanoic Acid	HFPO-DA	13252-13-6
4,8-Dioxa-3h-Perfluorononanoic Acid	ADONA	919005-14-4
<b>CHLORO-PERFLUOROALKYL SULFONIC ACIDS</b>		
11-Chloroeicosfluoro-3-Oxaundecane-1-Sulfonic Acid	11CI-PF3OUdS	763051-92-9
9-Chlorohexadecafluoro-3-Oxanone-1-Sulfonic Acid	9CI-PF3ONS	756426-58-1
<b>PERFLUORETHER SULFONIC ACIDS (PFESAs)</b>		
Perfluoro(2-Ethoxyethane)Sulfonic Acid	PFEESA	113507-82-7
<b>PERFLUORETHER/POLYETHER CARBOXYLIC ACIDS (PFPCAs)</b>		
Perfluoro-3-Methoxypropanoic Acid	PFMPA	377-73-1
Perfluoro-4-Methoxybutanoic Acid	PFMBA	863090-89-5
Nonafuoro-3,6-Dioxaheptanoic Acid	NFDHA	151772-58-6

**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

## GLOSSARY

### **Acronyms**

DL	- Detection Limit: This value represents the level to which target analyte concentrations are reported as estimated values, when those target analyte concentrations are quantified below the limit of quantitation (LOQ). The DL includes any adjustments from dilutions, concentrations or moisture content, where applicable. (DoD report formats only.)
EDL	- Estimated Detection Limit: This value represents the level to which target analyte concentrations are reported as estimated values, when those target analyte concentrations are quantified below the reporting limit (RL). The EDL includes any adjustments from dilutions, concentrations or moisture content, where applicable. The use of EDLs is specific to the analysis of PAHs using Solid-Phase Microextraction (SPME).
EMPC	- Estimated Maximum Possible Concentration: The concentration that results from the signal present at the retention time of an analyte when the ions meet all of the identification criteria except the ion abundance ratio criteria. An EMPC is a worst-case estimate of the concentration.
EPA	- Environmental Protection Agency.
LCS	- Laboratory Control Sample: A sample matrix, free from the analytes of interest, spiked with verified known amounts of analytes or a material containing known and verified amounts of analytes.
LCSD	- Laboratory Control Sample Duplicate: Refer to LCS.
LFB	- Laboratory Fortified Blank: A sample matrix, free from the analytes of interest, spiked with verified known amounts of analytes or a material containing known and verified amounts of analytes.
LOD	- Limit of Detection: This value represents the level to which a target analyte can reliably be detected for a specific analyte in a specific matrix by a specific method. The LOD includes any adjustments from dilutions, concentrations or moisture content, where applicable. (DoD report formats only.)
LOQ	- Limit of Quantitation: The value at which an instrument can accurately measure an analyte at a specific concentration. The LOQ includes any adjustments from dilutions, concentrations or moisture content, where applicable. (DoD report formats only.)  Limit of Quantitation: The value at which an instrument can accurately measure an analyte at a specific concentration. The LOQ includes any adjustments from dilutions, concentrations or moisture content, where applicable. (DoD report formats only.)
MDL	- Method Detection Limit: This value represents the level to which target analyte concentrations are reported as estimated values, when those target analyte concentrations are quantified below the reporting limit (RL). The MDL includes any adjustments from dilutions, concentrations or moisture content, where applicable.
MS	- Matrix Spike Sample: A sample prepared by adding a known mass of target analyte to a specified amount of matrix sample for which an independent estimate of target analyte concentration is available. For Method 332.0, the spike recovery is calculated using the native concentration, including estimated values.
MSD	- Matrix Spike Sample Duplicate: Refer to MS.
NA	- Not Applicable.
NC	- Not Calculated: Term is utilized when one or more of the results utilized in the calculation are non-detect at the parameter's reporting unit.
NDPA/DPA	- N-Nitrosodiphenylamine/Diphenylamine.
NI	- Not Ignitable.
NP	- Non-Plastic: Term is utilized for the analysis of Atterberg Limits in soil.
NR	- No Results: Term is utilized when 'No Target Compounds Requested' is reported for the analysis of Volatile or Semivolatile Organic TIC only requests.
RL	- Reporting Limit: The value at which an instrument can accurately measure an analyte at a specific concentration. The RL includes any adjustments from dilutions, concentrations or moisture content, where applicable.
RPD	- Relative Percent Difference: The results from matrix and/or matrix spike duplicates are primarily designed to assess the precision of analytical results in a given matrix and are expressed as relative percent difference (RPD). Values which are less than five times the reporting limit for any individual parameter are evaluated by utilizing the absolute difference between the values; although the RPD value will be provided in the report.
SRM	- Standard Reference Material: A reference sample of a known or certified value that is of the same or similar matrix as the associated field samples.
STLP	- Semi-dynamic Tank Leaching Procedure per EPA Method 1315.
TEF	- Toxic Equivalency Factors: The values assigned to each dioxin and furan to evaluate their toxicity relative to 2,3,7,8-TCDD.
TEQ	- Toxic Equivalent: The measure of a sample's toxicity derived by multiplying each dioxin and furan by its corresponding TEF and then summing the resulting values.
TIC	- Tentatively Identified Compound: A compound that has been identified to be present and is not part of the target compound list (TCL) for the method and/or program. All TICs are qualitatively identified and reported as estimated concentrations.

**Report Format:** Data Usability Report



**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

#### Footnotes

- 1 - The reference for this analyte should be considered modified since this analyte is absent from the target analyte list of the original method.

#### Terms

**Analytical Method:** Both the document from which the method originates and the analytical reference method. (Example: EPA 8260B is shown as 1,8260B.) The codes for the reference method documents are provided in the References section of the Addendum.

**Difference:** With respect to Total Oxidizable Precursor (TOP) Assay analysis, the difference is defined as the Post-Treatment value minus the Pre-Treatment value.

**Final pH:** As it pertains to Sample Receipt & Container Information section of the report, Final pH reflects pH of container determined after adjustment at the laboratory, if applicable. If no adjustment required, value reflects Initial pH.

**Frozen Date/Time:** With respect to Volatile Organics in soil, Frozen Date/Time reflects the date/time at which associated Reagent Water-preserved vials were initially frozen. Note: If frozen date/time is beyond 48 hours from sample collection, value will be reflected in 'bold'.

**Initial pH:** As it pertains to Sample Receipt & Container Information section of the report, Initial pH reflects pH of container determined upon receipt, if applicable.

**PAH Total:** With respect to Alkylated PAH analyses, the 'PAHs, Total' result is defined as the summation of results for all or a subset of the following compounds: Naphthalene, C1-C4 Naphthalenes, 2-Methylnaphthalene, 1-Methylnaphthalene, Biphenyl, Acenaphthylene, Acenaphthene, Fluorene, C1-C3 Fluorenes, Phenanthrene, C1-C4 Phenanthrenes/Anthracenes, Anthracene, Fluoranthene, Pyrene, C1-C4 Fluoranthrenes/Pyrenes, Benz(a)anthracene, Chrysene, C1-C4 Chrysenes, Benzo(b)fluoranthene, Benzo(j)+(k)fluoranthene, Benzo(e)pyrene, Benzo(a)pyrene, Perylene, Indeno(1,2,3-cd)pyrene, Dibenz(ah)+(ac)anthracene, Benzo(g,h,i)perylene. If a 'Total' result is requested, the results of its individual components will also be reported.

**PFAS Total:** With respect to PFAS analyses, the 'PFAS, Total (5)' result is defined as the summation of results for: PFHpA, PFHxS, PFOA, PFNA and PFOS. In addition, the 'PFAS, Total (6)' result is defined as the summation of results for: PFHpA, PFHxS, PFOA, PFNA, PFDA and PFOS. For MassDEP DW compliance analysis only, the 'PFAS, Total (6)' result is defined as the summation of results at or above the RL. Note: If a 'Total' result is requested, the results of its individual components will also be reported.

The target compound Chlordane (CAS No. 57-74-9) is reported for GC ECD analyses. Per EPA, this compound "refers to a mixture of chlordane isomers, other chlorinated hydrocarbons and numerous other components." (Reference: USEPA Toxicological Review of Chlordane, In Support of Summary Information on the Integrated Risk Information System (IRIS), December 1997.)

**Total:** With respect to Organic analyses, a 'Total' result is defined as the summation of results for individual isomers or Aroclors. If a 'Total' result is requested, the results of its individual components will also be reported. This is applicable to 'Total' results for methods 8260, 8081 and 8082.

#### Data Qualifiers

- A** - Spectra identified as "Aldol Condensates" are byproducts of the extraction/concentration procedures when acetone is introduced in the process.
- B** - The analyte was detected above the reporting limit in the associated method blank. Flag only applies to associated field samples that have detectable concentrations of the analyte at less than ten times (10x) the concentration found in the blank. For MCP-related projects, flag only applies to associated field samples that have detectable concentrations of the analyte at less than ten times (10x) the concentration found in the blank. For DOD-related projects, flag only applies to associated field samples that have detectable concentrations of the analyte at less than ten times (10x) the concentration found in the blank AND the analyte was detected above one-half the reporting limit (or above the reporting limit for common lab contaminants) in the associated method blank. For NJ-Air-related projects, flag only applies to associated field samples that have detectable concentrations of the analyte above the reporting limit. For NJ-related projects (excluding Air), flag only applies to associated field samples that have detectable concentrations of the analyte, which was detected above the reporting limit in the associated method blank or above five times the reporting limit for common lab contaminants (Phthalates, Acetone, Methylene Chloride, 2-Butanone).
- C** - Co-elution: The target analyte co-elutes with a known lab standard (i.e. surrogate, internal standards, etc.) for co-extracted analyses.
- D** - Concentration of analyte was quantified from diluted analysis. Flag only applies to field samples that have detectable concentrations of the analyte.
- E** - Concentration of analyte exceeds the range of the calibration curve and/or linear range of the instrument.
- F** - The ratio of quantifier ion response to qualifier ion response falls outside of the laboratory criteria. Results are considered to be an estimated maximum concentration.
- G** - The concentration may be biased high due to matrix interferences (i.e., co-elution) with non-target compound(s). The result should be considered estimated.
- H** - The analysis of pH was performed beyond the regulatory-required holding time of 15 minutes from the time of sample collection.
- I** - The lower value for the two columns has been reported due to obvious interference.
- J** - Estimated value. This represents an estimated concentration for Tentatively Identified Compounds (TICs).
- M** - Reporting Limit (RL) exceeds the MCP CAM Reporting Limit for this analyte.
- ND** - Not detected at the reporting limit (RL) for the sample.
- NJ** - Presumptive evidence of compound. This represents an estimated concentration for Tentatively Identified Compounds (TICs), where

**Report Format:** Data Usability Report



**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

**Data Qualifiers**

the identification is based on a mass spectral library search.

- P** - The RPD between the results for the two columns exceeds the method-specified criteria.
- Q** - The quality control sample exceeds the associated acceptance criteria. For DOD-related projects, LCS and/or Continuing Calibration Standard exceedences are also qualified on all associated sample results. Note: This flag is not applicable for matrix spike recoveries when the sample concentration is greater than 4x the spike added or for batch duplicate RPD when the sample concentrations are less than 5x the RL. (Metals only.)
- R** - Analytical results are from sample re-analysis.
- RE** - Analytical results are from sample re-extraction.
- S** - Analytical results are from modified screening analysis.

*Report Format: Data Usability Report*



**Project Name:** WAYLAND HS  
**Project Number:** ENG20-0296

**Lab Number:** L2142404  
**Report Date:** 08/17/21

## REFERENCES

- 133 Determination of Selected Per- and Polyfluorinated Alkyl Substances in Drinking Water by Solid Phase Extraction and Liquid Chromatography/Tandem Mass Spectrometry (LC/MS/MS). EPA Method 537.1, EPA/600/R-18/352. Version 1.0, November 2018.
- 134 Determination of Selected Perfluorinated Alkyl Acids in Drinking Water by Solid Phase Extraction and Liquid Chromatography/Tandem Mass Spectrometry (LC/MS/MS) using Isotope Dilution. Alpha SOP 23528.

## LIMITATION OF LIABILITIES

Alpha Analytical performs services with reasonable care and diligence normal to the analytical testing laboratory industry. In the event of an error, the sole and exclusive responsibility of Alpha Analytical shall be to re-perform the work at its own expense. In no event shall Alpha Analytical be held liable for any incidental, consequential or special damages, including but not limited to, damages in any way connected with the use of, interpretation of, information or analysis provided by Alpha Analytical.

We strongly urge our clients to comply with EPA protocol regarding sample volume, preservation, cooling, containers, sampling procedures, holding time and splitting of samples in the field.



## Certification Information

---

**The following analytes are not included in our Primary NELAP Scope of Accreditation:**

**Westborough Facility**

EPA 624/624.1: m/p-xylene, o-xylene, Naphthalene

EPA 625/625.1: alpha-Terpineol

EPA 8260C/8260D: NPW: 1,2,4,5-Tetramethylbenzene; 4-Ethyltoluene, Azobenzene; SCM: Iodomethane (methyl iodide), 1,2,4,5-Tetramethylbenzene; 4-Ethyltoluene.

EPA 8270D/8270E: NPW: Dimethylnaphthalene,1,4-Diphenylhydrazine, alpha-Terpineol; SCM: Dimethylnaphthalene,1,4-Diphenylhydrazine.  
SM4500: NPW: Amenable Cyanide; SCM: Total Phosphorus, TKN, NO<sub>2</sub>, NO<sub>3</sub>.

**Mansfield Facility**

**SM 2540D**: TSS

EPA 8082A: NPW: PCB: 1, 5, 31, 87,101, 110, 141, 151, 153, 180, 183, 187.

EPA TO-15: Halothane, 2,4,4-Trimethyl-2-pentene, 2,4,4-Trimethyl-1-pentene, Thiophene, 2-Methylthiophene, 3-Methylthiophene, 2-Ethylthiophene, 1,2,3-Trimethylbenzene, Indan, Indene, 1,2,4,5-Tetramethylbenzene, Benzothiophene, 1-Methylnaphthalene.

**Biological Tissue Matrix**: EPA 3050B

---

**The following analytes are included in our Massachusetts DEP Scope of Accreditation**

**Westborough Facility:**

**Drinking Water**

EPA 300.0: Chloride, Nitrate-N, Fluoride, Sulfate; EPA 353.2: Nitrate-N, Nitrite-N; **SM4500NO3-F**: Nitrate-N, Nitrite-N; **SM4500F-C**, **SM4500CN-CE**, **EPA 180.1**, **SM2130B**, **SM4500CI-D**, **SM2320B**, **SM2540C**, **SM4500H-B**, **SM4500NO2-B**

EPA 332: Perchlorate; **EPA 524.2**: THMs and VOCs; **EPA 504.1**: EDB, DBCP.

**Microbiology**: **SM9215B**; **SM9223-P/A**, **SM9223B-Colilert-QT**, **SM9222D**.

**Non-Potable Water**

**SM4500H,B**, **EPA 120.1**, **SM2510B**, **SM2540C**, **SM2320B**, **SM4500CL-E**, **SM4500F-BC**, **SM4500NH3-BH**: Ammonia-N and Kjeldahl-N, **EPA 350.1**: Ammonia-N, LACHAT 10-107-06-1-B: Ammonia-N, **EPA 351.1**, **SM4500NO3-F**, **EPA 353.2**: Nitrate-N, **SM4500P-E**, **SM4500P-B**, **E**, **SM4500SO4-E**, **SM5220D**, **EPA 410.4**, **SM5210B**, **SM5310C**, **SM4500CL-D**, **EPA 1664**, **EPA 420.1**, **SM4500-CN-CE**, **SM2540D**, **EPA 300**: Chloride, Sulfate, Nitrate.

EPA 624.1: Volatile Halocarbons & Aromatics,

EPA 608.3: Chlordane, Toxaphene, Aldrin, alpha-BHC, beta-BHC, gamma-BHC, delta-BHC, Dieldrin, DDD, DDE, DDT, Endosulfan I, Endosulfan II, Endosulfan sulfate, Endrin, Endrin Aldehyde, Heptachlor, Heptachlor Epoxide, PCBs

EPA 625.1: SVOC (Acid/Base/Neutral Extractables), **EPA 600/4-81-045**: PCB-Oil.

**Microbiology**: **SM9223B-Colilert-QT**; **Enterolert-QT**, **SM9221E**, **EPA 1600**, **EPA 1603**, **SM9222D**.

**Mansfield Facility:**

**Drinking Water**

EPA 200.7: Al, Ba, Cd, Cr, Cu, Fe, Mn, Ni, Na, Ag, Ca, Zn. **EPA 200.8**: Al, Sb, As, Ba, Be, Cd, Cr, Cu, Pb, Mn, Ni, Se, Ag, TL, Zn. **EPA 245.1** Hg. **EPA 522**, **EPA 537.1**.

**Non-Potable Water**

EPA 200.7: Al, Sb, As, Be, Cd, Ca, Cr, Co, Cu, Fe, Pb, Mg, Mn, Mo, Ni, K, Se, Ag, Na, Sr, Ti, V, Zn.

EPA 200.8: Al, Sb, As, Be, Cd, Cr, Cu, Fe, Pb, Mn, Ni, K, Se, Ag, Na, TL, Zn.

EPA 245.1 Hg.

**SM2340B**

---

For a complete listing of analytes and methods, please contact your Alpha Project Manager.



## CHAIN OF CUSTODY

PAGE 1 OF 1

8 Walkup Drive  
Westboro, MA 01581  
Tel 508-898-9220

320 Forbes Blvd  
Marlboro, MA 01752  
Tel 508-822-9300

## Client Information

Client: Weston & Sampson Inc  
Address: 55 Walkers Brook Dr  
Reading MA

Phone: 978-532-1900  
Email: mackinnon@wseiinc.com  
getchell@wseiinc.com

## Additional Project Information:

## Project Information

Project Name: Wayland MAHS

Project Location: Wayland MA

Project #: EN620-S296

Project Manager:

ALPHA Quote #:

## Turn-Around Time

Standard       RUSH (only confirmed if pre-approved)

Date Due:

Data Rec'd in Lab: 8/17/21

ALPHA Job #: LaM2404

## Report Information - Data Deliverables

ADEX       EMAIL

Same as Client Info      PO #:

## Regulatory Requirements &amp; Project Information Requirements

- Yes  No MA MCP Analytical Methods       Yes  No CT RCP Analytical Methods  
 Yes  No Matrix Spike Required on this SDG? (Required for MCP Inorganics)  
 Yes  No GW1 Standards (Info Required for Metals & EPH with Targets)  
 Yes  No NPDES RGP  
 Other State /Fed Program

Criteria

## SAMPLE INFO

Filtration

Field

Lab to do

Preservation

Lab to do

Sample Comments

ALPHA Lab ID (Lab Use Only)	Sample ID	Collection Date	Time	Sample Matrix	Sampler Initials
LaM2404-01	MW-6	8/16/21	0855	DW	JAG
-02	SW-1		0915	SW	
-03	MW-1		0945	DW	
-04	SW-5		1010	SW	
-05	SH-4		1110	DW	
-06	SW-2		1200	SW	
-07	SW-3		1215		
-08	SW-4		1230		
-09	PB-01		1255		

Container Type  
P= Plastic  
A= Amber Glass  
V= Vial  
G= Glass  
B= Beaker/cup  
C= Cube  
O= Cellar  
E= Erlenmeyer  
D= DOD Bottle  
I= Isotopic Dilution

Preservative  
A= None  
B= HCl  
C= HNO3  
D= H2SO4  
E= NaOH  
F= MeOH  
G= NaHSO4  
H= Na2S2O3  
I= Ascorbic Acid  
J= NH4Cl  
K= Zn Acetate  
O= Other

## Container Type

## Preservative

Container Type	Preservative

Relinquished By:	Date/Time	Received By:	Date/Time
Ashey Grassy	8/16/21 2:56	John JAG	8/16/21 12:56
Extant pm	8/16/21 1700	John JAG	8/16/21 1700
	8/16/21 2050	John JAG	8/16/21 2010

All samples submitted are subject to Alpha's Terms and Conditions.  
See reverse side.

FORM NO: 01-01 (rev. 12-Mar-2012)